


Zone 40 Water Supply Master Plan Amendment For the NewBridge Project

February 2016



SACRAMENTO COUNTY
WATER AGENCY

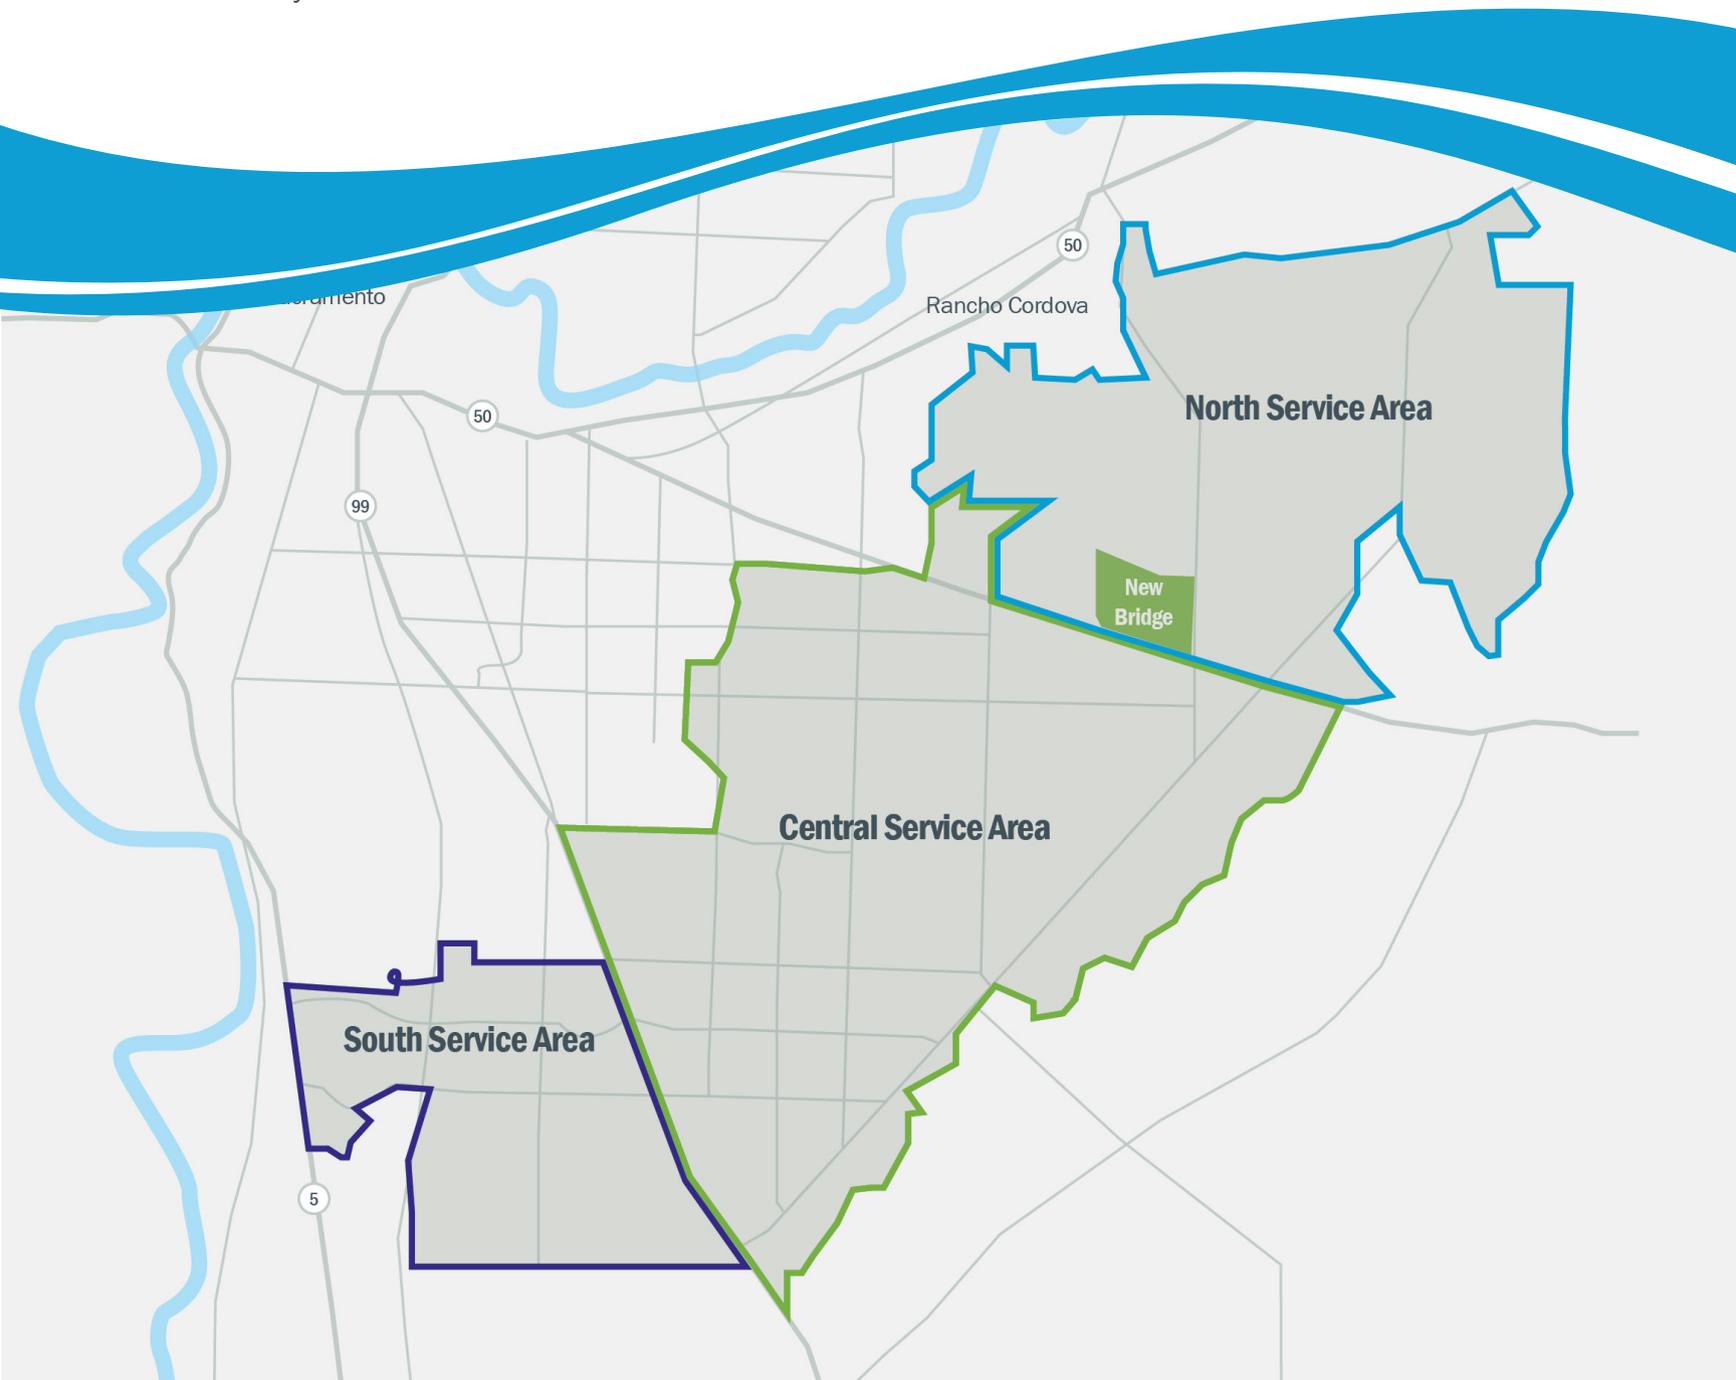

Zone 40 Water Supply Master Plan Amendment

For the NewBridge Project

Prepared for
Sacramento County Water Agency
Sacramento, CA
February 5, 2016

10540 White Rock Road, Suite 180
Rancho Cordova, California 95670

T: 916.444.0123
F: 916.635.8805



February 5, 2016

Robert Gardner
Sacramento County Water Agency
827 7th Street, Room 301
Sacramento, CA 95814

148130

Subject: Zone 40 Water Supply Master Plan Amendment for the
NewBridge Project

Dear Mr. Gardner:

Brown and Caldwell is pleased to submit the above referenced plan. Please do not
hesitate to contact me if you have any questions or comments.

Very truly yours,

Brown and Caldwell

A handwritten signature in black ink that reads "Paul Selsky". The signature is written in a cursive, flowing style.

Paul Selsky, PE
Project Manager

PS:ds

Zone 40 Water Supply Master Plan Amendment

For the NewBridge Project

Prepared for
Sacramento County Water Agency, Sacramento, CA
February 5, 2016



148130

Project Participants

Sacramento County Water Agency

Darrell Eck, Senior Civil Engineer

Robert Gardner, Associate Civil Engineer

Ping Chen, Associate Civil Engineer

Bob Steeg, GIS

Daniel Barry, Senior Civil Engineer

Carlos Smith, Associate Civil Engineer

John Kern, Associate Civil Engineer

Brown and Caldwell

Paul Selsky, Project Manager

Melanie Holton, Project Engineer

Jeff Lawrence, Reviewer

Dawn Schock, Document Preparation

May Huang, Engineer

Elizabeth Velasco, Engineer

Table of Contents

List of Figures	v
List of Tables.....	vi
List of Abbreviations.....	x
1. Introduction	1-1
1.1 SCWA and Zone 40	1-1
1.2 Purpose.....	1-1
1.3 Linkage to 2005 Zone 40 Water Supply Master Plan	1-2
1.4 Service Area Description.....	1-2
1.4.1 North Service Area	1-3
1.4.2 Central Service Area	1-3
1.4.3 South Service Area.....	1-3
1.5 Report Organization	1-3
2. Existing Water System Description	2-1
2.1 Surface Water Facilities	2-1
2.2 Groundwater Facilities	2-2
2.3 Water Distribution Facilities	2-9
2.3.1 Pressure Zones	2-9
2.3.2 Pipelines	2-9
2.3.3 Storage Facilities.....	2-10
2.4 Recycled Water Facilities	2-10
3. Water Demands	3-1
3.1 Historical Connections and Water Production.....	3-1
3.2 Water Demand Projection Methodology	3-3
3.3 Land Use	3-4
3.3.1 Planning Subareas.....	3-4
3.3.2 Land Use.....	3-4
3.3.3 Residential Land Use Density	3-8
3.4 Connection Growth Projection	3-8
3.5 Unit Water Demand Factors	3-9
3.6 Recycled Water Demands.....	3-12
4. Water Supply	4-1
4.1 Water Forum Agreement.....	4-1
4.2 Surface Water.....	4-1
4.2.1 Central Valley Project Water	4-1
4.2.2 Appropriative Water	4-3
4.2.3 City of Sacramento’s American River Place of Use Water Supply	4-3

4.2.4	Other Water Supplies.....	4-4
4.2.5	Summary of Surface Water Supplies.....	4-4
4.2.6	Historical Use of Surface Water Supplies.....	4-5
4.3	Groundwater.....	4-6
4.3.1	Sacramento Central Groundwater Authority (SCGA) and Groundwater Management Plan.....	4-6
4.3.2	Groundwater Basin Description	4-7
4.3.3	Historical Use of Groundwater Supplies.....	4-7
4.3.4	Remediated Groundwater	4-7
5.	Water Supply Capacity Approach	5-1
5.1	Maximum Day Demand Supply Capacity and Use	5-1
5.1.1	North Service Area	5-2
5.1.2	Central Service Area	5-2
5.1.3	South Service Area.....	5-3
5.2	Annual Water Supply Capacity and Use.....	5-3
5.3	Storage and Pumping Station Capacity Evaluation Approach.....	5-3
5.3.1	Storage Volume.....	5-4
5.3.2	Pump Station Capacity	5-4
6.	Water System Facilities and Capital Improvement Plan Approach.....	6-1
6.1	Needed Water System Facilities	6-1
6.2	Capital Improvement Plan	6-1
6.3	Basis of Cost Estimates	6-2
7.	Baseline.....	7-1
7.1	Water Demands.....	7-1
7.1.1	Buildout Demographics	7-1
7.1.2	Buildout Water Demands	7-5
7.1.3	Water Demand Growth Projection	7-6
7.2.1	Maximum Day Demand Supply Capacity and Use.....	7-7
7.2.2	Annual Water Supply	7-9
7.2.3	Storage and Pumping Station Capacity Evaluation	7-12
7.3.1	Needed Water System Facilities	7-13
7.3.2	Capital Improvement Plan	7-22
8.	NewBridge	8-1
8.1.1	Buildout Demographics	8-1
8.1.2	Buildout Water Demands	8-8
8.1.3	Water Demand Growth Projection	8-10
8.2.1	Maximum Day Demand Supply Capacity and Use.....	8-11
8.2.2	Annual Water Supply	8-14
8.2.3	Storage and Pumping Station Capacity Evaluation	8-16
8.3.1	Needed Water System Facilities	8-17

8.3.2	Capital Improvement Plan	8-24
9.	Cumulative.....	9-1
9.1.1	Buildout Demographics	9-1
9.1.2	Buildout Water Demands	9-11
9.1.3	Water Demand Growth Projection	9-14
9.2	Water Supply Capacity	9-15
9.2.1	Maximum Day Demand Supply Capacity and Use.....	9-15
9.2.2	Annual Water Supply	9-18
9.2.3	Storage and Pumping Station Capacity Evaluation	9-21
9.3	Water System Facilities and Capital Improvement Program	9-22
9.3.1	Needed Water System Facilities	9-22
9.3.2	Capital Improvement Plan	9-29
10.	References.....	10-1
	Appendix A: Zone 40 Residential Unit Water Demand Factors Technical Memorandum	A
	Appendix B: Baseline Supply and Demand Comparison Tables.....	B
	Appendix C: NewBridge Supply and Demand Comparison Tables	C
	Appendix D: Cumulative Supply and Demand Comparison Tables	D
	Appendix E: Cost Estimates for CIP Projects.....	E

List of Figures

Figure 1-1. Zone 40 Service Area	1-4
Figure 2-1. Existing Supply Facilities - NSA	2-4
Figure 2-2. Existing Supply Facilities – CSA	2-5
Figure 2-3. Existing Supply Facilities – SSA	2-8
Figure 2-4. Existing System Hydraulic Schematic	2-11
Figure 3-1. Historical Connections by Service Area	3-1
Figure 3-2. Historical Annual Water Production by Service Area	3-2
Figure 3-3. Water Demand Estimate Analysis Progression	3-3
Figure 3-4. Water Planning Subareas	3-5
Figure 3-5. Developed Area Currently Served by SCWA	3-6
Figure 4-1. Zone 40 Water Supply	4-2
Figure 4-2. Historical Annual Water Supply	4-5
Figure 4-3. Monthly Water Production by Type of Supply	4-6
Figure 4-4. Available Water Supplies	4-9
Figure 5-1. 2013 Maximum Day Demand and Supply Capacity by Service Area	5-2
Figure 7-1. Buildout Land Use - Baseline	7-2
Figure 7-2. Historical and Projected Population in Zone 40 - Baseline	7-3
Figure 7-3. Historical and Projected Zone 40 Connections at High, Medium, and Low Growth Rates – Baseline	7-5
Figure 7-4. Water Demand Projection – Baseline	7-7
Figure 7-5. Phase 1 CIP Projects – NSA, Baseline	7-14
Figure 7-6. Phase 1 CIP Projects - CSA & SSA, Baseline	7-16
Figure 7-7. Phase 2 & 3 CIP Projects – NSA, Baseline	7-17
Figure 7-8. Phase 2 & 3 CIP Projects - CSA & SSA, Baseline	7-18
Figure 8-1. NewBridge Land Use – NewBridge Area	8-3
Figure 8-2. Buildout Land Use – NewBridge	8-5
Figure 8-3. Historical and Projected Population – NewBridge	8-6
Figure 8-4. Historical and Projected Connections at High, Medium, and Low Growth Rates – NewBridge	8-8
Figure 8-5. Water Demand Projection – NewBridge	8-11
Figure 8-6. Phase 1 CIP Projects – NSA, NewBridge	8-18
Figure 8-7. Phase 1 CIP Projects - CSA & SSA, NewBridge	8-19
Figure 8-8. Phase 2 & 3 CIP Projects – NSA, NewBridge	8-20

Figure 8-9. Phase 2 & 3 CIP Projects - CSA & SSA, NewBridge	8-21
Figure 9-1. New Growth Areas Land Use	9-3
Figure 9-2. Buildout Land Use – Cumulative	9-7
Figure 9-3. Historical and Projected Population	9-8
Figure 9-4. Historical and Projected Zone 40 Connections at High, Medium, and Low Growth Rates - Cumulative.....	9-10
Figure 9-5. Water Demand Projection – Cumulative.....	9-14
Figure 9-6. Maximum Day Demand to Supply Capacity Comparison by Phase - Cumulative.....	9-17
Figure 9-7. Maximum Day Use of Water Supplies by Phase and Climate Year Type - Cumulative	9-18
Figure 9-8. Zone 40 Annual Use of Water Supplies by Phase and Climate Year Type	9-21
Figure 9-9. Phase 1 CIP Projects – NSA - Cumulative.....	9-23
Figure 9-10. Phase 1 CIP Projects - CSA & SSA - Cumulative.....	9-24
Figure 9-11. Phase 2 & 3 CIP Projects – NSA - Cumulative	9-25
Figure 9-12. Phase 2 & 3 CIP Projects - CSA & SSA - Cumulative.....	9-26
Figure 9-13. CIP Summary by Phase.....	9-34

List of Tables

Table 2-1. Zone 40 Surface Water Facilities	2-2
Table 2-2. NSA Groundwater Facilities	2-3
Table 2-3. CSA Groundwater Facilities.....	2-6
Table 2-4. SSA Groundwater Facilities.....	2-7
Table 2-5. Pressure Zones	2-9
Table 2-6. Distribution Pipeline Length by Diameter by Service Area.....	2-9
Table 2-7. Stand-alone Storage Facilities	2-10
Table 3-1. Zone 40 Historical Water Production, ac-ft/yr	3-2
Table 3-2. 2010 Area By Land Use	3-7
Table 3-3. Projected Annual Connection Growth (new connections) ^(a)	3-9
Table 3-4. Zone 40 Comparison of 2010 to Buildout Water Use Metrics - Baseline.....	3-11
Table 3-5. Buildout Unit Water Demand Factors.....	3-12
Table 4-1. Summary of Surface Water Supplies, ac-ft/yr	4-4
Table 4-2. Zone 40 Water Supply Portfolio, ac-ft/yr ^(a)	4-9
Table 7-1. 2010 and Buildout Area by Land Use - Baseline.....	7-1
Table 7-2. Buildout Dwelling Units, Population, and Connections by Land Use Category - Baseline	7-4

Table 7-3. 2010 and Buildout Dwelling Units, Population, and Connections by Service Area - Baseline	7-4
Table 7-4. Projected Connections in 5-Year Increments - Baseline	7-5
Table 7-5. Buildout Water Demand by Land Use Category - Baseline	7-6
Table 7-6. Projected Water Demand in 5-Year Increments, ac-ft/yr - Baseline	7-6
Table 7-7. Maximum Day Demand to Supply Comparison for Zone 40 - Baseline, mgd.....	7-9
Table 7-8. Supply and Demand Comparison-Normal Year - Baseline, ac-ft/yr.....	7-10
Table 7-9. Supply and Demand Comparison-Single Dry Year - Baseline, ac-ft/yr	7-10
Table 7-10. Supply and Demand Comparison-Multiple Dry Years - Baseline, ac-ft/yr.....	7-11
Table 7-11. Zone 40 Storage Capacity Evaluation Summary - Baseline	7-12
Table 7-12. Zone 40 Pump Station Capacity Evaluation Summary - Baseline.....	7-12
Table 7-13. Additional Supply Facilities - Baseline	7-20
Table 7-14. Additional Storage Facilities - Baseline.....	7-20
Table 7-15. Phase 1 Pipelines - Baseline	7-21
Table 7-16. Phase 2 and 3 Pipelines - Baseline.....	7-22
Table 7-17. Phase 1 CIP Cost Estimate - Baseline.....	7-23
Table 7-18. Phases 2 and 3 Pipeline Cost Estimate - Baseline	7-24
Table 7-19. Phase 2 CIP - Baseline	7-25
Table 7-20. Phase 3 CIP - Baseline	7-25
Table 7-21. Zone 40 CIP Cost Summary - Baseline	7-26
Table 8-1. Source of Land Use Information for NewBridge Development.....	8-1
Table 8-2. Land Use Area and Buildout Demographics for the NewBridge Area	8-2
Table 8-3. 2010 and Buildout Area By Land Use – NewBridge	8-4
Table 8-4. Buildout Dwelling Units, Population, and Connections by Land Use Category- NewBridge.....	8-7
Table 8-5. 2010 and Buildout Dwelling Units, Population, and Connections by Service Area – NewBridge .	8-7
Table 8-6. Projected Connections in 5-Year Increments – NewBridge	8-8
Table 8-7. NewBridge Area Buildout Water Demands	8-9
Table 8-8. Buildout Water Demand by Land Use Category – NewBridge	8-10
Table 8-9. Projected Water Demand in 5-Year Increments – NewBridge, ac-ft/yr	8-10
Table 8-10. Maximum Day Demand to Supply Comparison for Zone 40 - NewBridge, mgd.....	8-13
Table 8-11. Supply and Demand Comparison-Normal Year - NewBridge, ac-ft/yr.....	8-14
Table 8-12. Supply and Demand Comparison-Single Dry Year - NewBridge, ac-ft/yr	8-14
Table 8-13. Supply and Demand Comparison-Multiple Dry Years – NewBridge, ac-ft/yr.....	8-15
Table 8-14. Zone 40 Storage Capacity Evaluation Summary.....	8-16

Table 8-15. Zone 40 Pump Station Capacity Evaluation Summary	8-16
Table 8-16. Additional Supply Facilities – NewBridge.....	8-22
Table 8-17. Additional Storage Facilities – NewBridge.....	8-22
Table 8-18. Phase 1 Pipelines - NewBridge.....	8-23
Table 8-19. Phase 2 and 3 Pipelines – NewBridge.....	8-24
Table 8-20. Phase 1 CIP Cost Estimate - NewBridge	8-25
Table 8-21. Phases 2 and 3 Pipeline Cost Estimate – NewBridge	8-26
Table 8-22. Phase 2 CIP – NewBridge	8-27
Table 8-23. Phase 3 CIP – NewBridge	8-27
Table 8-24. Zone 40 CIP Cost Summary – NewBridge	8-28
Table 9-1. Sources of Land Use Information for the New Growth Areas	9-1
Table 9-2. Land Use Area and Buildout Demographics for the NewBridge Area	9-2
Table 9-3. Land Use Area and Buildout Demographics for the Jackson Township Area	9-4
Table 9-4. Land Use Area and Buildout Demographics for the West Jackson Area.....	9-5
Table 9-5. 2010 and Buildout Area By Land Use - Cumulative	9-6
Table 9-6. Buildout Dwelling Units, Population, and Connections by Land Use Category - Cumulative	9-8
Table 9-7. 2010 and Buildout Dwelling Units, Population, and Connections by Service Area - Cumulative..	9-9
Table 9-8. Projected Connections in 5-Year Increments - Cumulative.....	9-10
Table 9-10. Jackson Township Area Buildout Water Demands.....	9-12
Table 9-11. West Jackson Area Buildout Water Demands	9-12
Table 9-12. Buildout Water Demand by Land Use Category - Cumulative	9-13
Table 9-13. Projected Water Demand in 5-Year Increments - Cumulative, ac-ft/yr.....	9-14
Table 9-14. Maximum Day Demand to Supply Comparison for Zone 40 - Cumulative, mgd	9-16
Table 9-15. Supply and Demand Comparison-Normal Year - Cumulative, ac-ft/yr	9-19
Table 9-16. Supply and Demand Comparison-Single Dry Year - Cumulative, ac-ft/yr	9-19
Table 9-17. Supply and Demand Comparison-Multiple Dry Years- Cumulative, ac-ft/yr	9-20
Table 9-18. Zone 40 Storage Capacity Evaluation Summary - Cumulative	9-22
Table 9-19. Zone 40 Pump Station Capacity Evaluation Summary - Cumulative	9-22
Table 9-20. Additional Supply Facilities - Cumulative	9-27
Table 9-21. Additional Storage Facilities - Cumulative	9-28
Table 9-22. Phase 1 Pipelines - Cumulative	9-28
Table 9-23. Phase 2 and 3 Pipelines - Cumulative	9-29
Table 9-24. Phase 1 CIP Cost Estimate - Cumulative	9-30

Table 9-25. Phases 2 and 3 Pipeline Cost Estimate - Cumulative.....	9-32
Table 9-26. Phase 2 CIP - Cumulative.....	9-32
Table 9-27. Phase 3 CIP - Cumulative.....	9-33
Table 9-28. Zone 40 CIP Cost Summary - Cumulative.....	9-34

List of Abbreviations

AACE	Association for the Advancement Cost Engineering International	OHWD	Omochumne-Hartnell Water District
ac-ft/yr	acre-feet per year	PL	Public Law
Agency Act	Sacramento County Water Agency Act	POU	Place of Use
ASR	aquifer storage and recovery	PSA	purveyor specific agreement
bgs	below ground surface	Reclamation	U.S. Bureau of Reclamation
BMO	basin management objectives	SACOG	Sacramento Area Council of Governments
Cal Am	California American Water Company	SB	Senate Bill
CIP	capital improvement plan	SCGA	Sacramento Central Groundwater Authority
City	City of Sacramento	SCWA	Sacramento County Water Agency
CSA	Central Service Area	SFR	Single family residential
CMID	Construction Management and Inspection Division	SRCS	Sacramento Regional County Sanitation District
CSCGMP	Central Sacramento County Groundwater Management Plan	SSA	South Service Area
CVP	Central Valley Project	SMUD	Sacramento Municipal Utility District
DPR	direct potable reuse	SWRCB	State Water Resources Control Board
DU	dwelling units	SWTP	Surface Water Treatment Plant
EBMUD	East Bay Municipal Utility District	TDS	total dissolved solids
FRWA	Freeport Regional Water Authority	UWDF	unit water demand factors
FY	fiscal year	UWMP	urban water management plan
GET	groundwater extraction and treatment	WFA	Water Forum Agreement
GPCD	gallons per capita per day	WRPP	Water Recycling Pilot Program
gpd	gallons per day	WSIP	Water System Infrastructure Plan
gpm	gallons per minute	WSMP	Water Supply Master Plan
GIS	geographic information system	WTP	Water Treatment Plant
GSWC	Golden State Water Company		
GWTP	groundwater treatment plant		
HGL	hydraulic grade line		
in	inch		
IPR	indirect potable reuse		
JPA	joint powers authority		
lf	linear feet		
MDD	maximum day demand		
MFR	Multi-family residential		
MG	million gallons		
mgd	million gallons per day		
M&I	municipal and industrial		
NSA	North Service Area		

Section 1

Introduction

This amendment to the Zone 40 Water Supply Master Plan (WSMP) for the proposed NewBridge project has been prepared by Sacramento County Water Agency (SCWA). This section describes SCWA and Zone 40, the purpose of this Amendment, linkage to the 2005 WSMP (SCWA, 2005), the Zone 40 service area, and the report organization.

1.1 SCWA and Zone 40

SCWA was formed in 1952 by a special legislative act of the State of California called the Sacramento County Water Agency Act (Agency Act). SCWA is governed by a Board of Directors. Under the Agency Act, the Board may contract with the federal government and the State of California with respect to the purchase, sale, and acquisition of water. SCWA may also construct and operate any required capital facilities.

Zone 40 was created by SCWA Resolution No. 663 in May 1985, which described the boundaries of the zone and the types of projects to be undertaken. Zone 40 is a benefit zone created for the acquisition, construction, maintenance, and operation of facilities for the production, conservation, transmittal, distribution, and sale of ground or surface water or both for the present and future beneficial use of lands or inhabitants within the zone. Ordinance No. 18, adopted in 1986, empowered SCWA to establish fees, charges, credits, and regulations for the supply of water and required the development of a water supply master plan. The boundaries and scope of Zone 40's activities were expanded in April 1999 by Resolution WA-2331 to include the use of recycled water in conjunction with surface and groundwater.

SCWA provides retail water supply within Zone 40 to portions of unincorporated Sacramento County, the City of Rancho Cordova, and the City of Elk Grove. SCWA also provides wholesale water supply to a portion of the service area of Elk Grove Water District. Elk Grove Water District operates a retail water system serving customers within a portion of the City of Elk Grove and is a department of the Florin Resource Conservation District. SCWA will also provide wholesale water supply in the future to California American Water Company's (Cal Am) service area in Rio del Oro.

1.2 Purpose

The purpose of this WSMP Amendment is to address the sufficiency of water supply for the proposed NewBridge project and to update information contained within the WSMP (February 2005) due to changes in water demands, the growth rate, and water supplies. Significant changes such as water supply variations, County General Plan Amendments, annexations, incorporations, or new major programs are treated through formal updates or amendments to the WSMP.

The 2005 WSMP was developed to provide a flexible program of water management alternatives that could be implemented as the availability and feasibility of water supply sources change. It presented recommendations to meet future water demands in Zone 40 through the year 2030 (identified as the 2030 Study Area) with a regional conjunctive use program balancing the use of groundwater, surface water, and recycled water supplies. The Freeport Regional Water Project alternative was selected as the preferred alternative.

Subsequently, SCWA developed the 2006 Zone 40 Water System Infrastructure Plan (WSIP) (SCWA, April 2006), the 2006 Central Sacramento County Groundwater Management Plan, the 2010 Urban Water Management Plan (UWMP) (Brown and Caldwell, 2011), and the 2011 Water Supply Master Plan

Amendment for the Cordova Hills Project (SCWA, December 2011). The 2011 Cordova Hills Amendment addressed the proposed development by that name. Since the completion of these documents, the NewBridge project has been proposed. Significant changes in water use characteristics, land use planning, and water supply availability have also occurred.

The completion of this WSMP amendment is a necessary component for the approval of the proposed NewBridge project. The proposed project is located on the north side of Highway 16, east of Watt Avenue and west of Sunrise Boulevard. Because the proposed project is located outside of the 2005 WSMP study area, SCWA is required to develop and approve an amendment to the WSMP.

This WSMP amendment presents an evaluation of the water demands, water supplies, water system facilities, and costs for three scenarios, as follows:

Baseline. This scenario consists of Zone 40 with the land uses as currently approved.

NewBridge. This scenario consists of the Baseline scenario plus the proposed NewBridge project.

Cumulative. This scenario consists of the NewBridge scenario plus two other possible projects known as Jackson Township and West Jackson.

1.3 Linkage to 2005 Zone 40 Water Supply Master Plan

This WSMP Amendment contains updates and additions to substantial portions of the 2005 WSMP and the 2011 Cordova Hills Amendment. The items that have been updated include buildout land use acreages, unit water demand factors, recent historical demographics and water demands, projected water demands, growth rate projection, projected water supply availability, groundwater supply description, needed future facilities, and the capital improvement plan (CIP). New items that are presented in this Amendment that were not included in the 2005 WSMP and the 2011 Cordova Hills include existing water facilities descriptions; buildout population, connections, and dwelling units by service area; water demand factors expressed as demand per dwelling unit and per type of customer; projected maximum day and annual use of surface water and groundwater for dry and wet/average years; evaluation of storage and pump station capacity; and cost estimates for each proposed facility.

1.4 Service Area Description

The Zone 40 boundary and service areas as well as the NewBridge area are shown on Figure 1-1. The study area for this analysis is the Zone 40 area including the NewBridge area, Elk Grove wholesale area, and the future Cal Am area in Rio del Oro, except for the following areas.

- Portion of Elk Grove Water District that is not served by SCWA wholesale water supply.
- Omochumne-Hartnell Water District (OHWD).
- Areas within Zone 40 for which land use categories have not been assigned.
- Cal-Am service area in the CSA.

The study area is further described and illustrated in Section 3.

The Zone 40 has three service areas as follows:

- North Service Area (NSA)
- Central Service Area (CSA)
- South Service Area (SSA)

1.4.1 North Service Area

The NSA is located south of the American River and includes part of the City of Rancho Cordova. The NSA is currently supplied exclusively by groundwater. A surface water supply will be provided to the NSA in the near future that will initiate the conjunctive use program in that area. The NSA is the least developed of the three service areas, with currently less than 10 percent of the projected build out population. This service area includes the old Mather and Sunrise Corridor systems, as well as the newer Sunridge system. SCWA assumed ownership of the Mather System shortly after the County of Sacramento took over the old Mather Air Force Base after it was shut down by the US Air Force in the mid-1990s. In the case of the Sunrise Corridor System, SCWA was asked to take ownership and provide water service after the system was constructed through an assessment district in the late 1980's. The majority of the land within the NSA boundary is rural and undeveloped. The NewBridge growth area is located in the NSA.

1.4.2 Central Service Area

The CSA is located to the south of the NSA and is supplied by surface water from the Vineyard Surface Water Treatment Plant (SWTP) and groundwater. The CSA is partially developed with approximately 27 percent of the projected build out population. SCWA provides wholesale water to Elk Grove Water District within the CSA. This service area includes the old Grantline-99 system, as well as the newer Vineyard, Vineyard Springs, and North Vineyard Station areas. The CSA is predominately residential with a small amount of commercial and institutional customers and a large rural component to the east.

1.4.3 South Service Area

The SSA is located south of the CSA and to the west of Highway 99. The SSA is the most developed of the three service areas, with currently 60 percent of the projected build out population. The SSA is supplied by a mix of surface water, groundwater, and recycled water. This service area currently supplies the Laguna, East Franklin, and Laguna Ridge areas. The SSA is predominantly residential with some commercial and institutional customers as well.

1.5 Report Organization

The WSMP contains the following nine sections plus appendices, as follows:

Section 2 presents a description of the existing water system and its facilities.

Section 3 presents the methodology used to develop future water demands, the connection growth projection, and the water demand factors.

Section 4 describes the water supplies.

Section 5 describes the approach to quantify the amount of needed supply and storage capacity.

Section 6 describes the approach used to identify the needed water system facilities, the resulting CIP, and the cost estimates.


Section 7 develops the water demands, required water facilities, and their costs for the Baseline scenario. Sections 8 and 9 develop the same information for the NewBridge and Cumulative scenarios.

Appendix A contains back up information for the development of the demand factors.

Appendices B, C, and D contain the supply capacity, use of supply, comparison to demand, and storage evaluations for the Baseline, NewBridge, and Cumulative scenarios.

Appendix E has the cost estimate tables for each CIP project.

P:\Shared Folders\Wsp\landev\Zone 40\Water System Infrastructure Plan\WSP Update 2012\Shape files\Figure 1 files\Figure 1-1.pdf

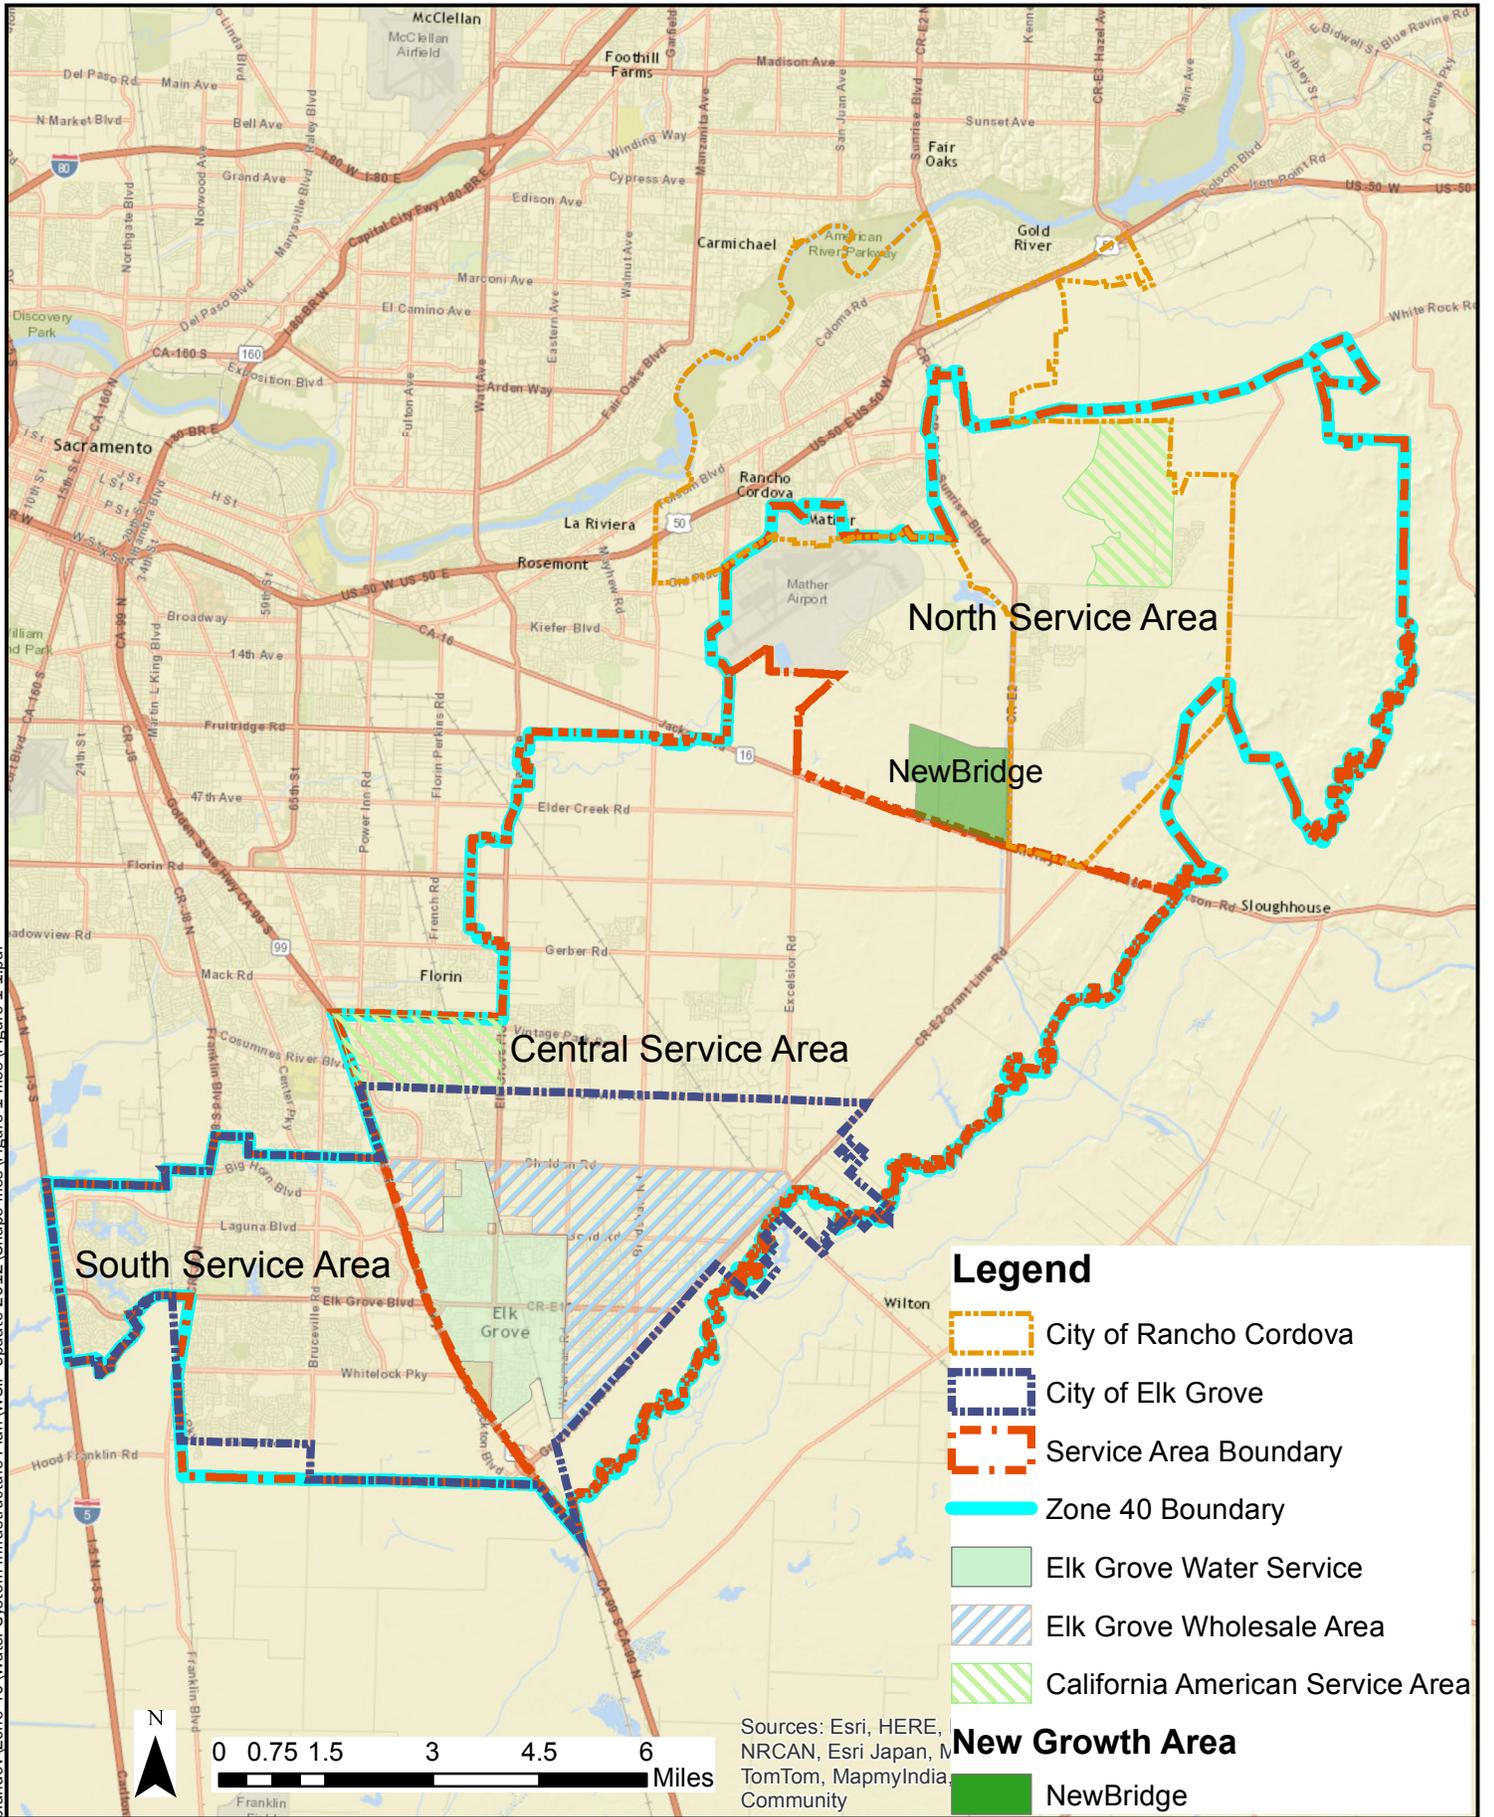

Legend

- City of Rancho Cordova
- City of Elk Grove
- Service Area Boundary
- Zone 40 Boundary
- Elk Grove Water Service
- Elk Grove Wholesale Area
- California American Service Area

New Growth Area

- NewBridge

Sources: Esri, HERE, NRCAN, Esri Japan, MapTom, MapmyIndia, Community

DATE	PROJECT	SITE
8/4/15	148130	

Zone 40 Water Supply Master Plan Amendment

Zone 40 Service Area

Figure 1-1

Section 2

Existing Water System Description

This section describes SCWA's existing Zone 40 water system. It contains a description of the water supply facilities including surface water facilities, groundwater wells, storage tanks, pressure zones, and the piping system. Recycled water facilities are also described.

2.1 Surface Water Facilities

SCWA surface water supplies for Zone 40 are diverted from the Sacramento River at Freeport and through the City of Sacramento's (City) Sacramento River SWTP.

Surface water diverted from the Sacramento River at the Freeport diversion structure is conveyed through the Freeport Regional Water Authority (FRWA) pipeline, treated at the Vineyard SWTP, and then delivered to the Zone 40 service area. FRWA was created as a joint powers authority (JPA) between SCWA and East Bay Municipal Utility District (EBMUD) in 2002, to increase surface water supply to the southern part of Sacramento County to reduce the county's dependence on groundwater through the implementation of a conjunctive use program and to provide a dry year surface water supply for EBMUD.

In 2011, FRWA completed the Sacramento River diversion at Freeport and a conveyance pipeline. The 84-inch (in) diameter pipeline starts at the Freeport intake, crosses Interstate 5 and Highway 99 to the east, and then parallels Gerber Road to a bifurcation at Vineyard Road. A SCWA owned 60-in diameter pipeline then conveys water north from this point to the Vineyard SWTP, which is located in the CSA. An EBMUD owned 66-in diameter pipeline continues further east to the Folsom South Canal.

The current capacity of the Vineyard SWTP is 50 million gallons per day (mgd) with an ultimate capacity of 100 mgd. Treatment facilities include coagulation, flocculation, sedimentation, filtration, and chlorine disinfection. The plant is also provided with solids-handling facilities. Other facilities include a clear well / chlorine contact tank, an electrical building, and treated water pump station.

The Vineyard SWTP currently provides treated surface water primarily to customers in the CSA with a smaller amount of supply to customers in the SSA. Three pipelines cross Highway 99 and hydraulically connect the CSA and the SSA at Sheldon Road, Bond Road, and Grant Line Road. The Sheldon Road pipeline was constructed in 2010.

Surface water is also provided to the SSA through the Franklin Intertie. The City diverts and treats a portion of SCWA's surface water at their Sacramento River SWTP, and then wheels that water through their distribution system to the Franklin intertie to Zone 40. The Franklin Intertie has a capacity of 11.1 mgd. Water from the intertie flows into the SSA through two routes. A dedicated transmission main connects to SCWA's Dwight Road facility where the supply is pumped into the SSA. Water from the intertie is also supplied to the SSA through an in-line booster pump that connects directly to the SSA distribution system.

Table 2-1 summarizes the surface water facilities' capacities.

Table 2-1. Zone 40 Surface Water Facilities			
Facility	Treated water capacity, mgd	Storage tank volume, MG	Pump station capacity, mgd
Vineyard SWTP	50/100 ultimate	20	75 mgd
Franklin Intertie ^(a)	11.1	--	1.6 ^a

^(a) This is the in-line booster pump near the intertie. Franklin Intertie supply is pumped to the SSA through both the Dwight Road GWTP booster pump station facility and the in-line booster pump.

2.2 Groundwater Facilities

Groundwater is supplied to Zone 40 from wells that that are connected to groundwater treatment plants (GWTPs) and from wells that pump directly into the distribution system (direct feed).

Each GWTP facility consists of wells that are manifolded into a treatment plant, a ground level storage tank, and a pump station. Most GWTPs are supplied by more than one well. The existing GWTPs use oxidation and filtration with a manganese zeolite (greensand) filter media for iron and manganese treatment. Treated water from the GWTPs flows into the ground level storage tanks and is subsequently pumped into the distribution system. The pump stations are typically sized larger than the GWTP capacities so that peak hour supply can be pumped to the distribution system from the storage tanks. In the case of the Dwight Road GWTP in the SSA, the pump station is sized larger than the GWTP to also pump the Franklin Intertie supply into the SSA. Storage tanks that are not located at a GWTP facility are described in Section 2.3.3.

The direct feed wells pump directly into the distribution system and do not require treatment. Direct feed wells are located in some areas of the CSA and SSA. SCWA also has some wells that were drilled and planned to be equipped in the future. Because these wells are not currently equipped to provide a groundwater supply to the system, they are not included in this section.


The wells used to feed the Anatolia GWTP are located in the CSA near the Vineyard SWTP, while the GWTP is located in the NSA and the treated water is supplied to the NSA. The wells that supply the GWTPs, storage tanks at the GWTPs, and pump stations in the NSA are listed in Table 2-2. There are no direct feed wells in the NSA. The locations of these facilities are shown on Figure 2-1.

Table 2-2. NSA Groundwater Facilities

Facility	GWTP capacity, mgd	Well capacity		Storage tank volume, MG	Pump station capacity, gpm
		Wells to GWTP, gpm	Direct feed wells, gpm		
Mather Housing GWTP					
W-096 McRoberts Well	--	750			
W-095 Pittsfield Well	--	1,600			
W-087 Plant Well	--	1,200			
W-092 Veterans Park Well	--	1,200			
Subtotal	6.0	4,750		0.5	3,600 (5.2 mgd) ^(a)
WT-08 Anatolia GWTP					
W-122 Excelsior Well #1		1,800			
W-123 Excelsior Well #2		1,800			
W-124 Excelsior Well #3		1,800			
Subtotal	6.5	5,400		4.0	7,800 (11.2 mgd)
Total	12.5	10,150	--	4.5	11,400 (16.4 mgd)

^(a) The pump station pumps a portion of the supply from the tank. The remaining supply is fed by gravity to Mather Housing.

The CSA is supplied water from the Vineyard SWTP and five groundwater treatment plants. There are also three direct feed wells that supply the CSA. The GWTPs, wells that supply the GWTPs, direct feed wells, storage tanks at the GWTPs, and pump stations in the CSA are listed in Table 2-3. The locations of these facilities are shown on Figure 2-2.

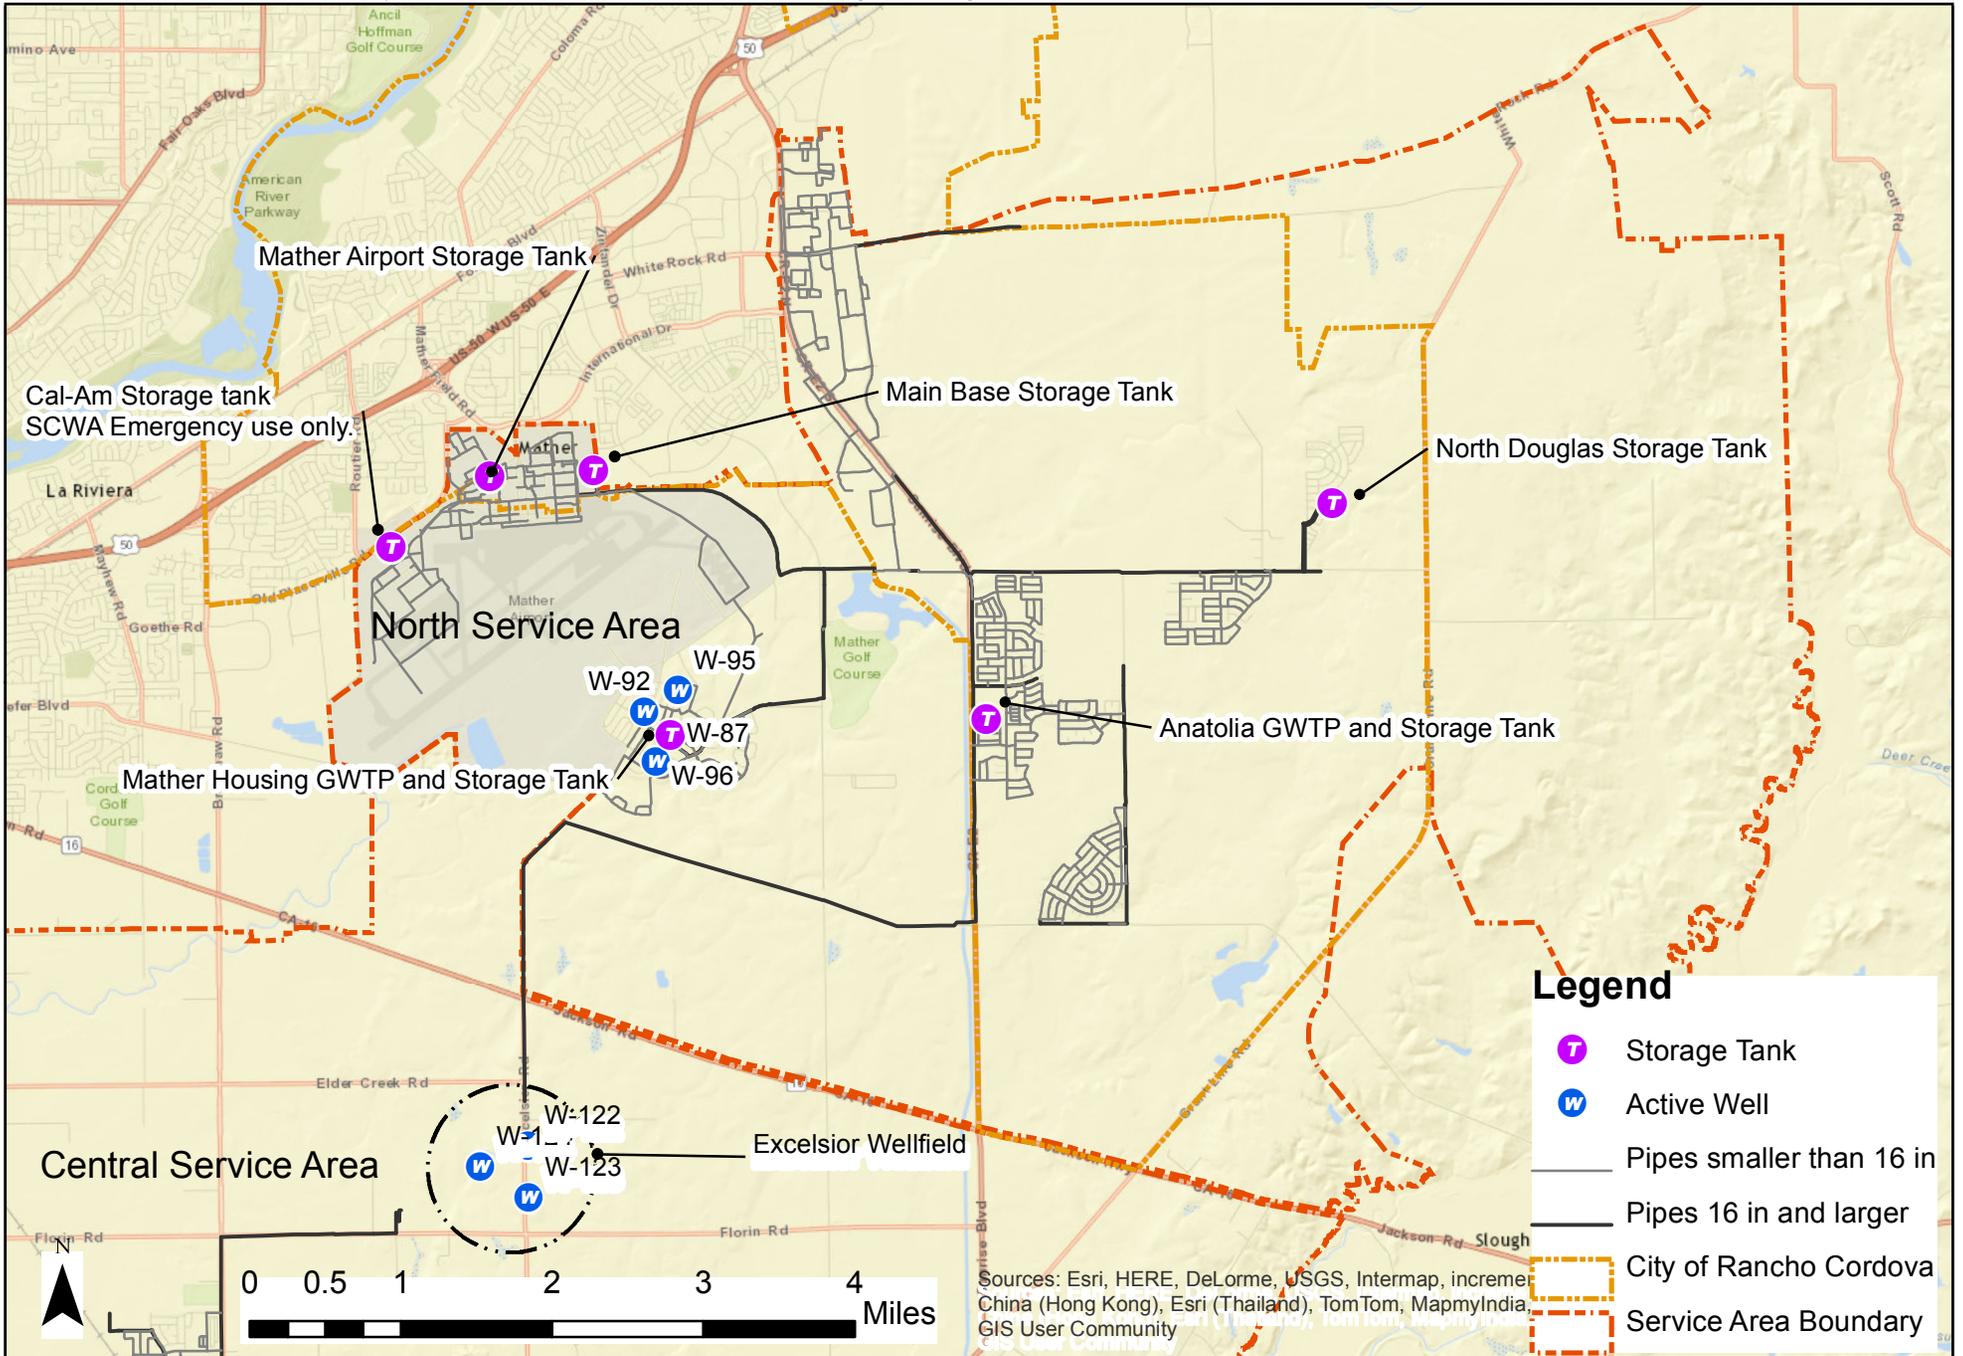

Zone 40 Water Supply Master Plan Amendment

Existing Supply Facilities - NSA


Figure 2-1



PROJECT
148130
DATE
11/7/14

SITE
TITLE


P:\Shared Folders\Wsplandev\Zone 40\Water System Infrastructure Plan\WSP Update 2012\Shape files\Figure 2 files\Figure 2.2_Vert.pdf

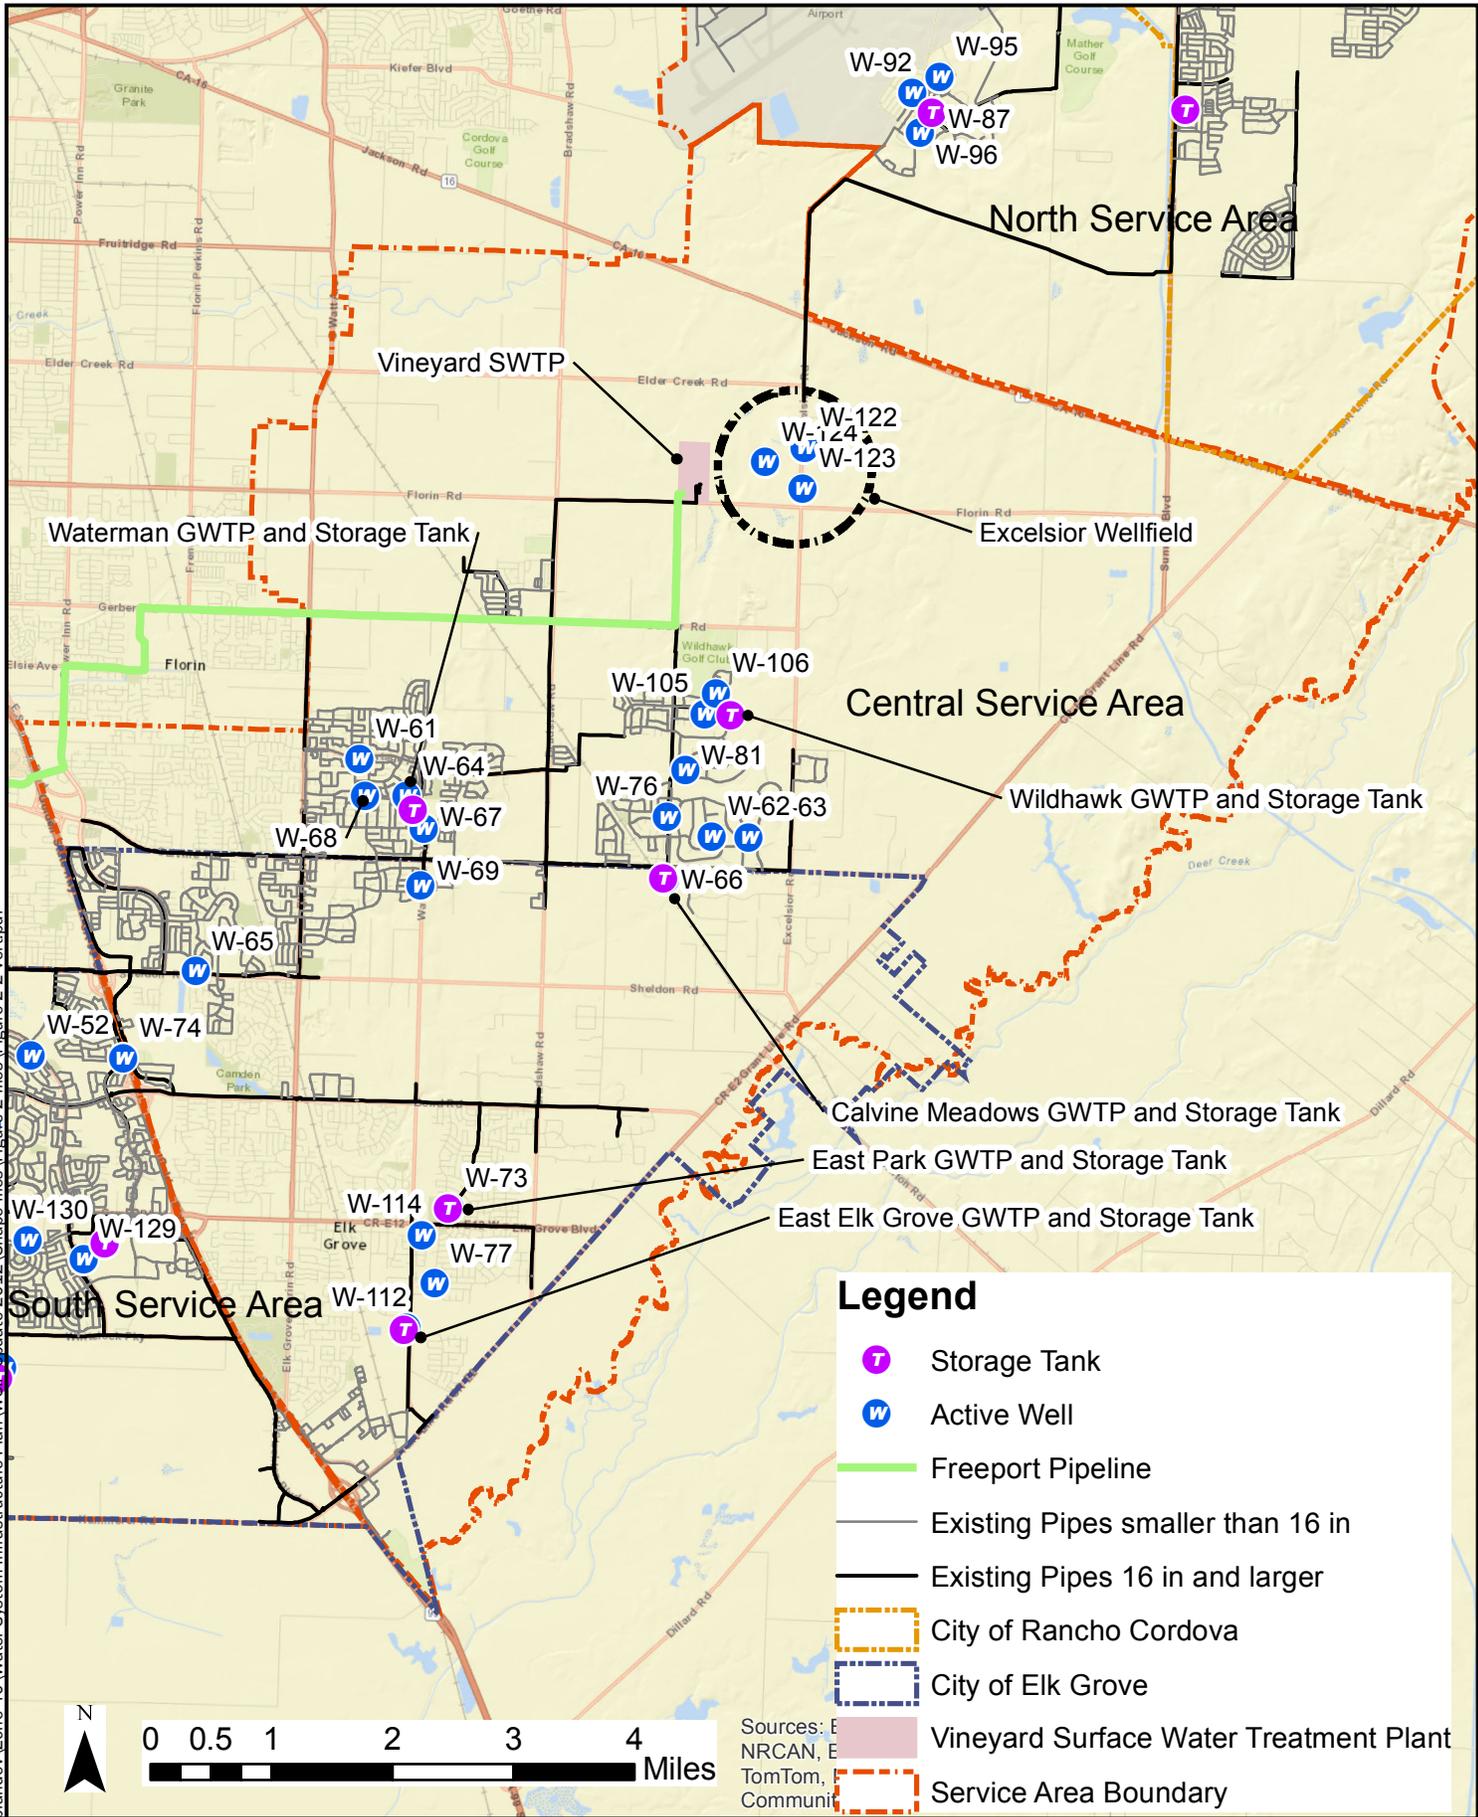

Legend

- T Storage Tank
- W Active Well
- Freeport Pipeline
- Existing Pipes smaller than 16 in
- Existing Pipes 16 in and larger
- City of Rancho Cordova
- City of Elk Grove
- Vineyard Surface Water Treatment Plant
- Service Area Boundary

Sources: E NRCAN, E TomTom, Commun



DATE	PROJECT	SITE
11/12/14	148130	
TITLE		

Zone 40 Water Supply Master Plan Amendment

Existing Supply Facilities - CSA

Figure 2-2

Table 2-3. CSA Groundwater Facilities


Facility	GWTP capacity, mgd	Well capacity		Storage tank volume, MG	Pump station capacity, gpm
		Wells to GWTP, gpm	Direct feed wells, gpm		
WF-01 Calvine Meadows GWTP					
W-066 Calvine Meadows Well		1,700			
W-076 Legends Well		1,750			
Subtotal	5.0	3,450		0.35	6,100 (8.8 mgd)
WT-05 East Elk Grove GWTP					
W-112 East Elk Grove On Site Well		1,500			
W-077 Waterman Ranch Well		1,500			
W-114 Windsor Downs Well		1,500			
Subtotal	6.5	4,500		3.5	9,000 (13.0 mgd)
WF-03 East Park GWTP					
W-073 East Park Well		1,915			
Subtotal	2.9	1,915		0.5	2,400 (3.5 mgd)
WT-02 Waterman GWTP					
W-061 Caymus Well		1,600			
W-069 Perry Ranch Well		1,500			
W-068 Tillotson Well		1,500			
W-067 Waterman Road Well		1,500			
W-064 Westray Well		1,500			
Subtotal	8.6	7,600		7.0	18,000 (25.9 mgd)
WT-03 Wildhawk GWTP					
W-105 Azinger Well		1,800			
W-106 Rodriguez Well		1,800			
W-081 Saddle Creek Well		1,500			
Subtotal	7.5	5,100		3.0	13,200 (19.0 mgd)
Direct feed wells					
W-062 Andalusian Well			1,100		
W-063 Equine Well			1,000		
W-065 Sheldon North Well			608		
Total	30.5		2,700	14.4	48,700 (70.1 mgd)

The SSA is supplied water from four GWTPs and from the Franklin Intertie. There are also six direct feed wells that supply the SSA. The SSA also receives some supply from the CSA. The GWTPs, wells that supply the GWTPs, direct feed wells, storage tanks at the GWTPs, and pump stations in the SSA are listed in Table 2-4. The locations of these facilities are shown on Figure 2-3.

Table 2-4. SSA Groundwater Facilities

Facility	GWTP capacity, mgd	Well capacity		Storage tank volume, MG	Pump station capacity, gpm
		Wells to GWTP, gpm	Direct feed wells, gpm		
Big Horn GWTP					
W-130 Big Horn Blvd #5 Well Civic Center Dr		1,500			
W-129 Big Horn offsite Well #4 Big Horn Blvd.		1,500			
Subtotal	4.5	3,000		2.0	6,000 (8.6 mgd)
Dwight Road GWTP					
W-070 Dwight Road Raw Water Well		1,500			
Subtotal	2.1	1,500		7.0	18,000 (25.9 mgd)^(a)
Lakeside GWTP					
W-055 Lakeside Well		1,700			
W-056 Riparian Well		1,500			
W-075 West Taron Well		1,600			
Subtotal	6.5	4,800		0.5	5,000 (7.2 mgd)
Poppy Ridge GWTP					
W-110 Ferragamo Well		1,500			
W-078 Poppy Ridge On-Site Well		1,500			
W-109 Terrazo Well		1,500			
Subtotal	6.5	4,500		3.5	7,200 (10.4 mgd)
Direct feed wells					
W-042 Banyon Well			760		
W-052 Big Horn North Well			940		
W-043 Duck Slough Well			1,000		
W-047 Feather Creek Well			800		
W-041 Seasons Well			650		
W-74 Stockton (Park Meadows)			500		
Total	21.6	--	4,650	13.0	36,200 (52.1 mgd)

^(a) Dwight Road GWTP pump station capacity is sized to also pump the supply from the Franklin intertie into the SSA distribution system.

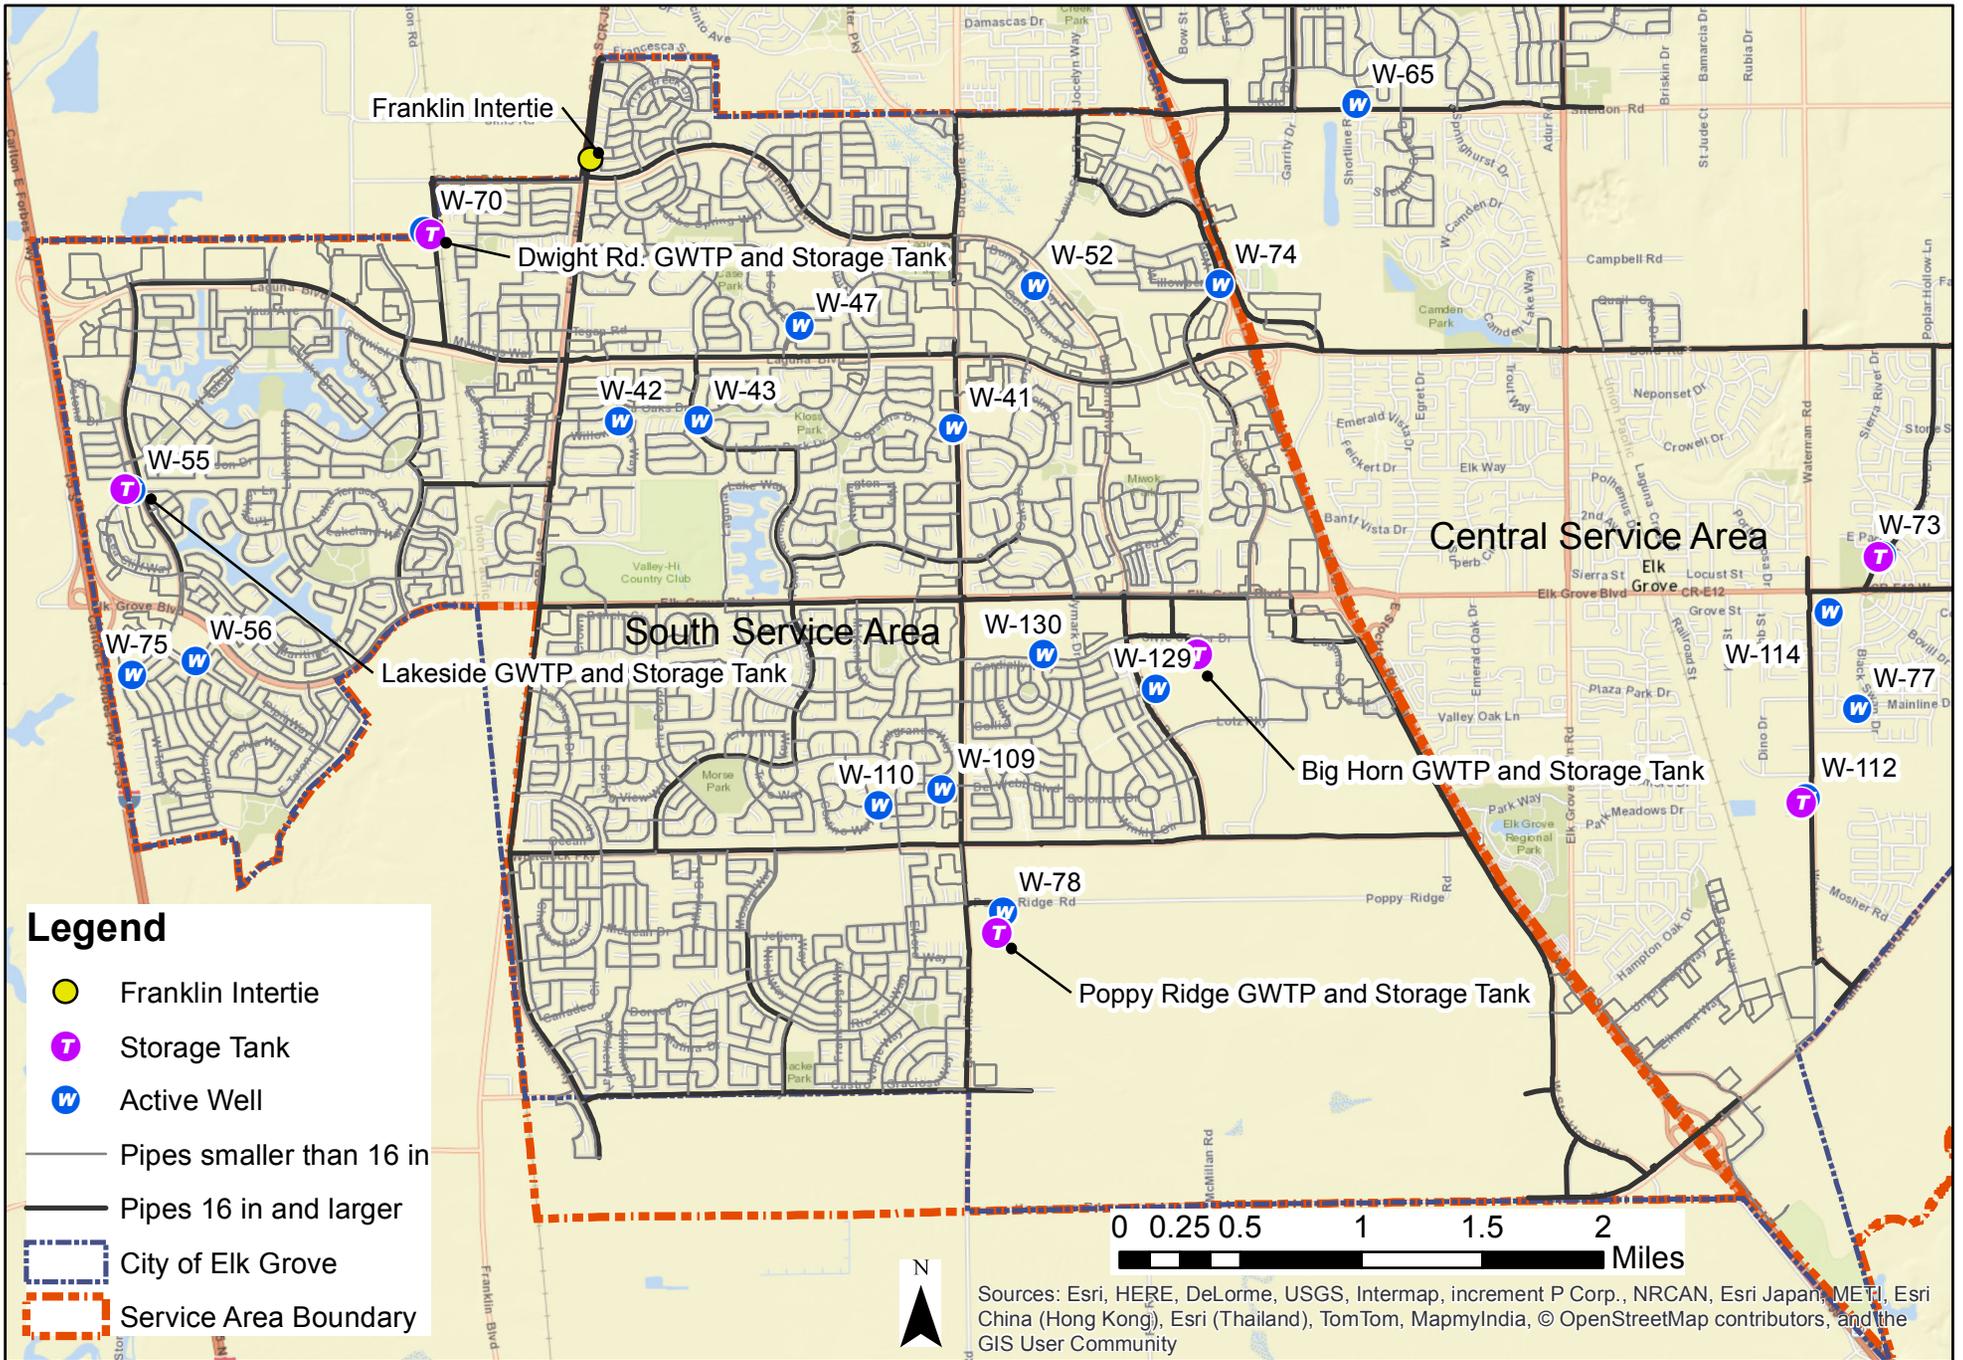

Legend

- Franklin Intertie
- T Storage Tank
- W Active Well
- Pipes smaller than 16 in
- Pipes 16 in and larger
- City of Elk Grove
- Service Area Boundary

Sources: Esri, HERE, DeLorme, USGS, Intermap, increment P Corp., NRCAN, Esri Japan, METI, Esri China (Hong Kong), Esri (Thailand), TomTom, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community



PROJECT 148130
DATE 7/30/15

SITE
TITLE

Zone 40 Water Supply Master Plan Amendment

Existing Supply Facilities - SSA

Figure 2-3

2.3 Water Distribution Facilities

Existing water distribution facilities within Zone 40 include storage tanks and pipelines. The system is also comprised of several pressure zones.

2.3.1 Pressure Zones

Zone 40 consists of two pressures zones, as described below. Figure 2-4 provides a hydraulic schematic of the Zone 40 system that illustrates the pressure zones and ground elevations of key water distribution and supply facilities. Table 2-5 summarizes the ground elevation and maximum day pressure range by pressure zone from SCWA’s hydraulic model.

- NSA Main Zone – The NSA Main Zone is the largest pressure zone within the NSA. The NSA Upper Zone will be added in the future.
- CSA/SSA Zone - The CSA and SSA form one pressure zone that is hydraulically connected by three pipelines that cross Highway 99.

Pressure zone	Ground elevation range, ft	Maximum day pressure, psi
NSA Main Zone	74 to 215	40 to 85
CSA/SSA Zone	10 to 96	50 to 75

2.3.2 Pipelines

Table 2-6 summarizes the existing transmission and distribution pipeline length by pipe diameter in each of the service areas. SCWA defines transmission pipe to be those 16 inches in diameter and greater. This includes SCWA pipelines within the Elk Grove wholesale area and raw water pipelines that connect the groundwater wells to the GWTPs.

Diameter, in	Pipe length, linear feet			
	NSA	CSA	SSA	Total
Distribution				
<8-in	54,200	200	10,600	65,000
8 to 10-in	264,300	421,700	1,080,200	1,766,200
12 to 14-in	128,800	175,700	344,100	648,500
Transmission				
16 to 24-in	52,300	167,600	231,800	451,600
30 to 36-in	47,100	34,300	16,200	97,500
> 36-in	11,800	24,800	1,300	37,800
Total	558,300	824,000	1,684,000	3,066,200

2.3.3 Storage Facilities

Zone 40 has fourteen active storage tanks. Eleven of the storage tanks are located at GWTPs and described in Section 2.2. The three storage tanks that are independent storage facilities that are not part of a GWTP facility are listed in Table 2-7. These tanks are used to meet the peak hour increment of demand that is greater than the maximum day demand as well as emergency and fire flow demands. Cal Am has a 3 mg storage tank in the NSA that is available to SCWA for emergency purposes.

Table 2-7. Stand-alone Storage Facilities

Name	Volume, MG	Pump station capacity, gpm	Pressure zone
Mather 1 storage (Main Base)	1.0	3,600 (5.2 mgd)	NSA Main Zone
Mather 2 storage (Mather Airport)	0.3	Elevated tank	NSA Main Zone
North Douglas	3.0	13,500 (19.4 mgd)	NSA Upper Zone
Total	4.3		

2.4 Recycled Water Facilities

Beginning in 2003, the Sacramento Regional County Sanitation District (SRCSD) started wholesaling recycled water to SCWA for the Phase I SRCSD/SCWA Water Recycling Pilot Program (WRPP). The Phase 1 recycled water service area consists of the Laguna West, Lakeside, and Laguna Stonelake communities that are located in the western third of the Laguna planning subarea in the SSA. In these areas SCWA retails the recycled water to large commercial irrigation customers, industrial customers, right-of-way landscaping, schools, and parks.

Some of the Phase 2 recycled water conveyance facilities have been constructed in the East Franklin Specific Plan planning subarea in the SSA. The portions of the system that are operational are using potable water as a supply source. Phase 2 is planned to also include the Laguna Ridge planning subarea.


SRCSD is responsible for the collection, treatment, and disposal of wastewater throughout most of the urbanized areas of Sacramento County. SRCSD operates a 5 mgd tertiary treatment facility at their regional wastewater treatment plant that includes a pump station. Recycled water is conveyed from the treatment facility via a single 24-inch transmission main than then drops to a 20-inch pipeline to the Phase 1 service area. The recycled water is then conveyed through a branched network of recycled water distribution pipelines ranging from 8-inch to 14-inch diameter in size.

Legend

Pressure Zone

Service Area

Volume in MG (million gallons)
Storage Tank

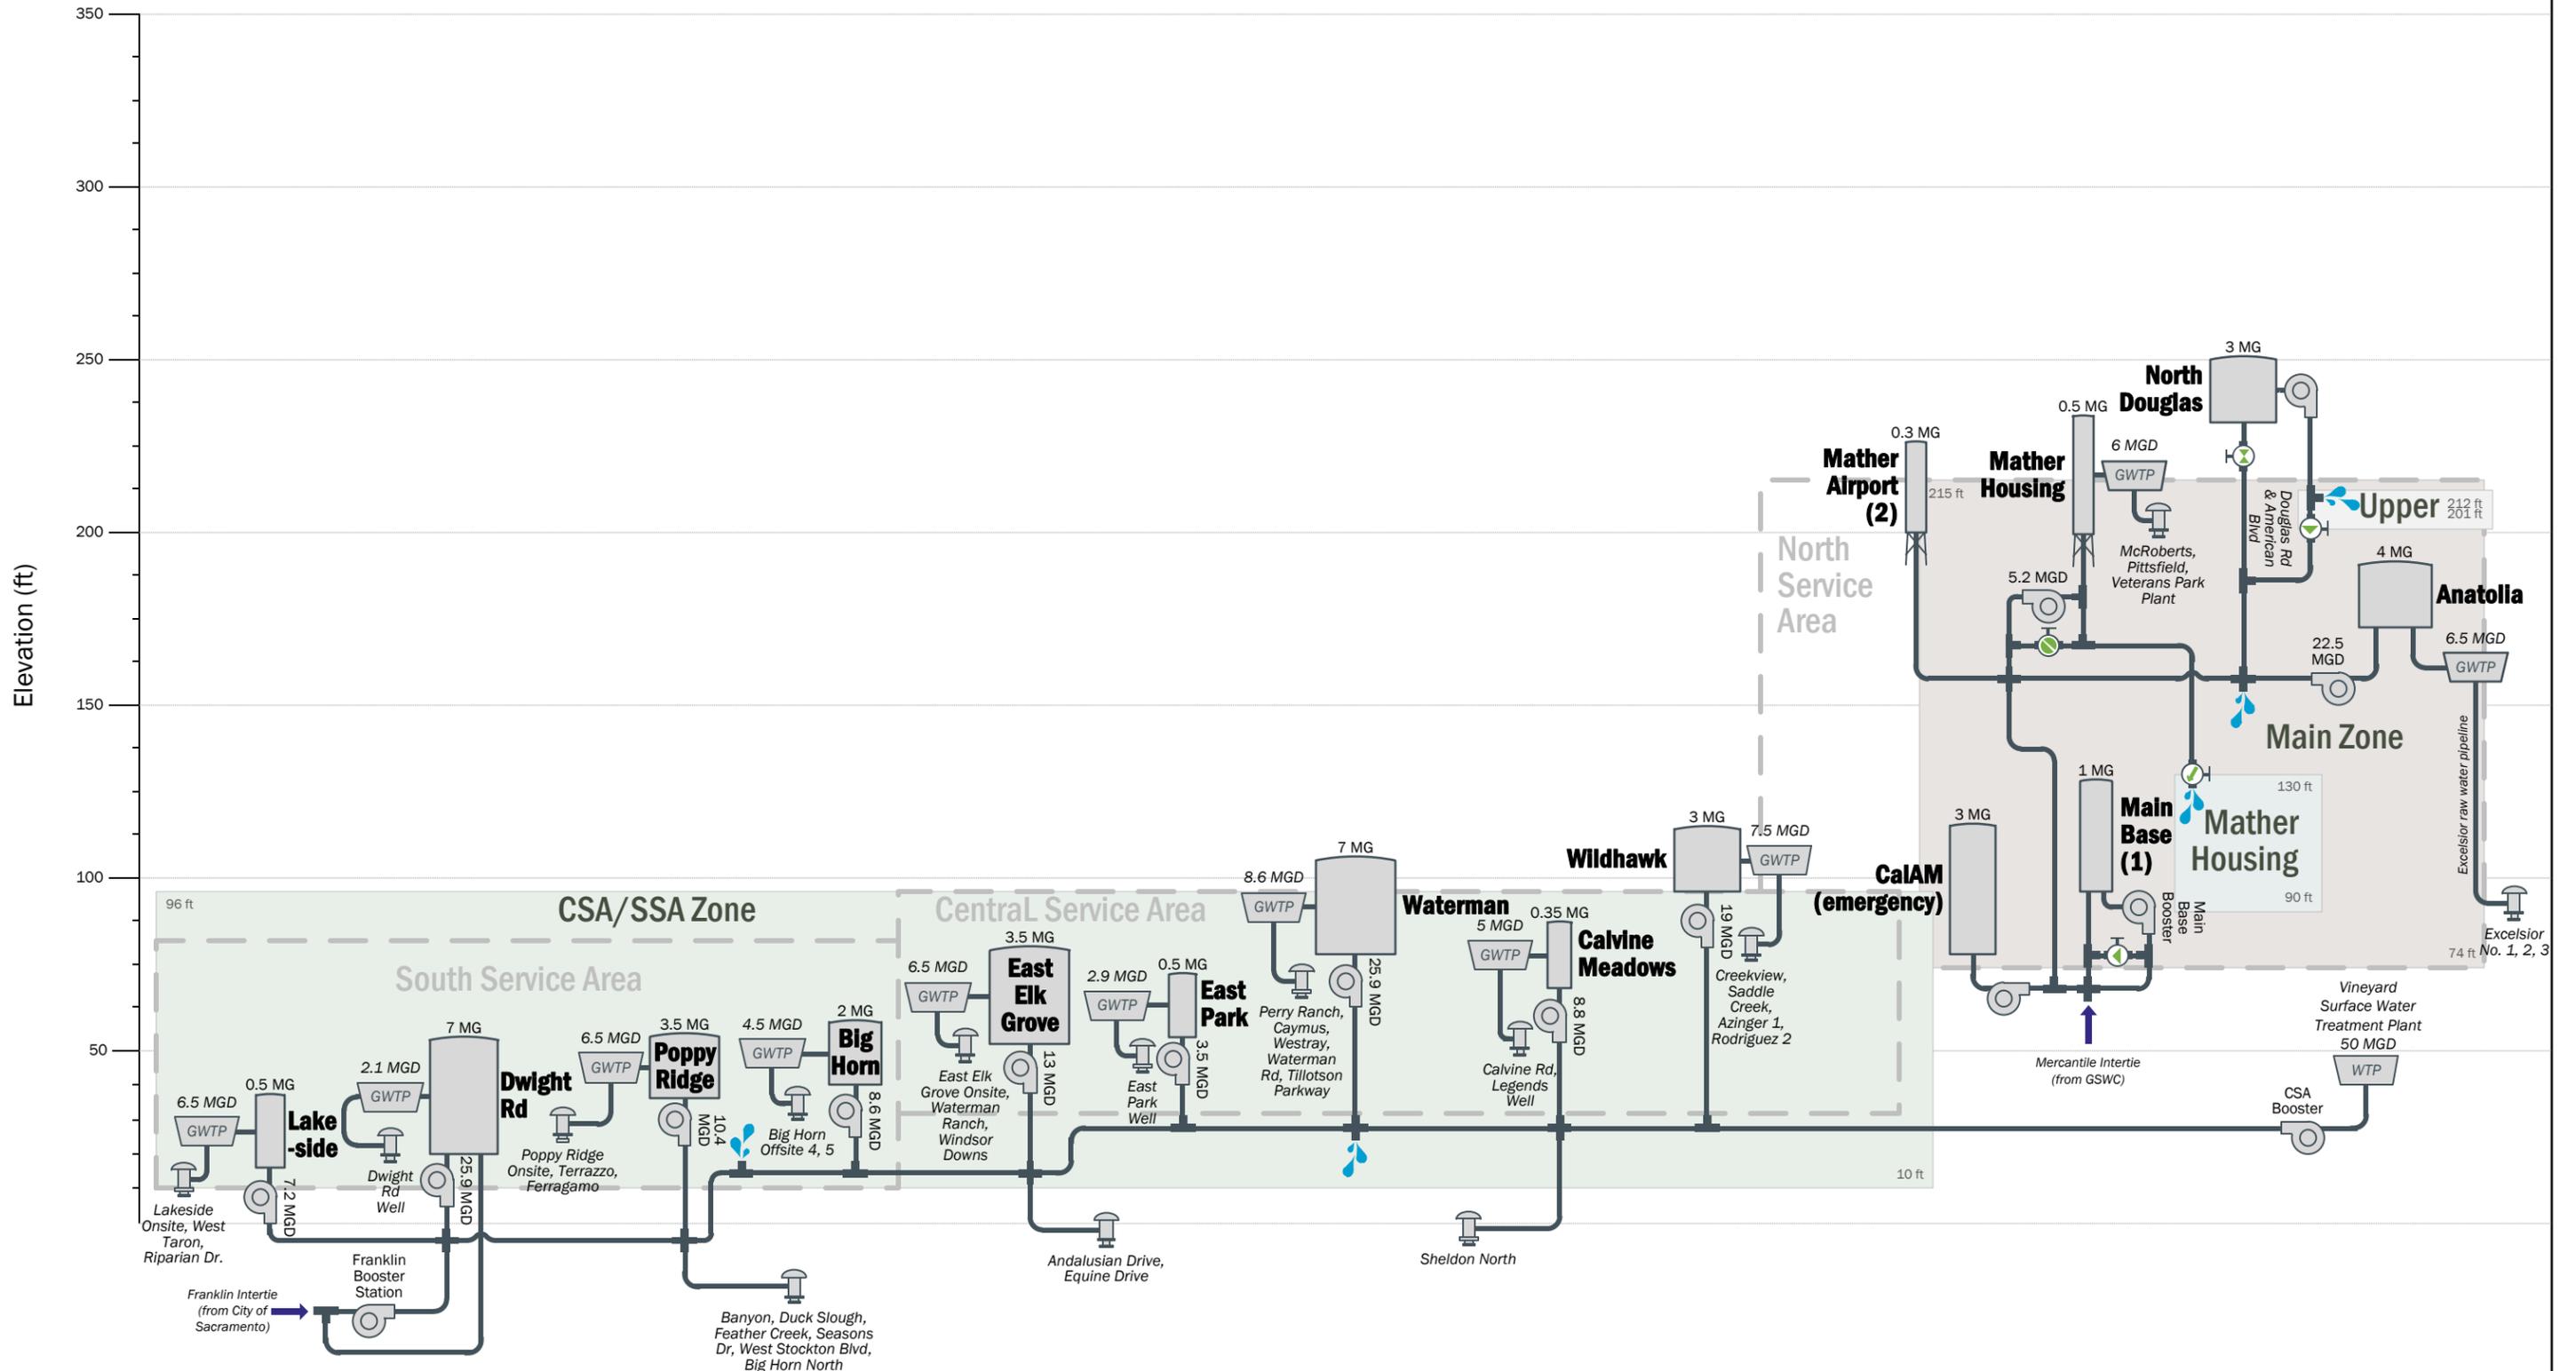


Section 3

Water Demands

This section presents the historical water use, the methodology used to develop future water demands, the connection growth projection, and the water demand factors. The projected water demands for the various scenarios are presented later in this document.

3.1 Historical Connections and Water Production

This section describes the historical number of connections, and the analysis to develop the projected demographics at buildout as well as the resulting projected growth rates of connections and population for Zone 40. Following the completion of SCWA's 2010 UWMP, the 2010 census data became available. An analysis of the 2010 population served by Zone 40 based on the 2010 census was performed (Brown and Caldwell, 2012). The historical number of connections by service area within Zone 40 is shown on Figure 3-1.

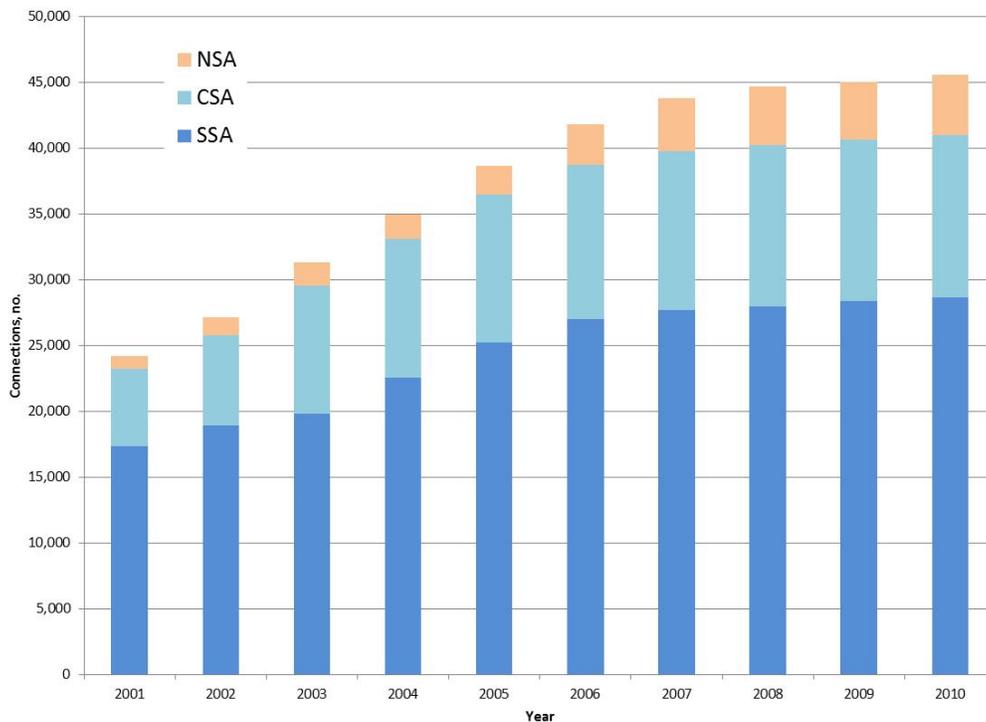

Note: Connections in Elk Grove wholesale area are not included on this figure because of unavailable historical information for all of the years depicted.

Figure 3-1. Historical Connections by Service Area

Historical potable and recycled water production in Zone 40 from 2001 to 2013 by service area is shown in Table 3-1 and illustrated on Figure 3-2. The production quantities presented in Table 3-1 for the CSA and SSA differ from the water demands in these two service areas since some of the water produced in the CSA

is utilized in the SSA. A portion of the SSA’s water demand has been supplied by water from the CSA that has increased with the start-up of the Vineyard SWTP in 2011. Water flows from the CSA to the SSA through three connections across Highway 99 as described in Section 2.1.

Table 3-1. Zone 40 Historical Water Production, ac-ft/yr

Area	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013
NSA	2,666	2,550	2,505	2,314	3,066	3,951	4,270	4,619	4,295	4,150	4,353	5,020	4,804
CSA	5,342	6,072	6,578	8,891	9,260	9,817	10,287	11,038	11,941	13,616	12,682	17,592	19,751
CSA (wholesale to Elk Grove) ^(a)	900	1,707	1,973	2,638	3,018	3,304	3,420	3,219	2,870	3,487	3,487	3,487	3,487
SSA ^(b)	13,386	14,071	13,558	15,346	17,980	17,104	18,453	18,875	16,610	12,411	12,974	9,185	7,338
SSA (recycled water)	-	-	609	786	695	596	837	915	866	794	829	870	922
Total	22,294	24,399	25,223	29,975	34,019	34,773	37,267	38,666	36,583	34,458	34,325	36,154	36,302

^(a) Historical production for Elk Grove wholesale from 2001 through 2010 provided by SCWA staff. Elk Grove wholesale production for 2011 through 2013 is estimated and assumed to equal 2010 production.

^(b) These values represent the water production in the SSA.

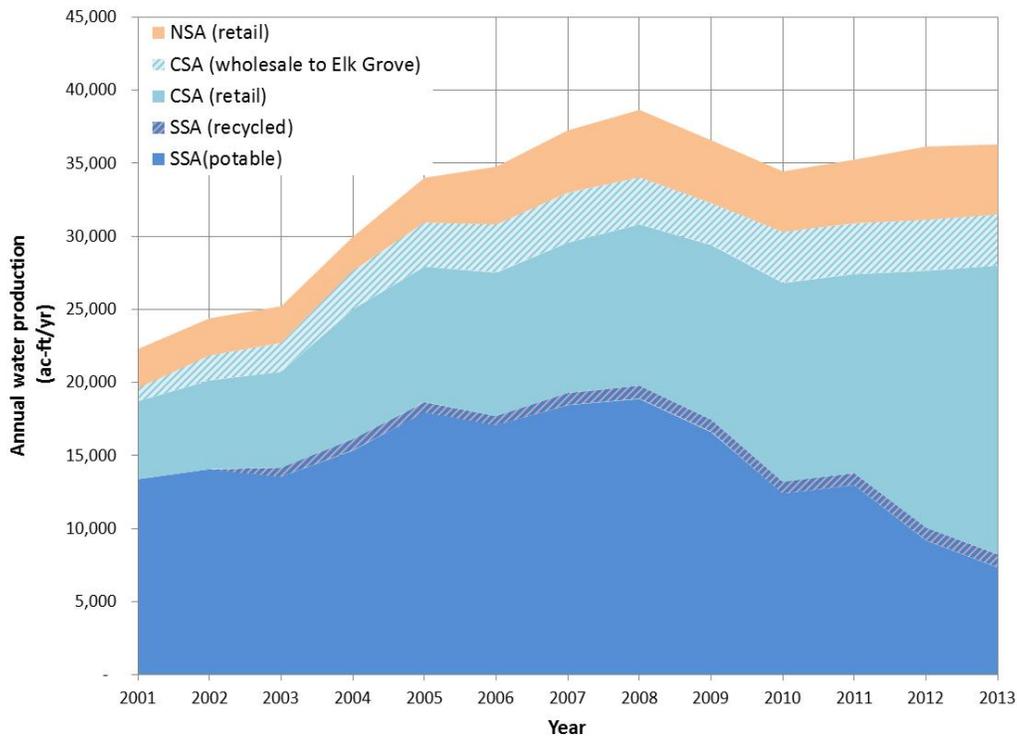


Figure 3-2. Historical Annual Water Production by Service Area

3.2 Water Demand Projection Methodology

Water demands are estimated based on the water demand estimate analysis progression shown on Figure 3-3. The approach has two components, which are the demographics and the water demands.

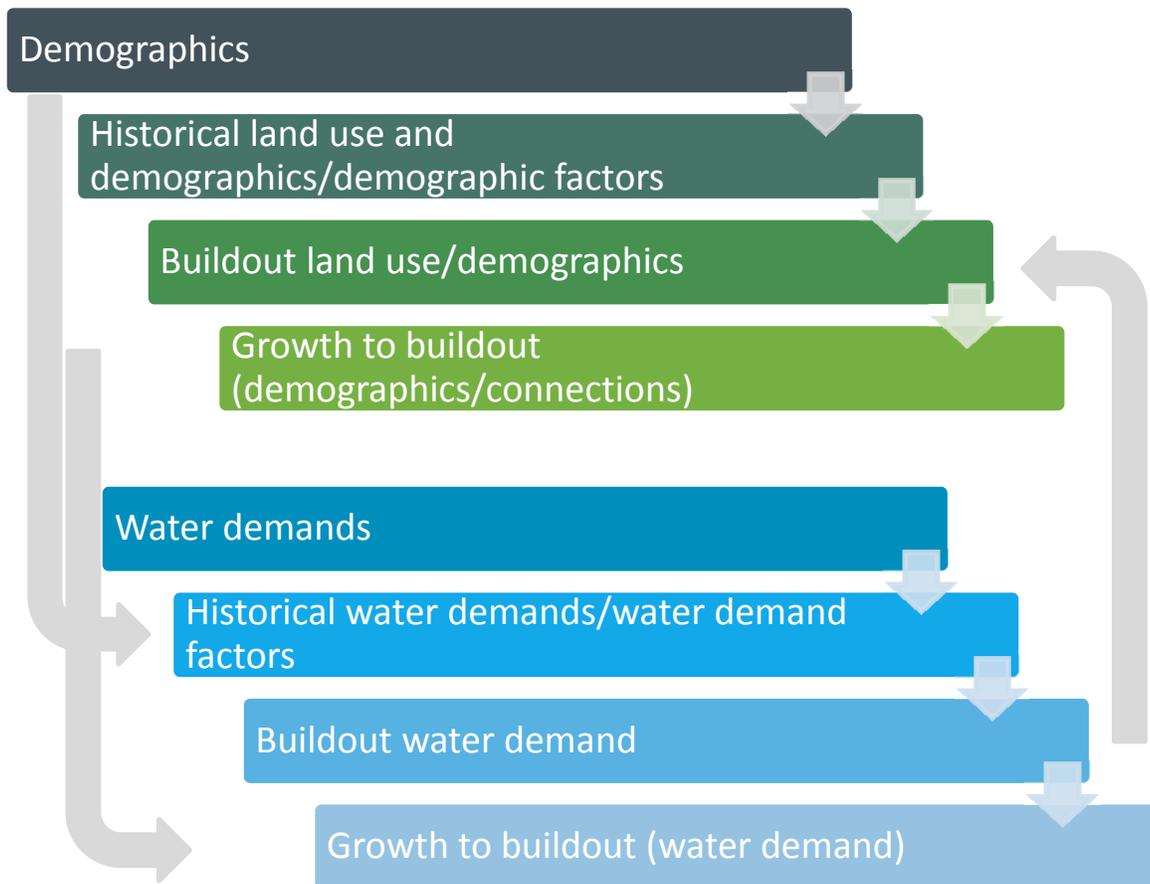


Figure 3-3. Water Demand Estimate Analysis Progression

The first part of the process is focused on land use and demographics. Demographics consist of population, connections, and dwelling units (DUs). The 2010 developed land use acreage by type of use is used to establish demographic factors such as connections and dwelling units per acre. The buildout developed land use acreage is then used to estimate buildout demographics. Buildout is considered to be reached when the available land is fully developed up to the maximum allowed for each land use category.

The number of dwelling units at buildout is estimated based on the maximum number of DUs allowed per acre in each of the general plan residential land use categories multiplied by the number of acres. The projected number of DUs at buildout is used to estimate the number of buildout residential connections and population. The buildout population for Zone 40 is estimated using a population per DU factor from the 2010 population and DU census data. Following the completion of SCWA's 2010 UWMP, the 2010 census data became available. An analysis of the 2010 population served by Zone 40 based on the 2010 census was performed (Brown and Caldwell, 2012). The number of residential connections at buildout is based on the maximum DUs /acre allowed for residential land uses and assumed DUs per connection factors.

For non-residential land uses, the number of connections at buildout is more speculative because of the uncertainty of the mix of types and land area sizes of industries, businesses, parks, and other public facilities. For public land uses the size of parks and public facilities will influence the number of connections in that category. The number of connections at buildout is estimated assuming that the number of connections per acre would be 20 percent higher than the 2010 value. The projected annual connection growth for each service area is estimated.

The second part of the process consists of developing water demand factors based on the historical water use compared to the amount of developed areas, population, and DUs. These historical demand factors are used to develop the demand factors projected for buildout. The buildout demand factors are then used together with the buildout land use and demographics to estimate the buildout water use. The increase in demand to buildout for each service area is based on the projected increase in connections for each service area.

The information presented in this report typically includes all of SCWA's retail service area, the Elk Grove wholesale area, and the future Cal Am wholesale area in Rio del Oro. In the instances where the information excludes the Elk Grove wholesale area, it is so noted.

3.3 Land Use

This section describes the planning subareas, land use, and residential density.


3.3.1 Planning Subareas

The study area is divided into planning subareas. The boundaries of the subareas correlate to current city boundaries, unincorporated areas, communities, and new growth areas defined by future development plans. The subareas are grouped into the three Zone 40 service areas: NSA, CSA, and SSA. The location of these subareas is illustrated on Figure 3-4.

3.3.2 Land Use

The area of land that was served by SCWA in 2010 is illustrated on Figure 3-5. The shaded areas on Figure 3-5 represent the area of land developed in 2010 and served retail water by SCWA. Figure 3-5 does not include the portion of Elk Grove Water District that is served by SCWA wholesale water supply. The 2010 developed acreage was estimated based on the location of SCWA's existing retail water distribution piping system.

Document Path: BCSAC\FPO\IP\43000\143542 - SCWA Water System Infrastructure Plan\Engineering\3_2_GIS\CAD\SCWA_SubAreas_8x11_20130716.mxd

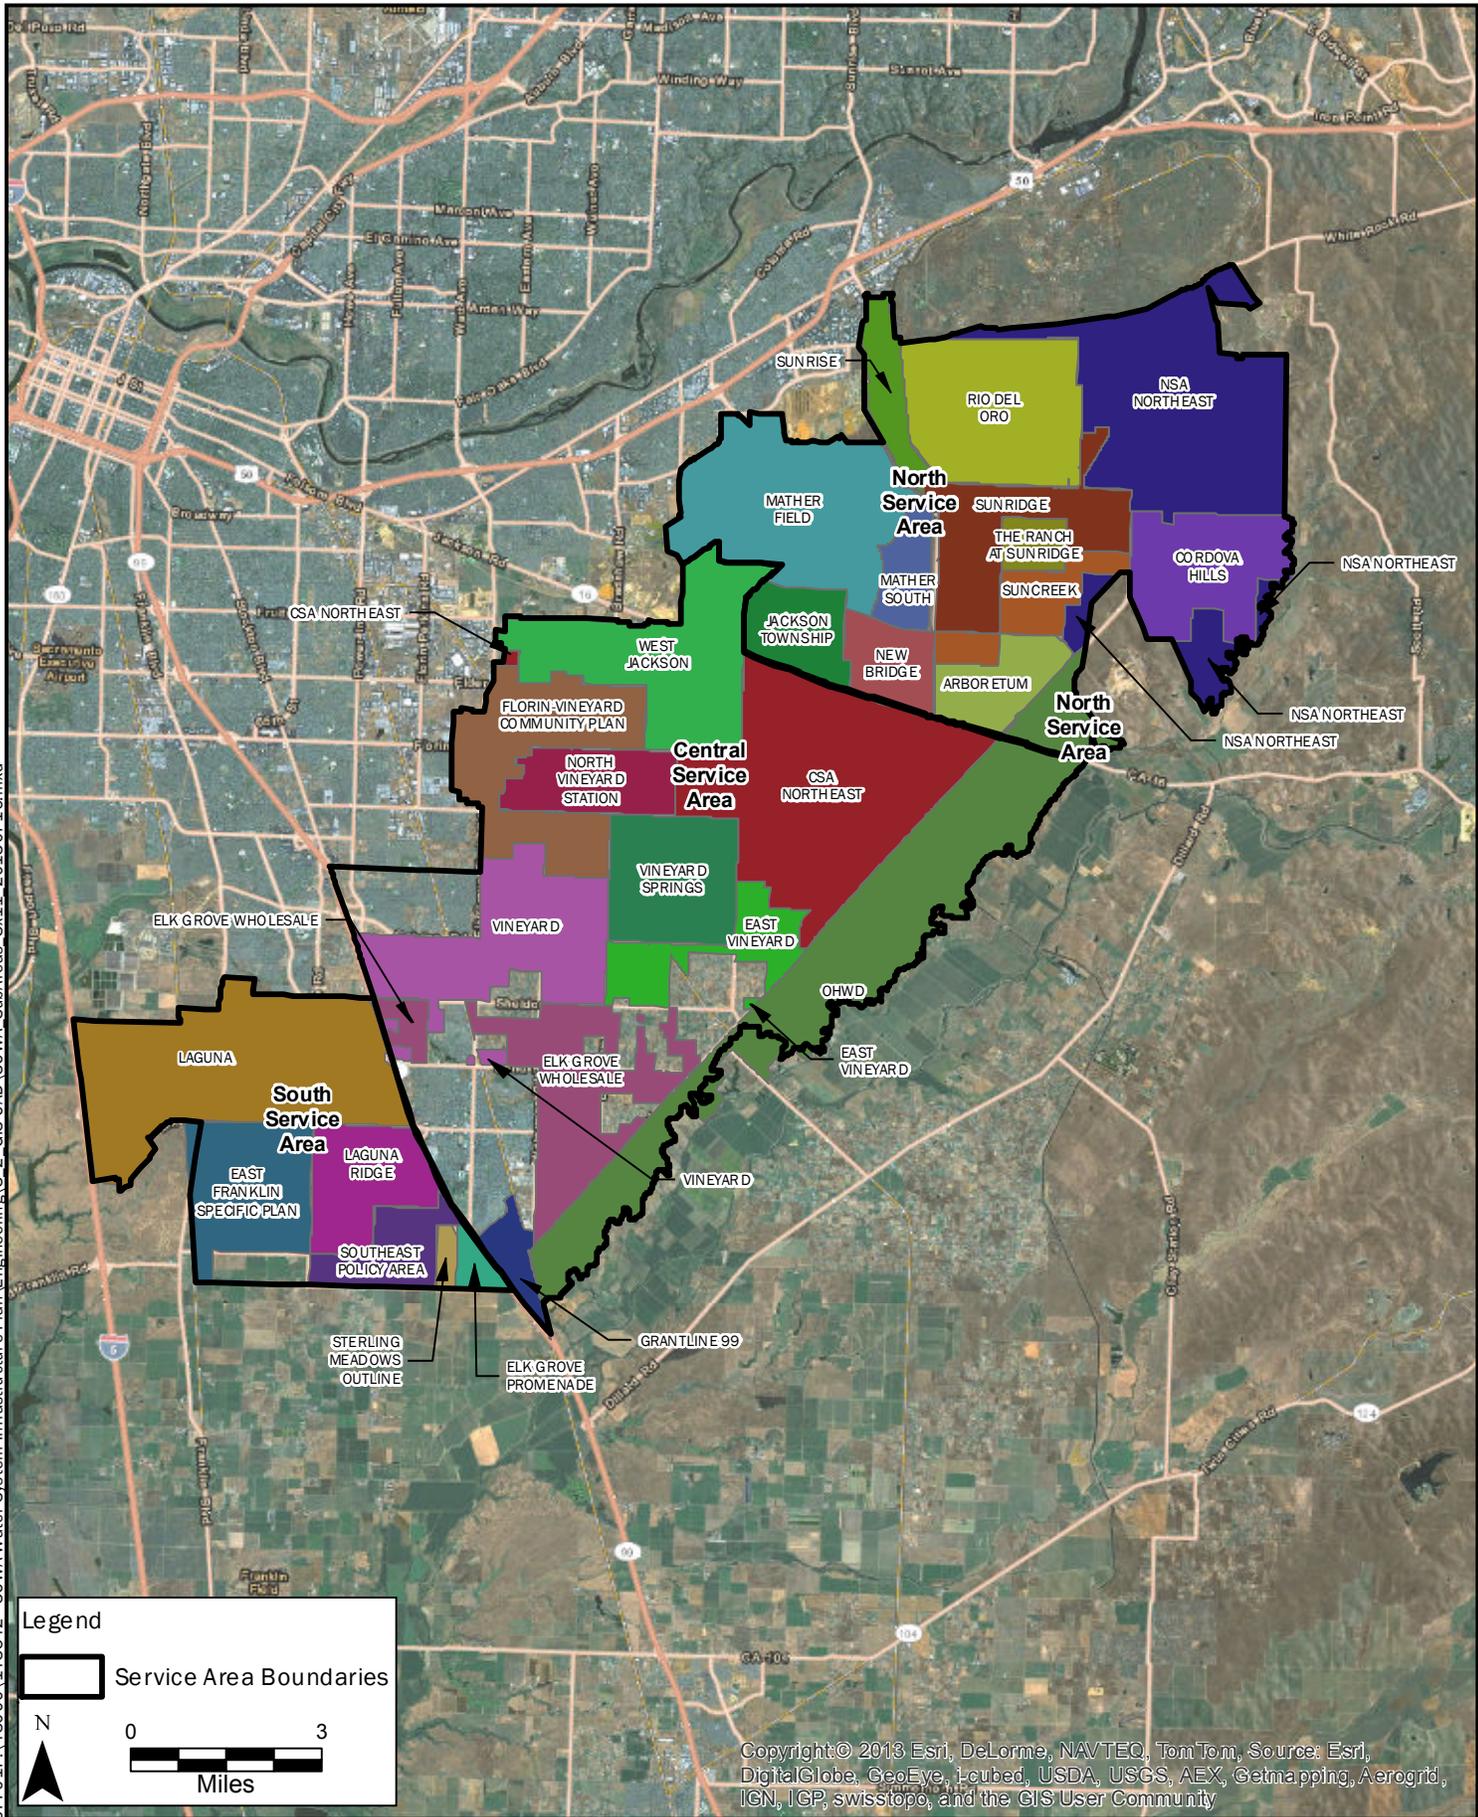


DATE	PROJECT	SITE
11/6/14	143542	

Zone 40 Water Supply Master Plan Amendment

Water Planning Subareas

Figure 3-4

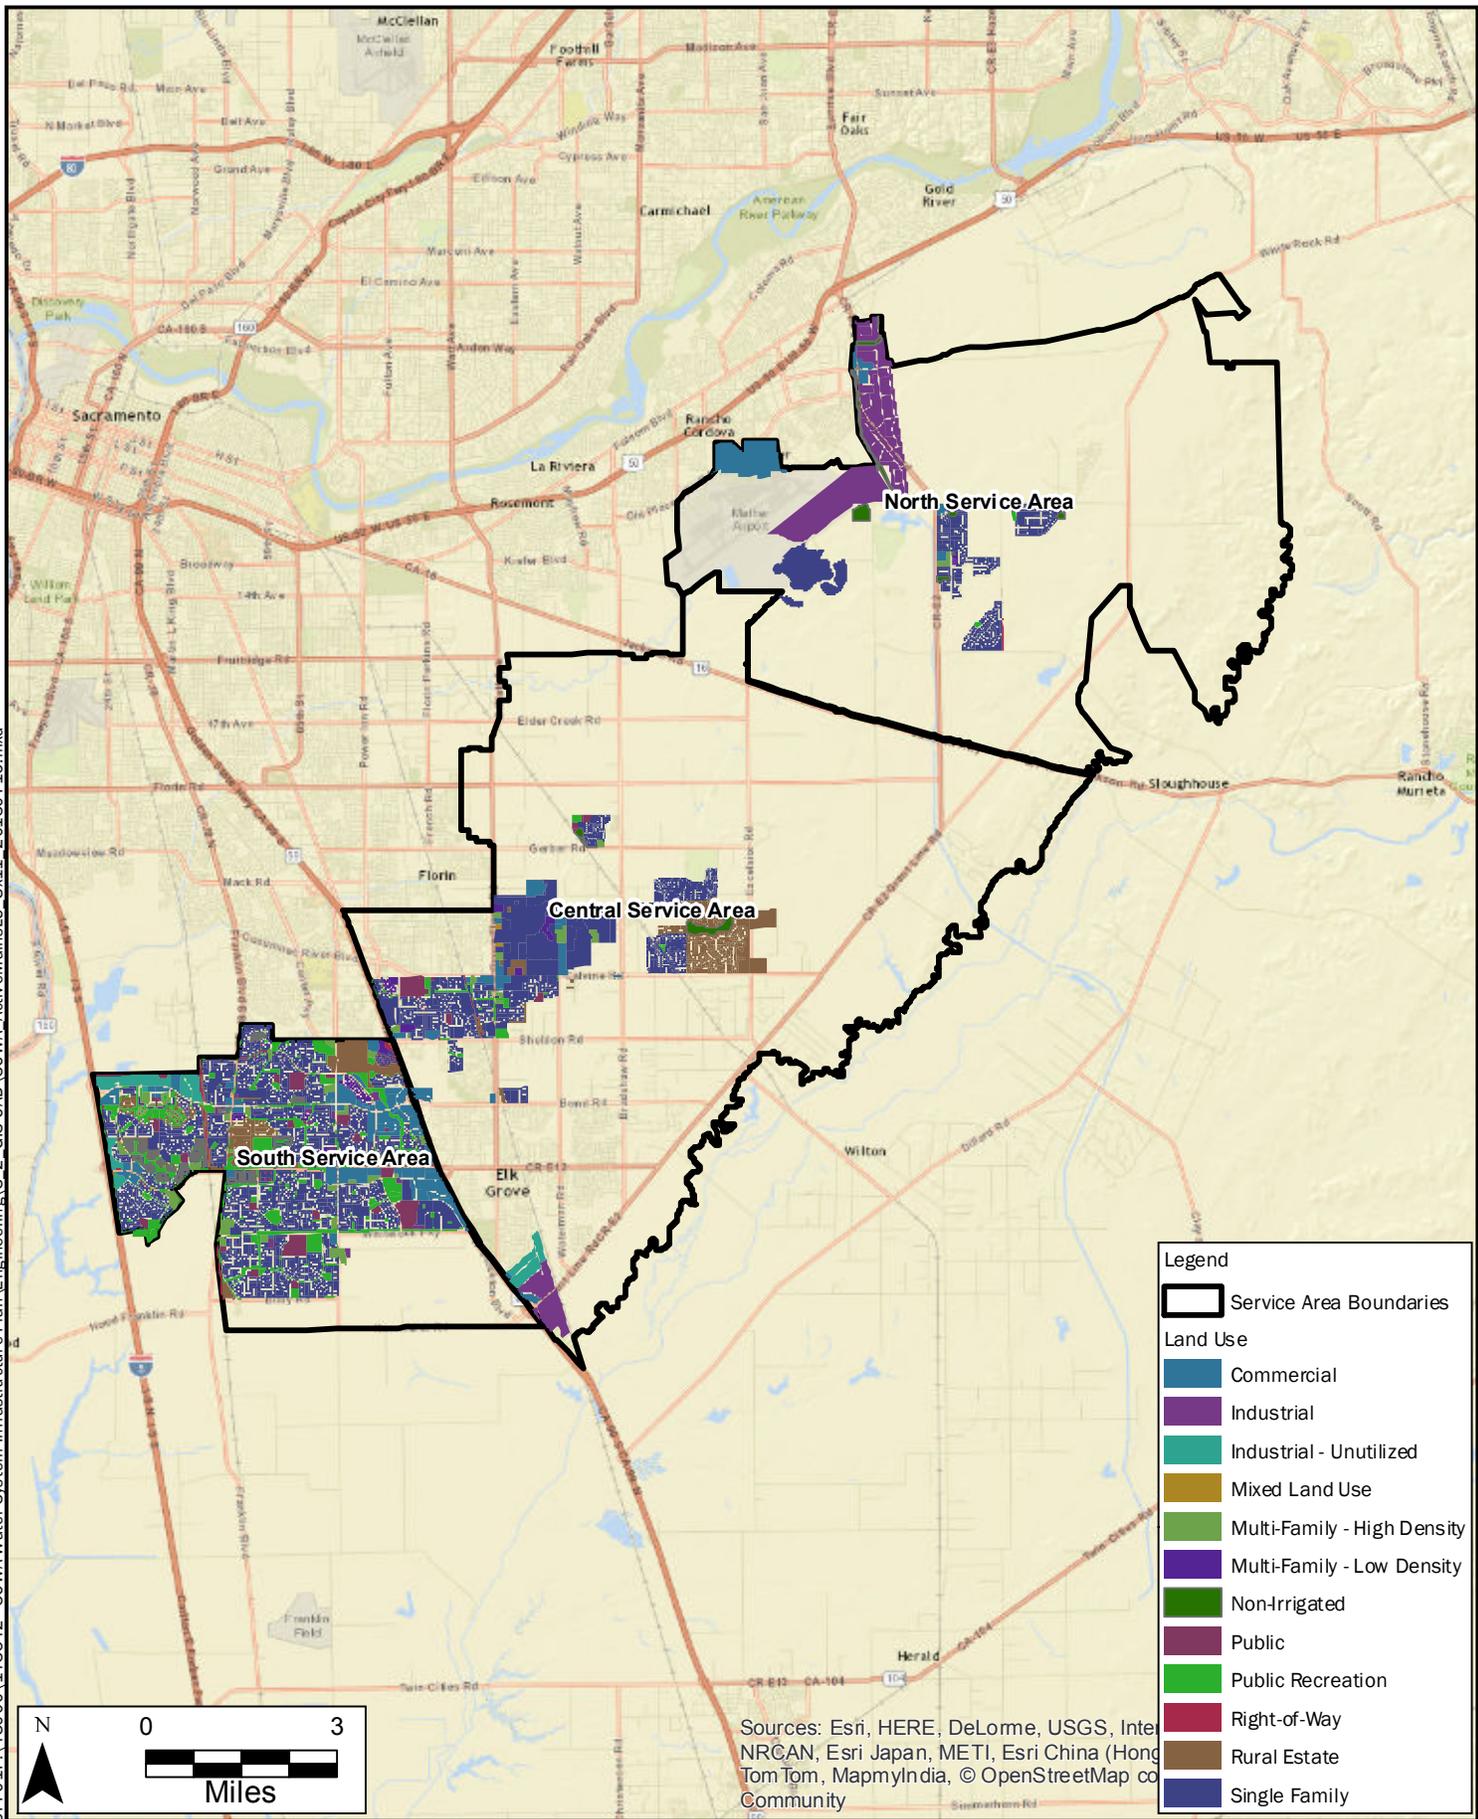

Legend

- Service Area Boundaries
- Land Use**
- Commercial
- Industrial
- Industrial - Unutilized
- Mixed Land Use
- Multi-Family - High Density
- Multi-Family - Low Density
- Non-Irrigated
- Public
- Public Recreation
- Right-of-Way
- Rural Estate
- Single Family

Sources: Esri, HERE, DeLorme, USGS, InterNRCAN, Esri Japan, METI, Esri China (Hong Tom Tom, MapmyIndia, © OpenStreetMap Community



DATE	PROJECT	SITE
11/6/14	143542	

Zone 40 Water Supply Master Plan Amendment

Developed Area Currently Served by SCWA

Figure 3-5

GIS maps of the land uses defined by the most recent land use planning information for Sacramento County, the City of Elk Grove, and the City of Rancho Cordova, as well as maps of the proposed developments in the new growth areas were used to quantify the area of each land use category within each planning subarea. The land use categories presented in the general plans have been collapsed into a reduced set for the purposes of this analysis. The 2010 land use acreages by land use category are summarized in Table 3-2.

Gross acres are defined as the total land area for each land use category including streets and right of way areas. Net acres exclude the area occupied by streets and right of ways. It is assumed that streets and right of ways cover 20 percent of the gross area within the residential, commercial, and industrial land use categories. All other land use categories are assumed to not have streets and right of ways, so their net and gross acreages are the same. The acreages presented in Table 3-2 are net acres.

The buildout gross acreage presented later in this report was estimated based on GIS data that included areas of both net and gross acreage. For those areas where the GIS data was provided as net acreage, the quantity of net acres was converted to gross acres.

Table 3-2. 2010 Area By Land Use	
Land use category	2010 developed area, net acres
Rural estate	1,380
Single family	6,970
Multi-family - low density	220
Multi-family - high density	390
Commercial	1,520
Industrial	1,110
Industrial-unutilized	340
Public	920
Public recreation	1,270
Mixed land use	20
Right-of-way	70
Subtotal, municipal water supply land area	14,210
Self-supported/supplied by others	-
Non-irrigated	500
Agricultural	-
Total	14,710

Note: Elk Grove wholesale area is not included in the 2010 developed area acreage because it was not available.

3.3.3 Residential Land Use Density

The general plan residential land use categories each have a DU density range in terms of the minimum and maximum allowed number of DUs per acre. The buildout DUs and resulting residential water connections developed in this analysis are based on the maximum density allowed within each land use category (i.e. 7 dwelling units/acre for the RD 5-7 land use category). Each of the four residential land use categories defined for this analysis represent several general plan residential land use categories. The average and maximum dwelling unit densities established for each of the four residential land use categories were developed using the weighted average by buildout acreage of the several land use types represented in each category. Actual land use density at buildout may vary from what is assumed in this document.

Another density variable is bonus density. In general, bonus density is an increased DU density above and beyond the maximum allowable residential density under the local zoning ordinance. Section 65915 of the Government Code requires that local government provide a developer with incentives or concessions for increasing the production of housing units and child care facilities when an applicant seeks a density bonus for a housing development or for the donation of land for housing within the county. In 2004, Senate Bill (SB) 1818 amended section 65915 of the Government Code, pertaining to the density bonus law. The purpose of SB 1818 is to encourage developers to build affordable housing by requiring local governments to provide meaningful incentives. The projected number of DUs has not been adjusted for the possibility of bonus density being provided.

3.4 Connection Growth Projection

The future growth rate of Zone 40 is expressed as the growth in the number of water system connections. The growth in water system connections is projected based on an evaluation of the range of historical growth trends that have occurred in each service area. Figure 3-1 depicts the number of historical connections for the 2001 to 20010 period. Because of the uncertainty in the future rate of growth, three growth rates were developed and expressed as low, medium, and high. The medium growth rate is used for the projections in this document. The low and high connection growth rates are approximately the same as the lowest (1,300 connections per year) and highest (3,600 connections per year) historical 5-year moving average growth rate for the 9 year period from 2001 to 2010. The medium growth rate begins at 1,000 new connections per year increasing to 1,500 new connections per year in 2020 and thereafter until buildout. The number of new connections estimated to occur each year for each service area is presented in Table 3-3. The connection growth rate from 2015 to 2024 was provided by SCWA staff. Any change in the growth of new connections to the water system will change the water demand projection.

Table 3-3. Projected Annual Connection Growth (new connections) ^(a)				
Year	NSA	CSA	SSA	Total
2015	300	300	400	1,000
2016	300	300	500	1,100
2017	300	300	500	1,100
2018	350	350	500	1,200
2019	400	400	500	1,300
2020	500	500	500	1,500
2021	500	500	500	1,500
2022	500	500	500	1,500
2023	500	500	500	1,500
2024	500	500	500	1,500
2025	500	500	500	1,500
2030	500	500	500	1,500
2031	600	600	299	1,499
2035	750	750	-	1,500
2040	750	750	-	1,500
2045	750	750	-	1,500
2050	750	750	-	1,500
2051	750	15	-	765
2052	659	-	-	659

Note: Annual growth is shown from 2015 to 2025. Years after 2025 are shown in 5-year intervals and for years when buildout within a service area occurs. Annual growth for years not shown between 5-year intervals is constant.

^(a) *New connections include the Elk Grove wholesale subarea, Cal Am portion of Rio Del Oro subarea, and recycled water connections.*

3.5 Unit Water Demand Factors

Buildout unit water demand factors (UWDFs) are developed using a water demand per land area approach expressed as ac-ft/yr per acre. The buildout water demands are estimated by combining the buildout land use acreage for each type of land use with the applicable buildout UWDFs. This land area based approach for developing the buildout water demands is the same methodology used in the current WSMP and the subsequent Cordova Hills amendment. Since water use characteristics have changed over the last few years, this study includes an update of the UWDFs. The buildout UWDFs are updated based on consideration of several sources of information.

- 2005 WSMP UWDFs: The UWDFs in the 2005 WSMP, which are assumed to be gross factors (applied to gross acreage) (SCWA, 2005).
- Cordova Hills WSMP Amendment: The UWDFs for buildout in the 2005 WSMP were verified with limited meter data (SCWA, 2011).
- SCWA analysis of residential water use: SCWA conducted an analysis of metered residential connections in Zone 40 and developed UWDFs for rural residential, single family, multi-family low density, and multi-family high density land uses for the years 2005 through 2012 (SCWA, 2013). The analysis showed a reduction in the UWDFs since the previous work was completed. This analysis is presented in Appendix A.
- Analysis of SCWA 2010 Water Use Factors: UWDFs representing 2010 were developed for this study using 2010 estimated developed acreage in Zone 40 and SCWA water use data by customer category.
- 2010 UWDFs of other water agencies: The water demands per acre for other local water agencies were analyzed to use as a point of comparison.
- Gallons per capita per day (GPCD): In July 2011, SCWA adopted the 2010 UWMP, which included an analysis and selection of the SBx7-7 GPCD goal for all of SCWA's service areas. To meet SCWA's GPCD goal for all of its service areas, the Zone 40 GPCD target for 2020 is 196 GPCD. The Zone 40 per capita demand was less than the target in 2010. The UWDFs are selected to result in an overall per capita demand that does not exceed the 2020 target.

It's recognized that unit water use on a per capita basis has been trending downward for several years. The analysis of 2005 to 2012 residential water use by SCWA showed marked reductions in the water use per acre, which was also evident in the analysis of 2010 demand conducted for this study. Therefore it can be concluded that the UWDFs for buildout should be lower than those previously established.

As an initial step, the UWDFs from the SCWA analysis were selected for the residential factors. The equivalent water use factors expressed as demand per dwelling unit and per connection were developed and compared to the analysis of 2010 water use factors and similar water use factors for other local water agencies that consist of the City, Sacramento Suburban Water District, and the City of Roseville. The analysis of SCWA's 2010 water use provided multifamily and nonresidential UWDFs that appear to be unrealistically low. It is suspected that the acreages quantified in that analysis include areas not served by the water system. This is an area to further investigate in the future.

The buildout residential UWDFs are defined to be the same as the UWDFs in the SCWA analysis for the rural residential, single family, and multi-family low density categories. The UWDF for multi-family high density is assumed to be 5 percent less at buildout than the value determined in the SCWA analysis. The updated buildout nonresidential UWDFs are established to be 30 percent higher than indicated in the analysis of 2010 factors and 20 percent less than the previous 2005 and 2011 demand factor estimates.

No specific adjustments to the residential demand factors have been made for the bonus density issue discussed previously in this section. Since the residential UWDFs are the same as the 2005 to 2012 UWDFs from the SCWA analysis, the UWDFs may incorporate some bonus density to the extent that bonus density has been awarded in the past.

To compare the UWDFs with the target GPCD, the UWDFs were converted to the equivalent GPCD. As shown in Table 3-4, the actual 2010 and projected buildout GPCD meet the target GPCD.

Table 3-4. Zone 40 Comparison of 2010 to Buildout Water Use Metrics - Baseline

	2010	Buildout	Change ratio
Gallons per capita per day ^(a)	186	184	0.99
Total use/total DU, gpd/DU	570	559	0.98
SFR use/ SFR DU, gpd/DU	490	475	0.97
MFR use/MFR DU, gpd/DU	119	174	1.47
Non-res use/DU, gpd/DU	102	174	1.71
Total use/total con, gpd/connection	606	852	1.40
SFR use/SFR con, gpd/connection	490	475	0.97
MFR use/MFR con, gpd/connection	2,734	2,012	0.74
Non-res use/non res con, gpd/connection	2,856	3,538	1.24
Total demand per developed acre, ac-ft/ac	2.10	2.19	1.04
Potable demand per developed acre (recycled water removed), ac-ft/ac	2.05	2.12	1.03

SFR=single family residential

MFR=multi-family residential

Note: Water loss of 7.5% of water sales is included in this table.

^(a) Includes recycled water. The Zone 40 2020 target is 196 GPCD. This target value does not include recycled water. GPCD for purposes of reporting to the California Department of Water Resources does not include recycled water.

The defined buildout UWDFs are less than the factors established in the previous WSMP and close to or exactly the same as the actual unit water use factors experienced from 2005 to 2012. The assumed buildout factors result in an overall buildout per capita demand that is slightly less than the GPCD target and slightly greater than the 2010 GPCD value. Water use declined in 2014 as a result of the Governor’s drought declaration. It is assumed that the 2014 water use is temporary and will increase back to the levels of the 2005 to 2012 period. It is quite possible that unit water demands could decline in the future due to the passive savings that result from low flow plumbing fixtures achieving a higher level of saturation in Zone 40. However, the amount of decline of these updated water demand factors compared to the previous WSMP makes it prudent at this time to not assume that even greater reductions that result in a per capita demand significantly below the GPCD target will be achieved and can be counted on. The subject of additional water conservation effects on unit water use should be revisited by SCWA routinely with updates of the buildout UWDFs.

The UWDFs for the non-residential water use categories have some uncertainty due to the unknown water use characteristics of future non-residential development as well as lack of minimal data for current non-residential UWDFs. There can be a wide range in water use by different types of non-residential development. It is recommended that as non-residential development occurs in the future, the water use of that new development be monitored and tracked along with the specific type of development and the amount of acreage occupied.

The gross unit water demand factors are listed in Table 3-5. These UWDFs should be applied to gross acreage that has not been adjusted to remove streets or right-of-way. Water system loss is not included in the UWDFs.

Table 3-5. Buildout Unit Water Demand Factors	
Land use	Gross unit water demand factors ^(a), ac-ft/acre/yr
Rural estate	1.37
Single family	2.13
Multi-family - low density	2.44
Multi-family - high density	3.33
Commercial	2.02
Industrial	2.02
Public	0.81
Public recreation	2.80
Mixed land Use	2.15
Right-of-way	0.18
Self-supported/supplied by others	
Non-irrigated	--
Industrial-unutilized	--
Agricultural	--

^(a) Water loss is not included in the unit water demand factors.

Table 3-4 compares historical and projected water use metrics including demand per capita, per dwelling unit, per connection, and per acre for Zone 40 for the Baseline scenario. Below are some observations regarding some of the factors with the larger change ratios between 2010 and buildout.

- Non-residential water use/dwelling unit factor increases by 71 percent from 2010 to buildout. This reflects the large increase in the amount of non-residential land area and resulting water use compared to the smaller projected increase in residential land area.
- Non-residential use/non-residential connection factor increases by 24 percent from 2010 to buildout. This reflects the change in the mix of non-residential land use categories. One example is the proportionally large increase in public land use acreage at buildout. The public recreation land use category has connections that serve larger parcels and have a higher UWDF compared to the other non-residential land use categories.

Water loss includes water loss due to leaks, breaks, storage overflows, water use for firefighting, line flushing, and other authorized, but unbilled uses. Since SCWA is not completely metered, data are unavailable for determining the current percent of water loss. Water loss is assumed to 7.5 percent of water sales.

3.6 Recycled Water Demands

Recycled water use is currently approximately 900 ac-ft/yr. Recycled water use is projected to increase to a total of 3,300 ac-ft/yr when the planned Phase 2 recycled water system for the East Franklin and Laguna Ridge areas is completed.

The potential for additional recycled water use in areas in close proximity to the existing and planned Phase 1 and 2 areas are estimated to be approximately 500 ac-ft/yr based on serving public and public recreation land use categories in the adjacent Southeast Policy Area and Sterling Meadows subareas. This analysis of additional potential recycled water demand is not a recommendation to supply recycled water to these areas. SCWA plans to evaluate future recycled water use in a future study.

Section 4

Water Supply

The sources of water for SCWA's Zone 40 consist of surface water, groundwater, and recycled water. The existing water supply sources are described and quantified in this section. The adequacy and reliability of each supply for normal and dry hydrological conditions are presented.

4.1 Water Forum Agreement

SCWA is a stakeholder in the Water Forum, a Sacramento regional water management initiative. The Water Forum Agreement (WFA) was the result of the efforts of a diverse group of community organizations formed in 1994 to formulate principles for a regional solution for protecting the lower American River and providing for future water supply. The WFA was designed to achieve the two coequal objectives of providing a reliable and safe water supply for the region's economic health and planned development to the year 2030 and preserving the fishery, wildlife, recreational, and aesthetic values of the lower American River.

The WFA includes purveyor specific agreements (PSA) that define the benefits each water purveyor will receive as a stakeholder and actions each water purveyor must take to receive these benefits. The PSA for SCWA discusses the planned surface water supplies as part of a conjunctive use program to meet SCWA's water needs for planned growth. The PSA says that SCWA will divert surface water at or near the mouth of the American River or from the Sacramento River. Pertinent elements of the PSA for SCWA are discussed in the surface water and groundwater supply descriptions in this section.

4.2 Surface Water


Zone 40 surface water supplies consist of Central Valley Project (CVP) water, appropriative water, American River Place of Use (POU) water, and other surface water sources. Figure 4-1 illustrates the location of the major surface water facilities.

The quantities of surface water available to SCWA in wet/average, drier, and driest years and the frequency of their occurrence are important aspects for the planning of a conjunctive use system. The availability of each surface water supply source in different water year types is described below.

4.2.1 Central Valley Project Water

The CVP water supply consists of the CVP contract held by SCWA and the two Sacramento Municipal Utilities District (SMUD) assignments that total 45,000 ac-ft/yr. Most of the CVP water is diverted at the Freeport diversion on the Sacramento River and treated at the Vineyard SWTP. Some of the CVP supplies are diverted from the Sacramento River and treated at the City's Sacramento River SWTP and delivered to SCWA at the Franklin Intertie.

SCWA entered into a contract in April 1999 with the U.S. Bureau of Reclamation (Reclamation) for 22,000 ac-ft/yr of CVP supplies pursuant to Public Law (PL) 101-514. This contract is often referred to as "Fazio Water" in recognition of the efforts by Congressman Vic Fazio to secure this contract. Of this 22,000 ac-ft/yr, 7,000 ac-ft/yr has been subcontracted to the City of Folsom for diversion from Folsom Lake, with 15,000 ac-ft/yr available for SCWA through the Freeport diversion or Franklin Intertie. This supply is currently (2015) diverted at the City's Sacramento River SWTP and delivered to SCWA at the Franklin Intertie.

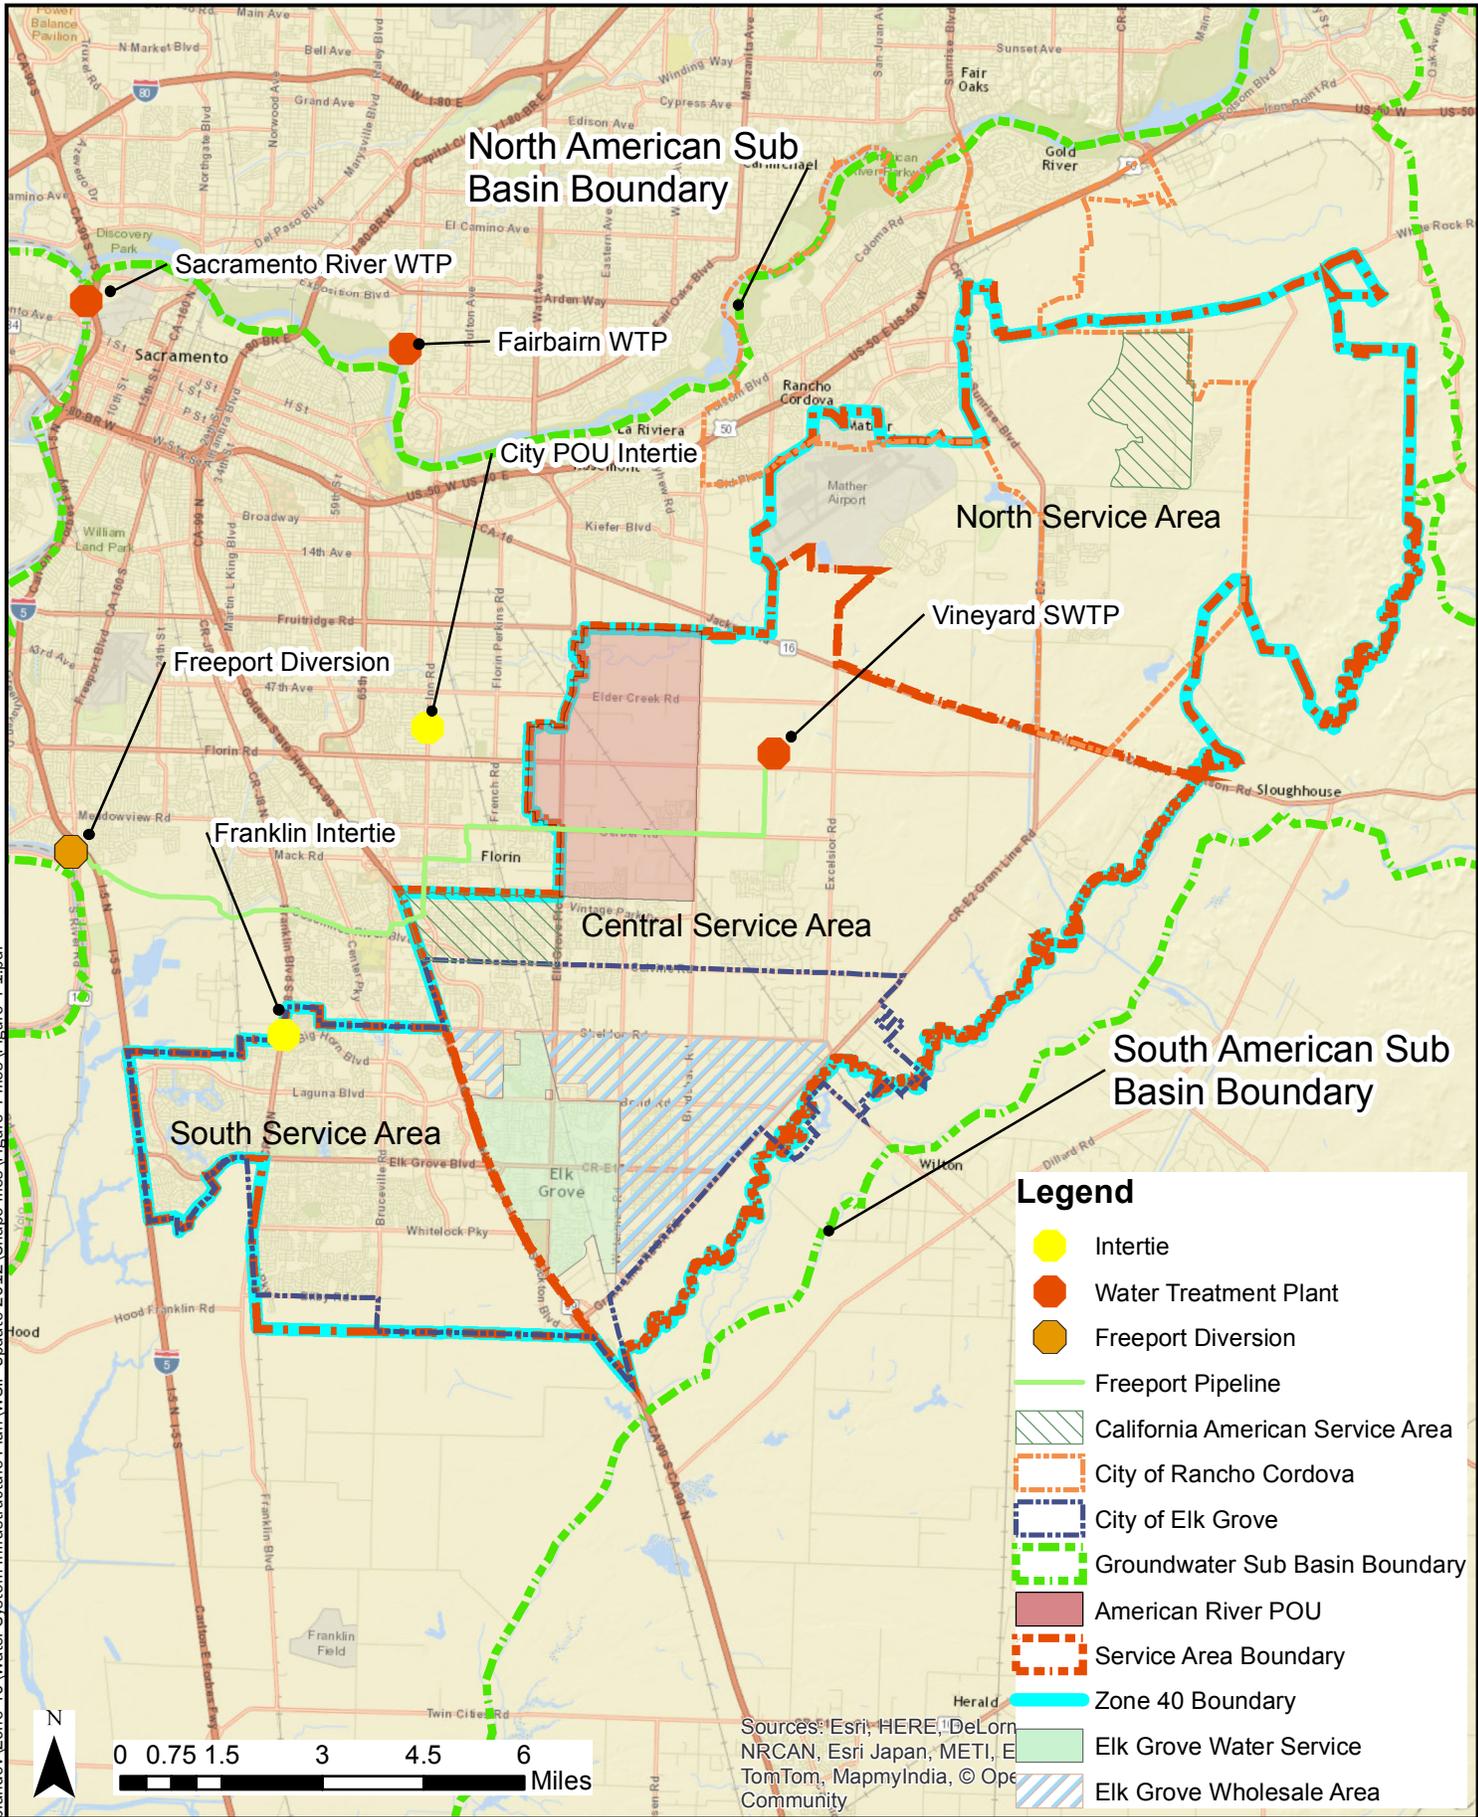

Zone 40 Water Supply Master Plan Amendment

Zone 40 Water Supply

Figure 4-1

DATE	PROJECT	SITE
1/20/15	148130	
TITLE		

SCWA has entered into two three-party agreements with the City and SMUD for the assignment to SCWA for a total of 30,000 ac-ft/yr of water from SMUD's existing contract with Reclamation. These assignments are often referred to as "SMUD I" and "SMUD II". This supply is also available for SCWA through the Freeport diversion or Franklin Intertie.

SCWA's total CVP supply is subject to reductions in dry years. The water supply allocations are defined by Reclamation on a year to year basis and are expressed as a percentage of either the contract amount or amount of average use. For the 20 year period of 1995 to 2014, the lowest allocation was 50 percent in 2014.

The water supply allocations are based on a draft policy that defines water shortage terms and conditions. Reclamation initiated the development of a Municipal and Industrial (M&I) Water Shortage Policy in 1992, with several proposals prepared through 2001. The 2001 draft water shortage policy states that Reclamation would reduce M&I water to a contractor once irrigation water allocations are reduced below 75 percent of the contract amount. Reclamation has a provision in the draft policy for a minimum M&I shortage allocation of 75 percent that is applied to the last three years of historical use with certain adjustments, although the actual allocation in 2014 was 50 percent of historical use (US, 2001). In 2010, Reclamation convened several workshops that will lead to the development of an Environmental Impact Statement that could potentially modify the existing policy or develop a new policy (US, 2011).

Supply allocations of 100 percent in a wet and average year, 75 percent for a drier year, and 50 percent of the historical use in the driest year are assumed.

4.2.2 Appropriative Water

In February 2008, the State Water Resources Control Board (SWRCB) approved SCWA's appropriative right permit application to divert water from the American and Sacramento Rivers (Permit 21209). The amount of appropriated water available for use could range up to 71,000 ac-ft/yr in wet years, primarily during the winter months. This water would be diverted at the Freeport diversion on the Sacramento River. Since SCWA's demands are low in the winter months, SCWA would likely have to construct storage to utilize the full amount. It is possible that 35,000 ac-ft/yr of this supply could be utilized without the ability to store the water. No supply from this source is assumed for the drier and driest years.

4.2.3 City of Sacramento's American River Place of Use Water Supply

A portion of Zone 40 lies within the City's American River POU. The City has a pre-1914 water right to the American River with a POU boundary that extends beyond the City's boundary and includes a portion of Zone 40, as shown on Figure 4-1. The amount of water available to serve the POU area within Zone 40 is estimated to be 9,300 ac-ft/yr (SCWA, July 2011).

The Water Forum PSA for SCWA assumes that the City's American River water entitlements would be a source of supply for Zone 40. This is consistent with the City's PSA. The City is planning for the wholesale delivery of American River water within the POU including areas outside of the City limits. A connection would be constructed to supply the Florin Vineyard Community Plan area in the CSA, with the timing based on when the supply is actually needed.

The City's diversions from the American River at the Fairbairn Water Treatment Plant are reduced when American River flows are less than the Hodge Flow Criteria, which would likely result in no POU water being available for SCWA in these circumstances. The City may decide to divert water during these restricted times at their Sacramento River diversion, although additional infrastructure might need to be constructed by the City to be able to convey this water to SCWA. It might be possible for SCWA to divert the POU water at the Freeport diversion. Given the uncertainty of the availability of POU water during dry periods, a supply

allocation of zero percent in the driest year and drier year, and 100 percent in the wet and average year is assumed.

4.2.4 Other Water Supplies

Other water supplies are water transfers that would be obtained from various water users that hold surface water rights on the Sacramento River and the American River upstream of SCWA’s point of diversion. To obtain these supplies, SCWA would enter into purchase and transfer agreements with other entities that hold surface water rights. There are Sacramento River water supplies available for transfer in dry years, although the costs of these dry year supplies can exceed \$500 per ac-ft.

The assumed quantity of other water supplies is 9,600 ac-ft/yr in dry years and no supplies transferred in wet years. The annual supply to demand comparison presented in Section 5.2 indicates that these other water supplies would not be needed at all if the CVP, POU, and groundwater supply amounts are not less than assumed. Therefore, the amount of other water supplies that would be needed would vary depending on the water supply situation.

SCWA has a Memorandum of Understanding dated April 2000 with GSWC to purchase up to 1,000 gpm of water through the Mercantile Intertie located within the NSA. The intertie between the two systems currently serves as an emergency connection for both water purveyors. No routine water supply from GSWC is assumed.

4.2.5 Summary of Surface Water Supplies

Table 4-1 presents SCWA’s surface water supplies for the wet/average years, drier years, and driest years assuming no constraint on supply capacity. The long-term average supply values presented in Table 4-1 assume that the supplies are all fully utilized with no infrastructure capacity constraints for all of the water year types, except for the amount of appropriative water as described in Section 4.2.2. The frequency of occurrence of these water year types are assumed to be 64 percent, 28 percent, 8 percent of the years respectively, based on an analysis of a historical 70-year hydrologic period (SCWA, 2006, Pg. 7-3). The frequency of occurrence of different water year types may change in the future, such as due to the impacts of climate change.

Table 4-1. Summary of Surface Water Supplies, ac-ft/yr

Water supply sources	Contract/water right/transfer amount	Wet/average year	Drier year	Driest year	Long-term average ^(b)
U.S. Bureau of Reclamation – CVP supply (SMUD 1, SMUD 2, and Fazio Water)	45,000	45,000	33,750 ^(a)	22,500 ^(a)	40,050
Appropriative water – SWRCB Permit 21209	71,000	35,000	0	0	22,400
City of Sacramento’s American River POU Water Rights	9,300	9,300	0	0	5,952
Other water supplies	9,600	0	9,600	9,600	3,456
Total	134,900	89,300	43,350	32,100	71,858

^(a) CVP drier and driest year supplies are the lesser of these values or 75 and 50 percent of the three year historical average, respectively. The driest year CVP supply may be as low as 13,100 ac-ft/yr since the average year of use of the CVP supply will be lower than the contract amount for a number of years.

^(b) Based on full use of all supplies for each water year type, which is different than the projected actual use of supplies. The frequency of occurrence for the wet/average, drier, and driest years assumed to be 64 percent, 28 percent, 8 percent of the years respectively, based on an analysis of a 70-year hydrologic period (SCWA, 2006, Pg. 7-3).

4.2.6 Historical Use of Surface Water Supplies

The use of surface water in Zone 40 started in 1995 through a contract with Browns Valley Irrigation District. In 1999, delivery of the CVP contract water was started through a wheeling agreement with the City. Surface water has historically been a minor portion of the supply for Zone 40, as shown on an annual basis on Figure 4-2 and a monthly basis on Figure 4-3. The water supplies on Figure 4-2 are identified by the service area where the water production occurs. Some of the surface water and CSA groundwater produced in the CSA are used in the SSA. Surface water use in Zone 40 has increased starting in 2011 with the startup of the Vineyard SWTP.

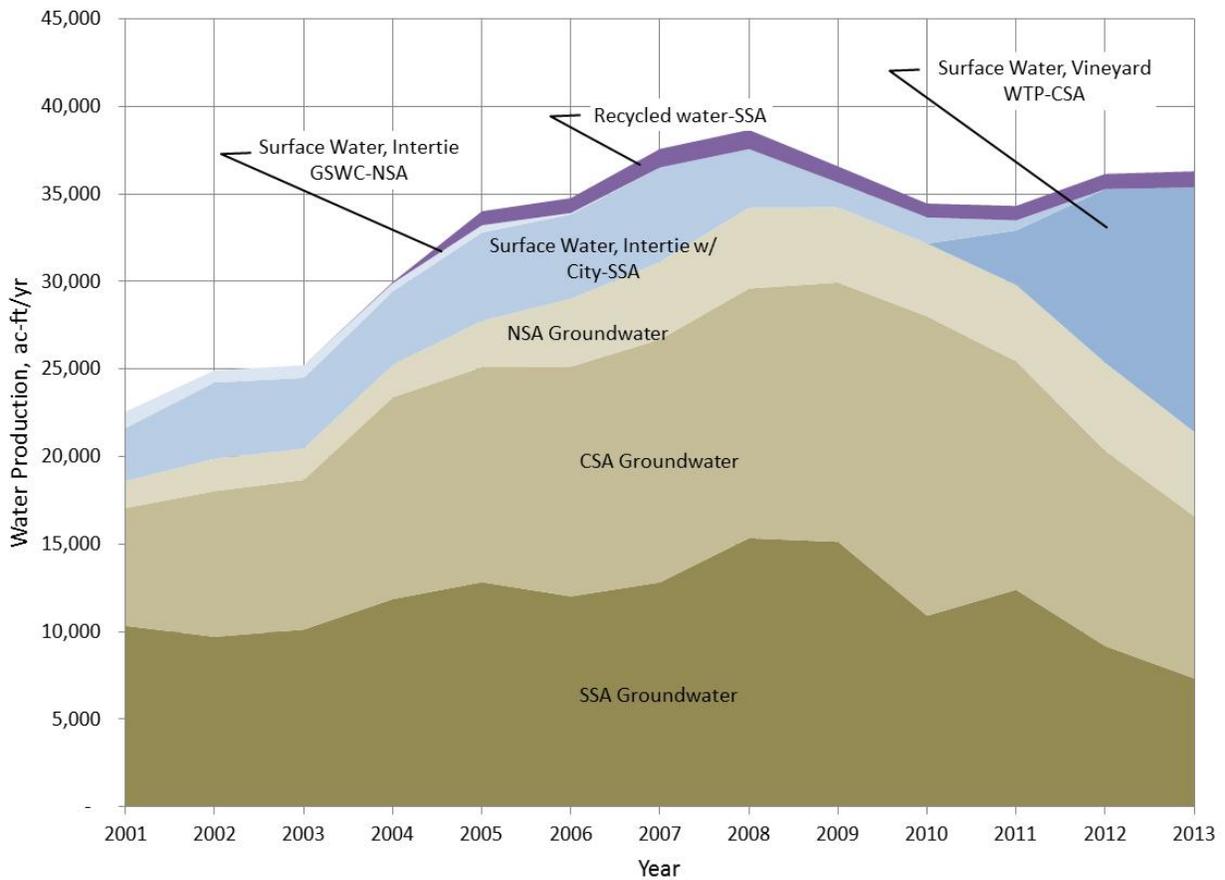


Figure 4-2. Historical Annual Water Supply

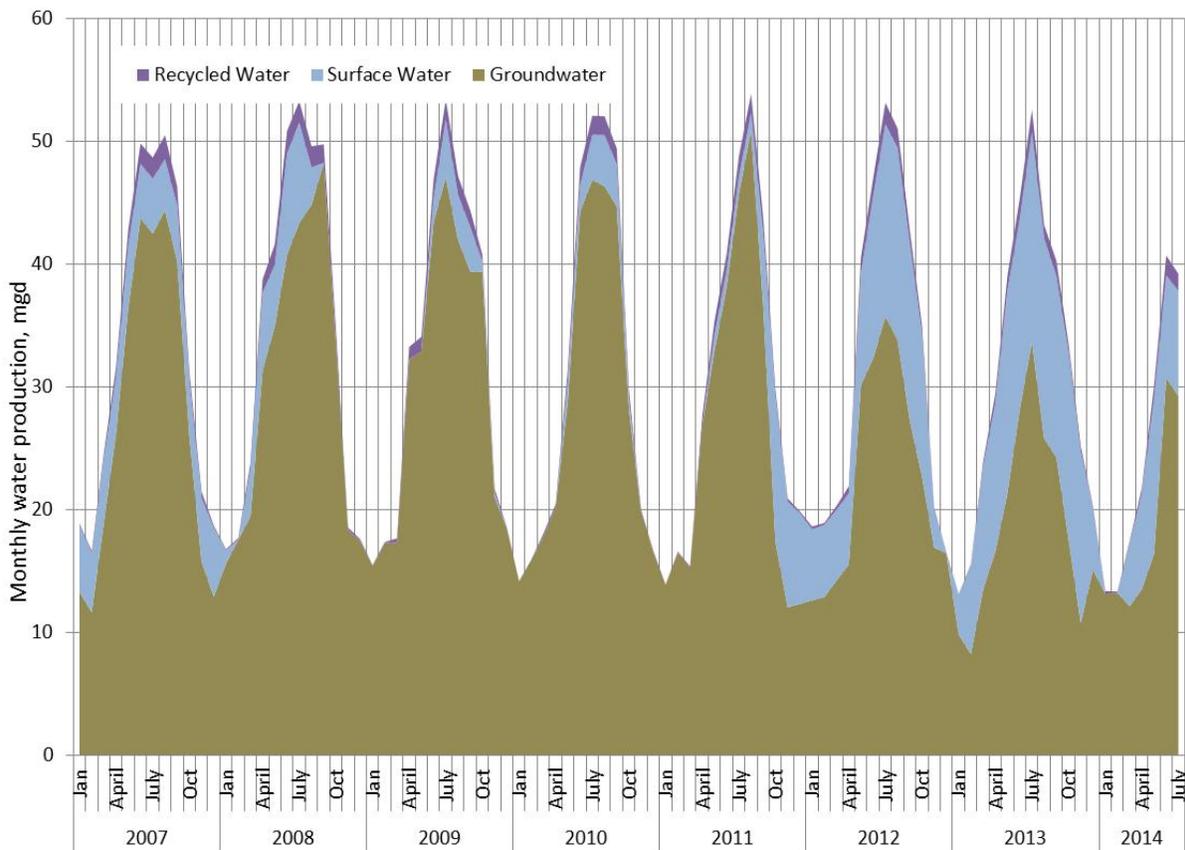


Figure 4-3. Monthly Water Production by Type of Supply

4.3 Groundwater

Zone 40 is supplied groundwater from part of the South American Subbasin (5-21.65) that covers an area of 248,000 acres. The South American Subbasin is not adjudicated and is not considered to be in overdraft according to DWR Bulletin 118 (DWR, 2003). This section describes the Sacramento Central Groundwater Authority (SCGA), the groundwater basin, historical groundwater use, and the remediated groundwater supply.

4.3.1 Sacramento Central Groundwater Authority (SCGA) and Groundwater Management Plan

SCGA was formed in 2006 through a joint powers agreement signed by the Cities of Elk Grove, Folsom, Rancho Cordova, and Sacramento, and the County of Sacramento. SCGA was formed for several purposes including maintaining the long-term sustainable yield of the Central Basin, managing the use of groundwater in the Central Basin, and facilitating the implementation of a conjunctive use program. The Central Basin is defined as the area bounded on the west by the Sacramento River, on the north by the American River, on the south by the Cosumnes River, and on the east by the foothills of the Sierra Nevada Range. The Central Basin's boundaries are similar to the boundaries of the South American Subbasin, although there are some differences. The Water Forum defined the long-term sustainable average annual yield of the Central Basin to be 273,000 ac-ft/yr. Zone 40 lies within a portion of the Central Basin.

The Central Sacramento County Groundwater Management Plan (CSCGMP), which was adopted in 2006 by SCGA, establishes a framework for maintaining sustainable groundwater resources in the Central Basin. This framework includes specific goals, objective, and an action plan to manage the basin and provides guidance to various stakeholders and negotiations for groundwater use.

4.3.2 Groundwater Basin Description

Groundwater in the Central Basin is generally classified as occurring in a shallow or upper unconfined aquifer zone (Laguna or Modesto Formation) and in an underlying deeper semi-confined aquifer zone (Mehrten Formation). These formations are typically composed of lenses of inter-bedded sand, silt, and clay, interlaced with coarse-grained stream channel deposits. The shallow aquifer extends approximately 200 to 300 feet below ground surface (bgs). The deep aquifer is separated from the shallow aquifer by a discontinuous clay layer that serves as a semi-confining layer for the deep aquifer. The base of the potable water portion of the deep aquifer averages approximately 1,400 feet bgs. Groundwater used in the Central Basin is supplied from both the shallow and deeper aquifer systems.

Intensive groundwater extraction from the Central Basin in the past has resulted in a general lowering of groundwater elevations near the center of the basin away from the sources of recharge. These depressions have grown and coalesced into a single cone of depression centered near Elk Grove. In general, the rest of the Central Basin does not show any distinctive patterns with respect to regional groundwater elevations, and the water table tends to mimic the local topography. With the completion of the FRWA project and SCWA's Vineyard WTP, the groundwater levels in the Central Basin are anticipated to stabilize as the conjunctive use program is fully implemented.

Groundwater in the upper aquifer system is of higher quality than that found in the lower aquifer system, although there are some occurrences of arsenic and nitrate. The lower aquifer system contains higher concentrations of iron and manganese and total dissolved solids (TDS). Water from the upper aquifer generally does not require treatment other than disinfection for public drinking water systems, unless high arsenic or nitrate values are encountered. Wells that pump from the lower aquifer often require treatment for iron and manganese. Most of SCWA's Zone 40 wells have iron and manganese treatment facilities.

Groundwater contamination plumes exist in the NSA that have migrated from the Aerojet/Boeing and Mather properties. SCWA has four operating wells (Mather Housing) in the vicinity of these plumes. There are several other smaller contamination plumes located in other areas of Zone 40.

4.3.3 Historical Use of Groundwater Supplies

Groundwater historically has been a substantial portion of the supply for Zone 40, as shown on an annual basis on Figure 4-2 and a monthly basis on Figure 4-3. The recent completion of the FRWA project and the Vineyard SWTP and the resulting increased use of surface water have resulted in a reduction in the annual use of groundwater in Zone 40 since 2009.

The current groundwater pumping to meet agricultural demands within Zone 40 and each of the new growth areas is estimated at 12,730 ac-ft/yr for 4,050 acres based an inspection of aerial photographs to determine existing agricultural acreage for field and row crops and pasture.

4.3.4 Remediated Groundwater

SCWA has a remediated groundwater supply of 8,900 ac-ft/yr in accordance with the terms and conditions in the agreement entitled "Agreement between Sacramento County, SCWA, and Aerojet-General Corporation With Respect To Transfer of GET Water" dated May 18, 2010. The timing and amount of remediated groundwater available is subject to change as a result of on-going negotiations with water purveyors affected by groundwater contamination and with Aerojet/Boeing as their remediation plans may change as directed by various regulatory agencies. The remediated groundwater is discharged into the American River from

Aerojet’s Groundwater Extraction and Treatment (GET) facilities located in the Rancho Cordova area that are used for groundwater clean-up operations. This remediated groundwater supply is diverted by SCWA from the Sacramento River at Freeport along with SCWA’s surface water supplies. A supply allocation of 100 percent in the driest year, drier year, and in a wet and average year is assumed.

4.4 Recycled Water

Recycled water is tertiary treated wastewater obtained from SRCS D that is supplied to the SSA in Zone 40 as a source of non-potable water for irrigation of parks, schools, and rights-of-way. Currently, SCWA provides recycled water in the SSA as part of a pilot project in the Laguna West, Lakeside, and Laguna Stonelake service areas (Phase 1 Area) that are located in the western portion of the Laguna subarea. Recycled water has historically been a small portion of the supply for Zone 40, as shown on an annual basis on Figure 4-2 and a monthly basis on Figure 4-3.

Recycled water supply availability will increase in the future when SRCS D expands its 5 mgd tertiary treatment facility. Recycled water use would increase to a total of 3,300 ac-ft/yr when the Phase 2 recycled water system is completed in the East Franklin and Laguna Ridge areas in the SSA (Phase 2 Area). Recycled water supply is assumed to be available at 100 percent of full supply in wet/average, drier, and driest years.

There is an emerging trend in California to use recycled water as an indirect source of potable water, known as indirect potable reuse. There are a limited number of water suppliers in California that are introducing recycled water into their potable water supplies through groundwater recharge. The City of San Diego is implementing a program that will result in augmenting one of their surface water supply reservoirs with recycled water. Studies are ongoing to develop requirements for direct potable reuse of recycled water. The attractiveness of these approaches is that the enormous costs of recycled water pipeline distribution systems can be avoided. SCWA intends to consider these options as it develops its long term recycled water strategy.

4.5 Water Supply Portfolio

The various water supplies available to SCWA combine to form Zone 40’s water supply portfolio. SCWA has implemented a conjunctive use program within Zone 40 that optimizes the use of groundwater and surface water based on hydrologic conditions.

Historically, SCWA relied primarily on groundwater to provide water service to its customers. Existing groundwater pumping capacity plus a relatively small amount of surface water through the Franklin Intertie had been sufficient to meet system wide water demands. With the completion the Freeport project and the Vineyard SWTP, SCWA is now able to more fully implement a conjunctive use program that results in a variation of the mix of supplies based on the water year type.

Conjunctively using surface water and groundwater allows SCWA to reduce surface water diversions and increase groundwater use in dry years. In wet and average years SCWA can increase surface water use and decrease groundwater use, thereby not exceeding the long term sustainable yield of the underlying groundwater basin.

Table 4-2 presents SCWA’s unconstrained water supply portfolio for wet/average, drier, and driest years. Table 4-2 also presents the long-term average use on an annual basis of each supply source assuming that all of the available water supplies are fully used for each climate year type. SCWA would have to construct additional supply, treatment, and conveyance facilities to fully access the available water supplies presented in Table 4-2. Figure 4-4 illustrates the Zone 40 available water supply in each year type assuming that supply facilities with adequate capacities are available. The long-term average supply availability may change if the frequency of occurrence of different water year types changes in the future, such as due to the

impacts of climate change. Section 5 presents the annual supplies that are available with the constraint of the capacity of the facilities and the projected use of the supplies.

Table 4-2. Zone 40 Water Supply Portfolio, ac-ft/yr ^(a)				
Supply source	Wet/average year	Drier year	Driest year	Long-term average ^(d)
Surface water ^(b)	89,300	43,350	32,100	71,858
Groundwater ^(c)	34,900	64,900	71,900	46,260
Recycled water	3,300	3,300	3,300	3,300
Total	127,500	111,550	107,300	121,418

^(a) These water supply values are not constrained by water supply facility capacities. SCWA would have to construct additional supply, treatment, and conveyance facilities to fully access the available water supplies presented in this table.

^(b) The surface water drier and driest year supplies could be less if the prior 3-year historical CVP use is less than the CVP contract amount. See Table 4-1 and text.

^(c) Includes the 8,900 ac-ft/yr remediated groundwater supply. Groundwater supply amounts are the projected annual groundwater use at buildout presented in Section 5.

^(d) Based on full use of all supplies for each water year type. The frequency of occurrence for the wet/average, drier, and driest years assumed to be 64 percent, 28 percent, 8 percent of the years respectively, based on an analysis of a 70-year hydrologic period (SCWA, 2006, Pg. 7-3).

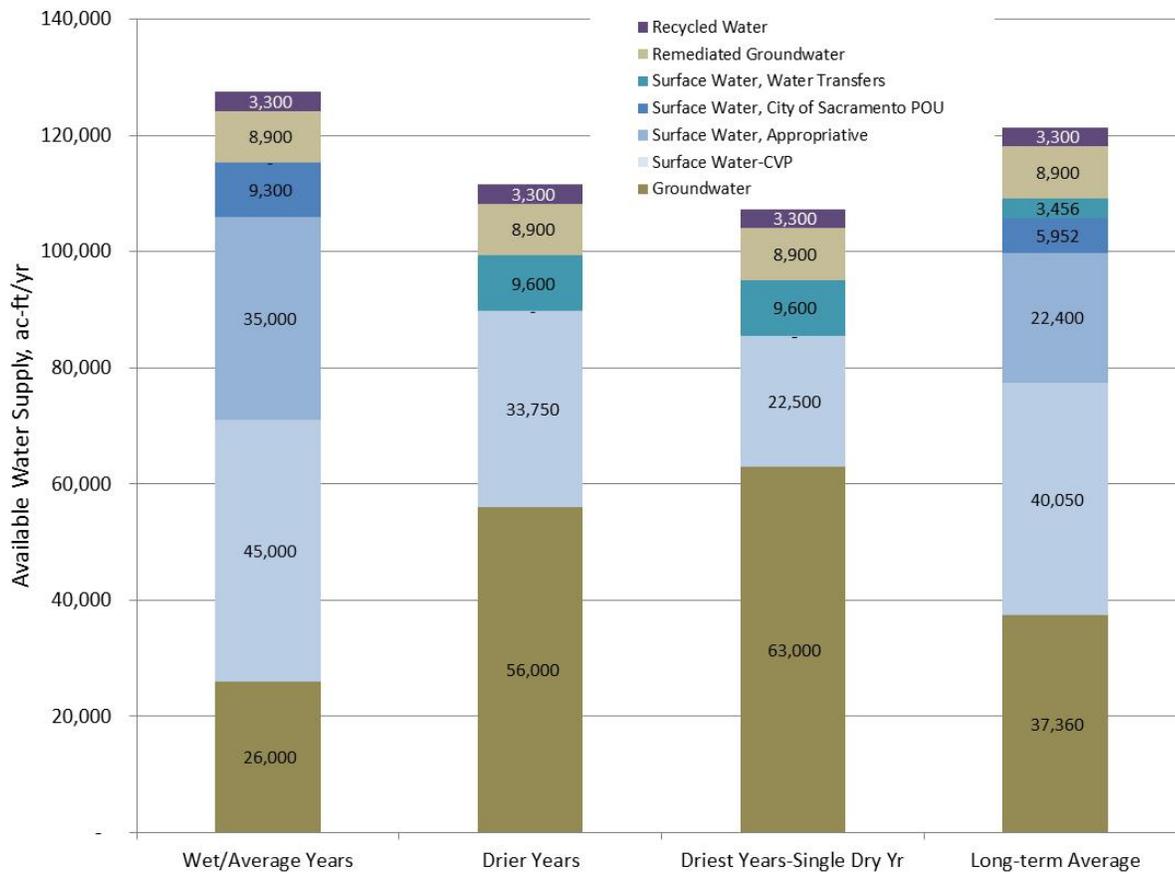


Figure 4-4. Available Water Supplies

Section 5

Water Supply Capacity Approach

This section describes the approach to quantify the amount of supply capacity that would be needed to meet Zone 40 demands through buildout. This information is needed to properly size the future water supply facilities. The capacity of the current system to supply current water demands is evaluated. The approach to evaluate storage requirements is presented.

5.1 Maximum Day Demand Supply Capacity and Use

Zone 40 needs enough water supply capacity to meet the projected future maximum day demand for both wet and dry climate years. The maximum day demand condition is important because the water supply facilities are sized to meet and exceed that condition. The planned future water supply capacity is based on the construction of new groundwater, surface water, and recycled water supply and conveyance facilities that are described in subsequent sections of this report for each of the scenarios. The maximum day demand is estimated using a maximum day demand peaking factor of 2.0.

Both wet year and dry year scenarios are considered in quantifying the needed water supply capacity. The total capacity of all water supply facilities must significantly exceed the maximum day demand because of the requirements of the conjunctive use program. The future water supply capacity is developed to meet the projected maximum day demands while allowing SCWA to vary the mix of supplies based on water year type. The water supply capacity is developed with the approach to increase the use of surface water in wet/average years and groundwater in dry years (conjunctive use program). The supply capacities include the supply for the Elk Grove and Rio del Oro wholesale areas as well as the Zone 40 retail area.

The remediated groundwater is categorized as part of the surface water supply capacity and use since it is conveyed through the surface water facilities. The groundwater capacity and use only reflects groundwater produced from wells owned and operated by SCWA.

The timing of the supply capacities is developed based on three phases. The period from January 2015 to December 2025 is considered Phase 1, January 2026 to December 2035 is considered Phase 2, and Phase 3 is the period from January 2036 through buildout.

Figure 5-1 presents a comparison of the total capacity of the existing water supply facilities to the 2013 maximum day demand for each of the service areas. The detailed supply capacity to demand tables for each service area are presented in Appendix B for 2013. As shown on Figure 5-1, the capacities of all of the existing water supply facilities exceed the maximum day demands for each service area. All three of the service areas currently have adequate groundwater supply capacity to meet their current maximum day demand without the use of surface water. There is enough surface water supply capacity in the CSA to meet the CSA's current maximum day demand without the use of groundwater. The NSA and the SSA currently have a more limited supply of surface water that cannot fully supply the maximum day demand.

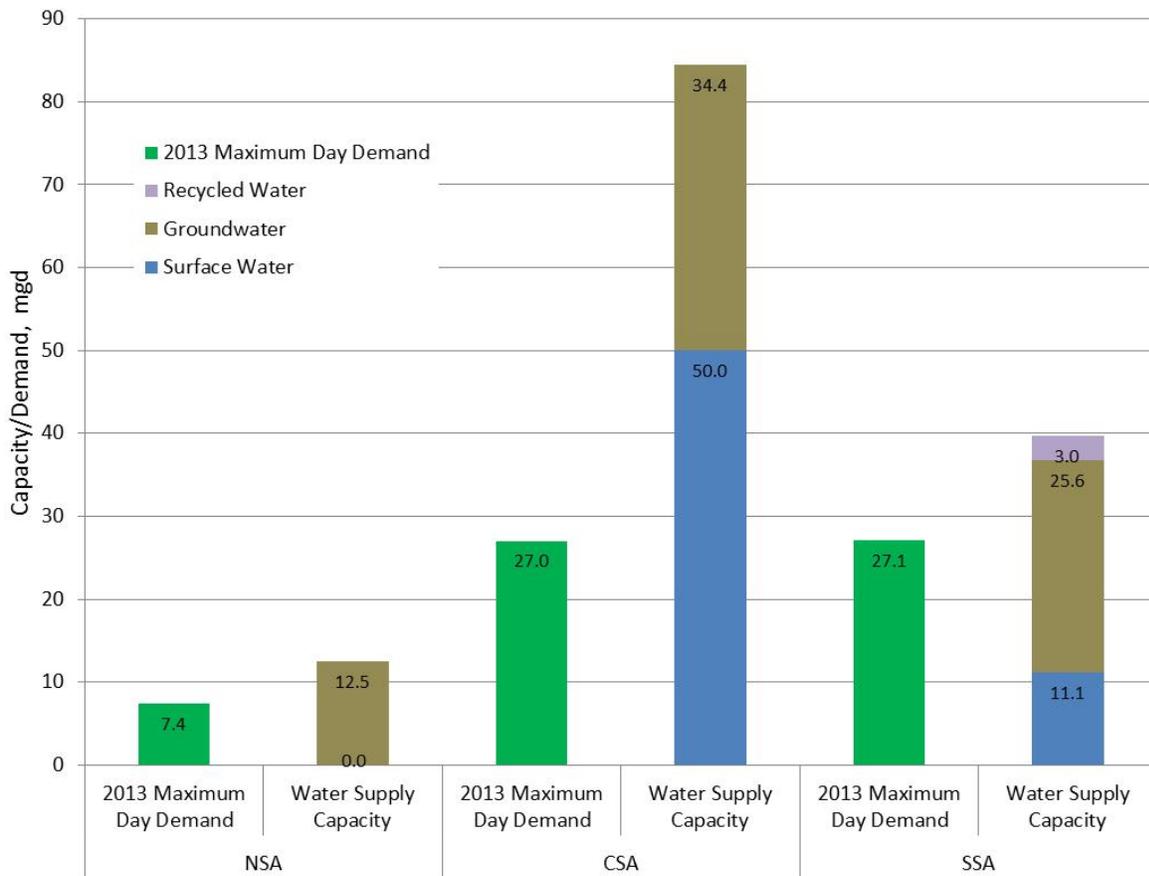


Figure 5-1. 2013 Maximum Day Demand and Supply Capacity by Service Area

5.1.1 North Service Area

The NSA is currently supplied by groundwater from existing groundwater treatment plants. The Mercantile interconnection with Golden State Water Company is only used for emergency purposes. The existing groundwater facilities have the capacity to meet the maximum day demand, with the Anatolia GWTP being the predominant water supply source and a smaller portion of groundwater from the Mather Housing GWTP. Surface water from the existing Vineyard SWTP cannot be delivered to the NSA due to lack of existing pipelines.

5.1.2 Central Service Area

The CSA is currently supplied by groundwater from existing groundwater treatment plants and some direct feed wells and surface water from the Vineyard SWTP. The existing groundwater facilities have the capacity to supply all of the current maximum day demand. Similarly, the Vineyard SWTP's current 50 mgd capacity is more than adequate to supply all of the CSA's current maximum day demand.

Water supplies produced in the CSA can be delivered to the SSA through the three connections between the CSA and SSA. These connections are located along Highway 99 at Sheldon Road, Bond Road, and Grant Line Road. The total capacity of these connections is approximately 30 mgd.

5.1.3 South Service Area

The SSA is currently supplied by surface water from the Franklin intertie and the Vineyard SWTP, groundwater from three existing groundwater treatment plants and some direct feed wells, and a small amount of recycled water. The existing groundwater facilities in the SSA have the capacity to supply all of the current maximum day demand.

As described previously, the three existing connections between the CSA and SSA can be used to supply surface water or groundwater to the SSA from the CSA.

5.2 Annual Water Supply Capacity and Use

The available supply capacity and use of supply are developed for each scenario on an annual basis because the values are directly useable for the development of water supply assessments and urban water management plans. The available water supply amounts that are described in Section 4 represent the full amount of available supply assuming there are no facility capacity constraints. The supply capacities and use of supplies are constrained by the supply and conveyance facility capacities.

The annual supply capacity and use are determined using the maximum day supply capacity and use. The proportional capacity and use of each water supply type on an annual basis is assumed to be the same as the mix of supplies on the day of maximum day. The annual supply capacity and use of supply is determined by assuming that the annual average day capacity or use is 50 percent of the capacity or use on the day of maximum demand. For example, a water supply capacity of 50 mgd equates to an annual average day capacity of 25 mgd or an annual capacity of 28,000 ac-ft/yr.

The actual annual use of supplies could differ from the values presented in this section if SCWA took an operational approach that would result in the annual mix of supplies being different than the mix of supplies used during the day of maximum demand. For example, in a dry year groundwater could be used to meet all of the demands in the winter, spring, and fall months. This would result in less surface water and more groundwater being used annually than what is presented in this section. Similarly, in a wet year surface water could be used to meet all demands in the winter, spring, and fall months. This would result in less groundwater and more surface water being used annually than what is presented in this section.

The remediated groundwater is included in the annual surface water values since it is conveyed through the surface water facilities. The annual groundwater amounts are only for the wells owned and operated by SCWA and exclude the groundwater remediation extraction.

One of the climate year types is expressed as multiple dry years to be consistent with the climate year types used for water supply assessments and urban water management plans. The multiple dry three year period is assumed to mimic the hydrology of 1989, 1990, and 1991 (SCWA, 2011). The CVP allocations for those three years were 100, 75, and 50 percent, respectively. The dry year CVP allocations are based on a percentage of the last three year historical use.

5.3 Storage and Pumping Station Capacity Evaluation Approach

This section presents the approach used to conduct the storage analysis that establishes the sizing and timing of future water storage facilities. Since it is not cost effective to size groundwater and surface water supply facilities to supply demands that occur above the maximum day demand rate, water storage is used to supply these short term demands. The short term demands that can last for a few hours are the peak hour demands and fire flow demands.

Since Zone 40 does not have high enough terrain to locate tanks that can provide adequate pressure with gravity flow, ground level tanks must be used in conjunction with pump stations to pump the stored water into the distribution system. The use of elevated storage tanks is typically not cost effective in the larger

storage volumes required for Zone 40. The storage evaluation has two elements, consisting of the storage volume and pump station capacity.

5.3.1 Storage Volume

The required minimum storage volume is the sum of the following three components:

Equalization Storage. Water is provided for equalization storage to meet the increment of peak demands that exceed the maximum day demand. Equalization storage is assumed to be 20 percent of the maximum day demand.

Emergency Storage. Volume is also required for emergency supplies in the event normal supplies are not available. Emergency storage is assumed to be 1/3 of the average day demand. Many water agencies have criteria to provide greater amounts of emergency storage such as one average day demand. However, since SCWA can utilize the underlying groundwater basin to provide additional volume, the sizing assumption is reasonable.

Fire Flow Storage. Water is stored to provide fire flow. Fire flow storage is assumed as the volume for two fires for each service area, with each fire requiring 3,000 gpm for 3 hours. SCWA also has storage provided by the groundwater basin that can provide a large volume of water. Some building types can have fire flow requirements that are higher. The assumption of having fire storage for two simultaneous fires in each service area provides enough storage for one larger fire flow rate or longer duration fire flow.

5.3.2 Pump Station Capacity

Pump stations must have the capacity to supply peak hour demand. The peak hour demand is estimated using a peak hour factor of 2.0 applied to the maximum day demand. There are two situations in Zone 40 that govern the sizing of the pump stations that are used with storage tanks. A pump station that pumps from a standalone storage tank can use its entire pumping capacity to draw water from storage. A pump station that pumps from a tank that is supplied by a GWTP or a SWTP must be sized large enough to be able to pump the supply from both the GWTP and from the storage facility. Only the portion of the pump station capacity that is larger than the GWTP or SWTP capacity is considered to be able to utilize the stored water. Both situations are considered in the storage pump station evaluation.

In situations where a GWTP or SWTP has surplus maximum day capacity, some of that surplus could be used to help supply demands that are greater than the average rate on the maximum demand day. In these types of situations, the required pump station capacity to meet peak hour demand would be less than presented in this analysis.

Section 6

Water System Facilities and Capital Improvement Plan Approach

This section describes the approach used to identify the needed water system facilities and develop the resulting CIP.

6.1 Needed Water System Facilities

The water supply facilities are sized to provide the maximum day surface water and groundwater supply capacities for each scenario. The storage tank and pumping station facilities are defined based on the storage evaluation developed for each scenario. The water supply, storage, pump station, and pipeline improvements have been identified by SCWA staff and are defined based on water system modeling performed by SCWA staff that is documented in the WSIP.

The sizing and timing of the water supply facilities are developed based on several general conjunctive use guidelines, as described below.

1. The groundwater supply should be able to provide enough maximum day supply in dry years to mitigate the reductions in surface water supply that could occur. The guideline is to be able to provide enough groundwater supply assuming a surface water supply that is reduced during the day of maximum demand in dry years by up to approximately 50 percent of its maximum day use in wet/average years.
2. The surface water supply should be able to supply a significant portion of the maximum day demand in a wet/average year while only using a portion of the groundwater supply capacity. The guideline is to provide enough surface water supply capacity to be able to supply approximately 50 percent or more of the maximum day demand.

6.2 Capital Improvement Plan

The CIP is developed based upon the water facilities identified in Section 6.1. The CIP is presented in three phases as follows:

- Phase 1. 2015 to 2025
- Phase 2. 2026 to 2035
- Phase 3. 2036 to buildout. The estimated buildout year varies dependent upon the Baseline, NewBridge, or Cumulative scenarios.

The CIP projects are categorized as surface water projects, groundwater projects, pipeline projects, and storage projects. Each of the planned facilities for each scenario is identified by a CIP project identification number. Groundwater treatment projects are identified as GWTP followed by a number. Groundwater well projects are identified as GW. Surface water projects are identified as SW, storage projects as S, and pipeline projects as P.

The projects presented in the CIP are limited to projects that expand the water supply capacity and the conveyance of water supplies to future customers. Not included in the CIP are the following types of projects and items:

- Projects that rehabilitate or replace existing water system facilities.
- Projects that correct existing system deficiencies, such as areas of inadequate pressure or fire flow.
- Land acquisition.
- Projects that provide for groundwater treatment for constituents other than iron and manganese. For example, projects needed to treat constituents that are found to a limited extent in the Central Basin such as Chromium VI, Arsenic, and Radon are not included.
- Projects that would plan and implement aquifer storage and recovery (ASR).
- Projects that would plan and implement an expanded recycled water supply beyond the project RW-1. For example, not included are projects that consist of indirect potable reuse (IPR) or direct potable reuse (DPR) of treated wastewater.
- Special fees or payments.
- Water system connection fees, such as for future interties with other water agencies.

6.3 Basis of Cost Estimates

The cost estimates represent conceptual estimates of the capital costs to construct the water system facilities. Costs should be refined from this conceptual phase as the projects are better defined and proceed into the pre-design and design phases. The cost estimates represent 2014 dollars. Capital cost estimate tables are presented for most of the CIP projects in Appendix E with several exceptions. SCWA provided the cost estimates for the Phase A NSA Project and Phase B NSA Project (P-10 and S-1). The Vineyard SWTP expansion project (SW-1) and recycled water project (RW-1) do not have individual cost estimate tables developed.

Capital costs represent the construction and other costs necessary to get a project completed. Construction costs cover the material, labor, and services necessary to build the identified project. Changes during the design of the project, in the cost of materials, labor, and equipment, and in the bidding environment will cause changes in the estimated cost.

The contingency cost item addresses the uncertainties that are associated with the preliminary sizing of projects. Factors such as unexpected construction conditions, the need for unforeseen construction items, and variations in quantities are some of the items that can increase project cost. An allowance of 25 percent of the construction cost is included to cover such contingencies for the groundwater, surface water, and storage projects.

The engineering, administrative, and legal cost item covers engineering services and items such as legal fees, administrative costs that are typically associated with a project. It is estimated that these costs would be 25 percent of the total of the construction cost plus contingency.

The environmental and permitting cost item is intended to cover services necessary to meet the requirements of the California Environmental Quality Act and services and fees associated with obtaining the necessary permits that would be required. It is estimated that these costs would be 10 percent of the total of the construction cost plus contingency.

The cost estimates for the Phase 1 pipeline projects, which are developer projects, are developed with a different approach. The cost estimates for the developer projects represent the amount that SCWA would pay a developer for a project and do not necessarily represent the total cost of a project. The cost estimates for the pipeline projects are based on the unit costs presented in Schedule C that was issued by SCWA on April 9, 2014. The pipeline projects are characterized as being either in undeveloped areas or under existing pavement to utilize the appropriate Schedule C unit pipeline cost. The Schedule C unit costs are values that have been escalated from unit costs that were developed in 2007 for the development of the Ordinance 18 Schedule C Unit Prices for Zone 40 Credits. The cost estimates for the developer projects include 15

percent for contingency, 8 percent for engineering, and 10 percent for the Construction Management and Inspection Division (CMID).

It is assumed that all future groundwater supply facilities would require groundwater treatment for iron and manganese. The groundwater treatment plant projects each include wells, pipelines from the wells to the treatment plant, treatment facility, storage reservoir, pumping station, and pipeline conveyance to the water distribution system. It is assumed that treatment facilities will not be required for the existing direct feed wells.

The cost for the expansion of the Vineyard SWTP (SW-1) is based on a unit cost of \$4 million per mgd capacity. The cost estimate for the recycled water project (RW-1) is assumed to be \$20 million, but no recycled water facility project description has been developed for this study. As a comparison, the 2005 WSMP estimated the cost of the recycled water facilities to be \$15 million and the 2006 WSIP presented a cost of \$11.6 million.

Section 7

Baseline

This section describes the demographics, water demands, water supplies, and needed water system improvements for the existing approved Zone 40 through buildout, which is known as the Baseline scenario.

7.1 Water Demands


This section describes the future land use, demographics, and demand projections for the Baseline scenario.

7.1.1 Buildout Demographics

The 2010 and buildout developed land use acreages by land use category are summarized in Table 7-1. The acreages presented in Table 7-1 are net acres for 2010 and gross acres for the study area at buildout. The buildout land use for the study area is illustrated on Figure 7-1.

Table 7-1. 2010 and Buildout Area by Land Use - Baseline		
Land use category	2010 developed area, net acres	Fully developed (buildout) area, acres
Rural estate	1,380	6,610
Single family	6,970	16,640
Multi-family - low density	220	3,480
Multi-family - high density	390	1,150
Commercial	1,520	3,760
Industrial	1,110	3,450
Industrial-unutilized	340	580
Public	920	2,110
Public recreation	1,270	4,260
Mixed land use	20	190
Right-of-way	70	230
Subtotal, municipal water supply land area	14,210	42,460
Self-supported/supplied by others	-	3,900
Non-irrigated	500	8,290
Agricultural	-	14,760
Total	14,710	69,410

Note: Elk Grove wholesale area is not included in the 2010 developed area acreage because the 2010 developed area acreage was not available. It is included in the buildout acreage.

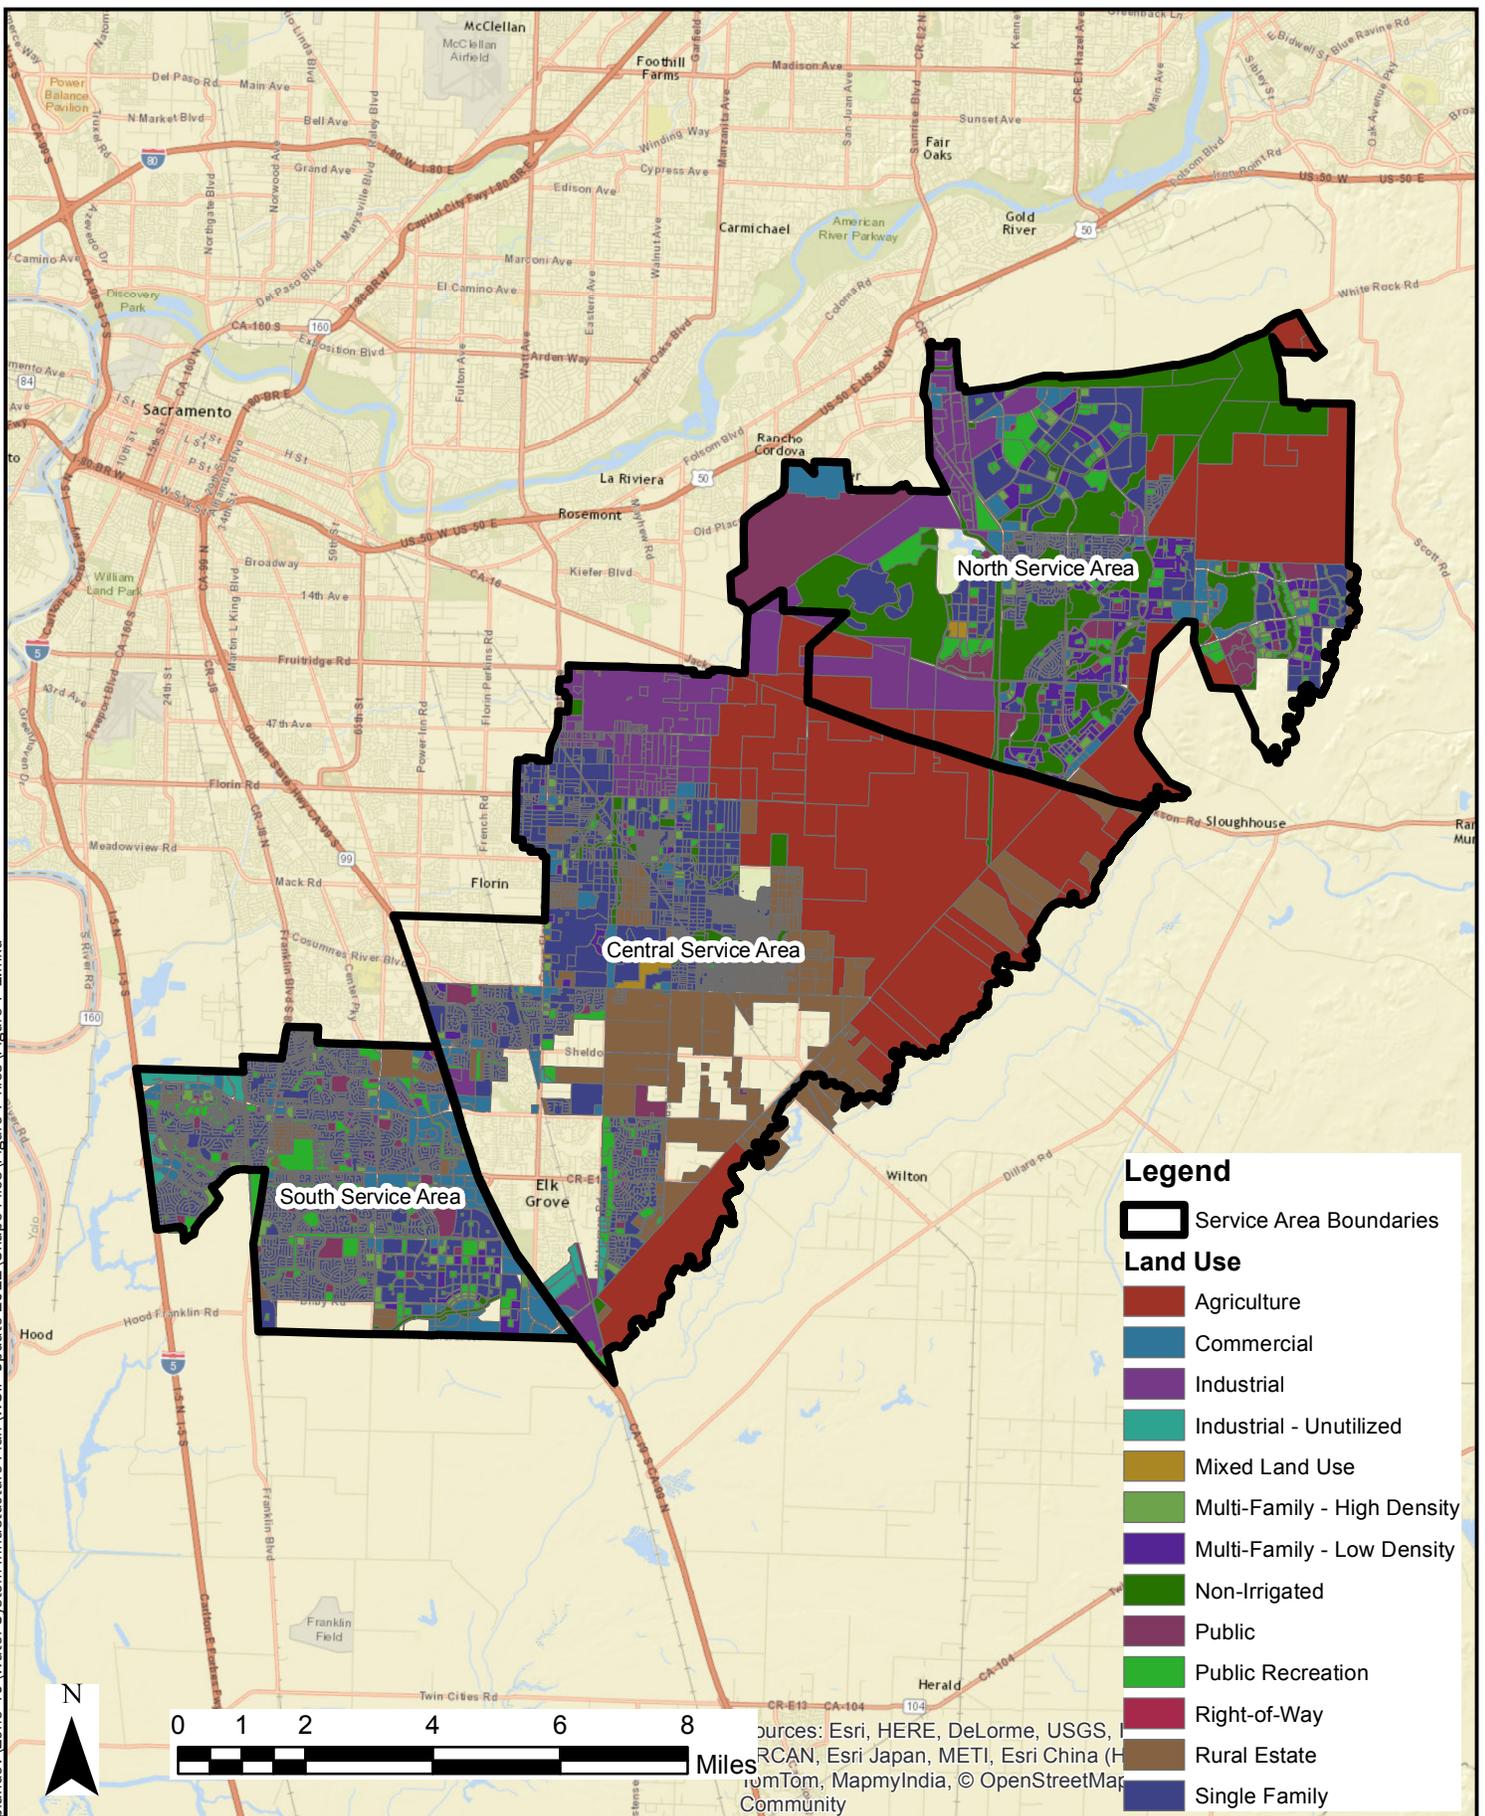


DATE 07/23/15	PROJECT 148130	SITE
		TITLE

Zone 40 Water Supply Master Plan Amendment

Buildout Land Use - Baseline

Figure 7-1

The historical and projected population in Zone 40 is shown on Figure 7-2. The projected DUs, population, and connections at buildout by land use category are presented in Table 7-2. Population per DU and per connection, DUs per connection, and connections per acre by land use category are also shown in this table. The number of people per connection projected at buildout is significantly higher than the 2010 value because of the proportionally large increase in multi-family land use area compared to single family land use area from 2010 to buildout. A larger proportion of the residential dwelling units and connections will be multifamily at buildout compared to 2010, which will result in a higher number of people per connection.

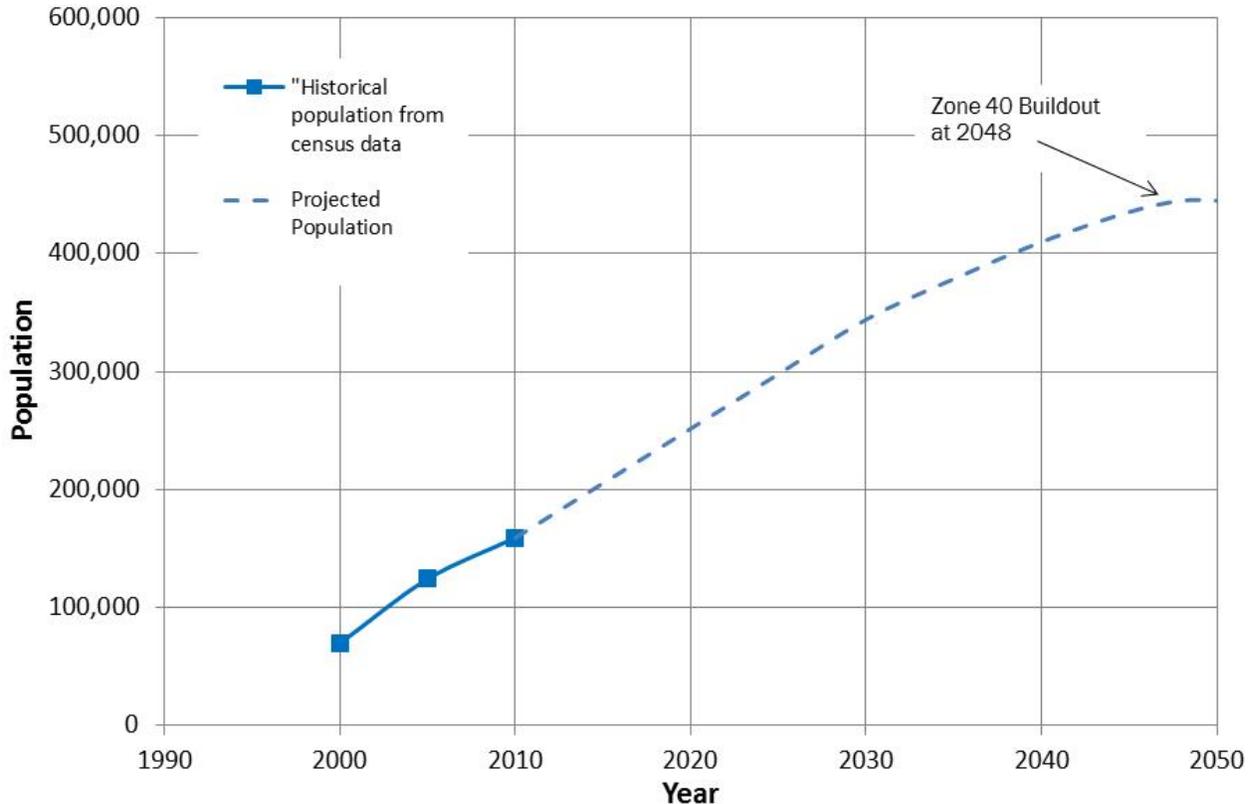

Elk Grove wholesale population is included. 2010 Elk Grove wholesale population is estimated to equal 10,144 people based on 3,210 Elk Grove wholesale connections and 3.16 people per connection in 2010.

Figure 7-2. Historical and Projected Population in Zone 40 - Baseline

Table 7-2. Buildout Dwelling Units, Population, and Connections by Land Use Category - Baseline

Land use category	Dwelling units	Population	Connections	Population/ dwelling unit	Population/ connection	Dwelling units/ connection	Connections/ acre
Rural estate	3,193	10,648	3,193	3.3	3.3	1	0.5
Single family	80,463	265,599	80,463	3.3	3.3	1	4.8
Multi-family - low density	38,733	106,565	3,893	2.8	27.4	10	1.1
Multi-family - high density	24,323	62,089	1,575	2.6	39.4	15	1.4
Commercial	-	-	1,645				0.4
Industrial	-	-	1,391				0.4
Industrial-unutilized	-	-	-				-
Public	-	-	198				0.1
Public recreation	-	-	3,581				0.8
Mixed land use	-	-	35				0.2
Right-of-way	-	-	380				1.7
Self-supported/ supplied by others	-	-	-	-	-	-	-
Non-irrigated	-	-	-	-	-	-	-
Agricultural	-	-	-	-	-	-	-
Total	146,700^(a)	444,900^(a)	96,300^(a)	3.0	4.6	1.5	1.8

^(a) Totals are rounded to the 100's place.

The 2010 and projected buildout DUs, population, and connections by service area are shown in Table 7-3. The projected buildout number of DUs and population for the NSA, CSA, and SSA are very similar; however the numbers of connections in the NSA are significantly less than the CSA and SSA. This is because there is a greater number of multi-family DUs in the NSA than the CSA and SSA. Since there are several multi-family dwelling units per connection, a lower number of connections is projected in the NSA to serve the similar number of dwelling units. Table 7-4 shows the projected number of connections by service area in five-year increments through 2050 and at buildout. The projected number of connections through buildout for each of the growth scenarios is illustrated on Figure 7-3.

Table 7-3. 2010 and Buildout Dwelling Units, Population, and Connections by Service Area - Baseline

Service area	2010			Buildout		
	Dwelling units	Population	Connections	Dwelling units	Population	Connections
NSA	4,000	11,700	4,600	46,000	135,800	25,400
CSA	17,400	56,600	15,600	49,400	150,700	32,800
SSA	30,600	91,300	28,900	51,300	158,400	38,100
Total	52,000	159,600	49,100	146,700	444,900	96,300

Note: 2010 dwelling units, population, and connections in Elk Grove wholesale area are estimated and included in the CSA values. Elk Grove wholesale area service connections in 2010 are estimated to be 3,200 connections and the DUs are estimated to be 3,500 based on a 1.1 DU per connection factor. The population is estimated to equal 10,144 people.

Table 7-4. Projected Connections in 5-Year Increments - Baseline

Service area	2010	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2048)
NSA	4,600	5,600	7,500	10,000	12,500	16,100	19,800	23,600	25,400	25,400
CSA	15,600	16,600	18,400	20,900	23,400	27,000	30,800	32,900	32,900	32,800
SSA	28,900	30,300	32,800	35,300	37,800	38,100	38,100	38,100	38,100	38,100
Total Zone 40	49,100	52,500	58,700	66,200	73,700	81,200	88,700	94,600	96,400	96,300

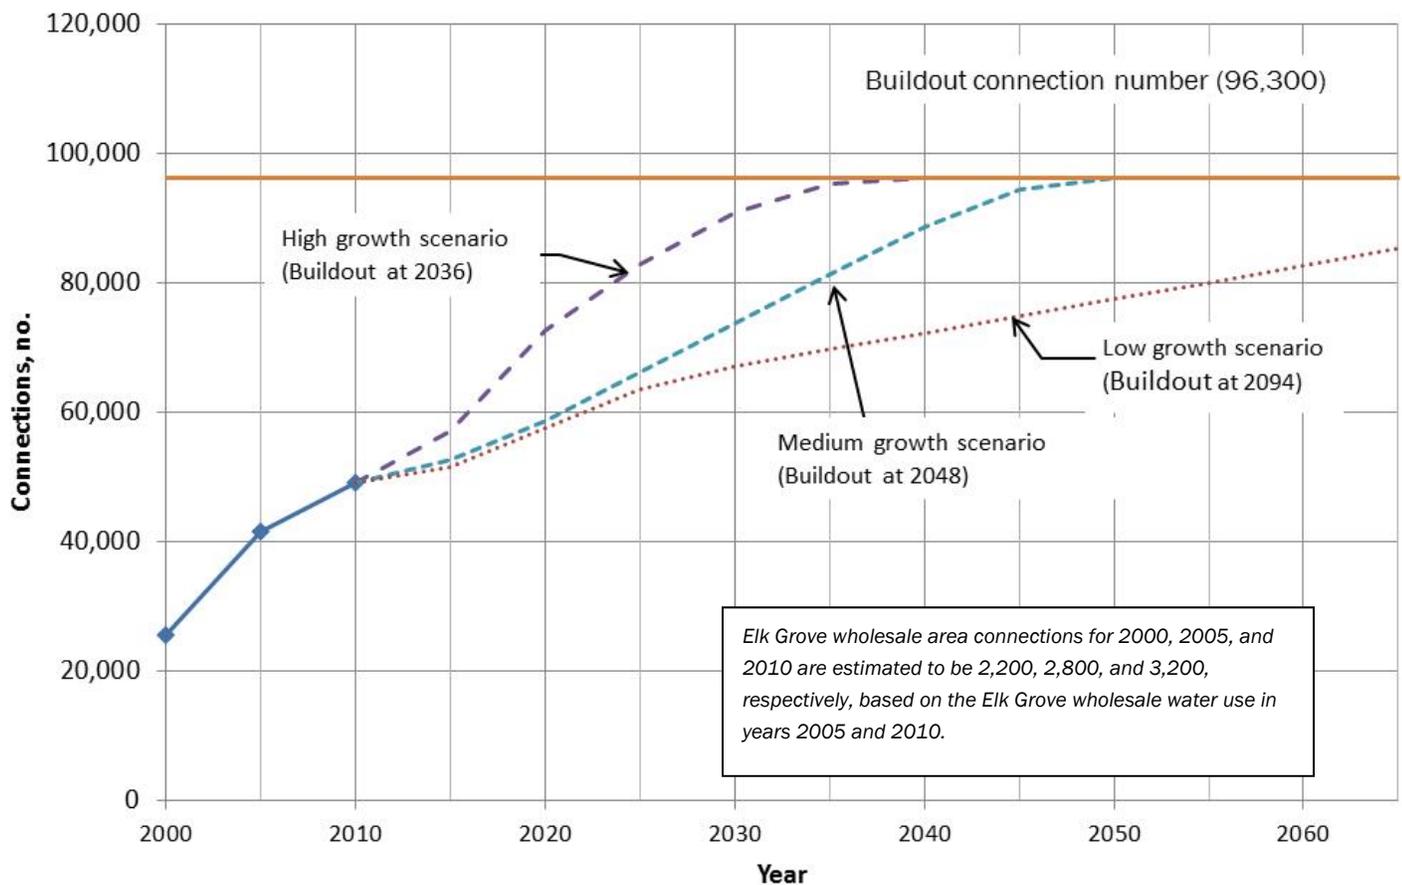


Figure 7-3. Historical and Projected Zone 40 Connections at High, Medium, and Low Growth Rates – Baseline

7.1.2 Buildout Water Demands

This section presents the buildout water demand by service area for the Baseline scenario. Based on the buildout land area in Table 7-1 and the unit water demand factors in Table 3-4, the buildout water demand by land use category is shown in Table 7-5 for the Baseline scenario. The recycled water demand in the SSA is included in the demand projections in Table 7-5 to provide the total Zone 40 water demand for this scenario.

Table 7-5. Buildout Water Demand by Land Use Category - Baseline

Land use category	Water demand, ac-ft/yr
Rural estate	9,100
Single family	35,500
Multi-family - low density	8,500
Multi-family - high density	3,800
Commercial	7,600
Industrial	7,000
Public	1,700
Public recreation	11,900
Mixed land use	400
Right-of-way	0
Subtotal (land use with water demand)	85,500
Water system losses (7.5% of water sales)	6,400
Self-supplied/supported by others	0
Industrial-unutilized	0
Non-irrigated	0
Agricultural	0
Total production	91,900

7.1.3 Water Demand Growth Projection

Water demand growth projections are determined based on the projected connection growth described in Section 3. The projected water demands by service area are shown in Table 7-6 and illustrated on Figure 7-4.

Table 7-6. Projected Water Demand in 5-Year Increments, ac-ft/yr - Baseline

Service area	2013	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2048)
NSA	4,200	5,300	7,400	10,300	13,500	18,100	23,200	28,600	31,400	31,400
CSA	15,100	16,300	18,400	21,100	23,900	27,800	32,100	34,400	34,400	34,400
SSA	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100
Total	34,500	38,700	45,500	54,000	63,000	72,000	81,400	89,100	91,900	91,900

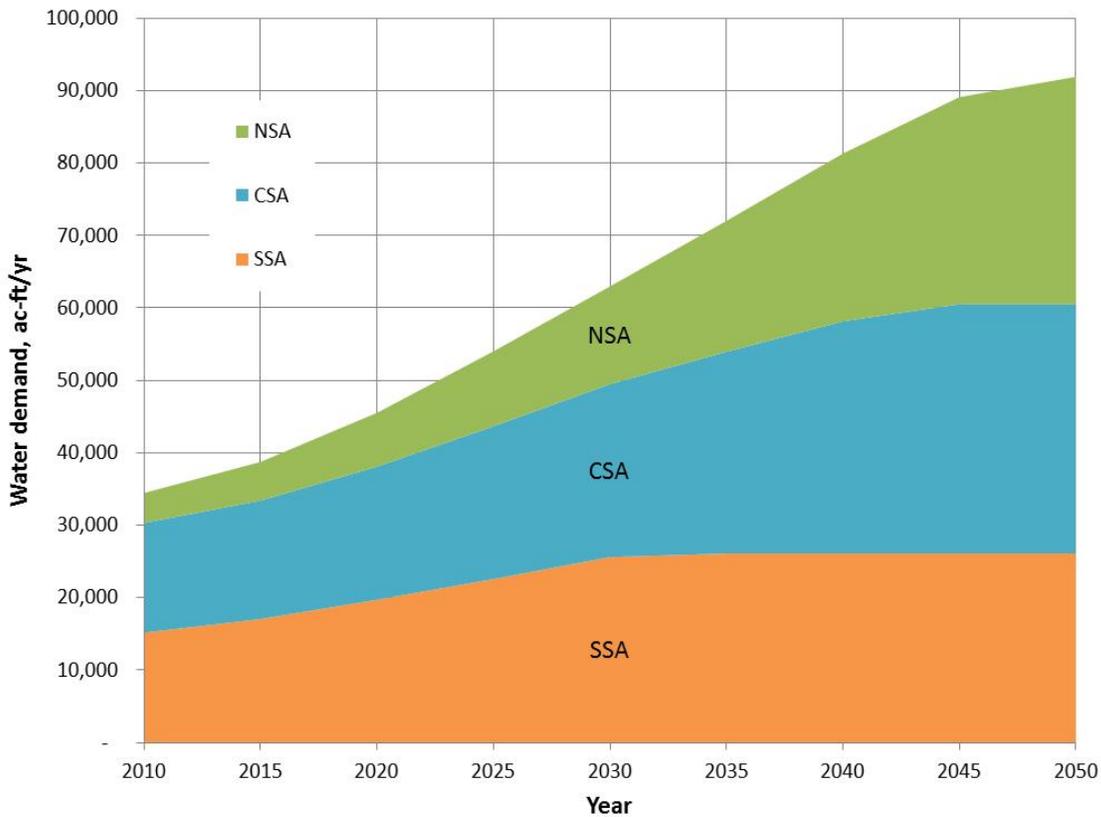


Figure 7-4. Water Demand Projection – Baseline

7.2 Water Supply Capacity

This section quantifies the amount of supply capacity that would be needed to meet demands through buildout. The supply capacity and the use of the supply is presented on both a maximum day basis and an annual basis

7.2.1 Maximum Day Demand Supply Capacity and Use

The maximum day demand to supply capacity comparison tables for each of the three service areas are presented in Appendix B. The future supply capacity is based on the proposed supply and conveyance facilities that are presented in Section 7.3. The maximum day use of each type of supply is quantified for the wet/average years and dry years.

7.2.1.1 North Service Area

Surface water supply from the existing Vineyard SWTP would be provided in Phase 1 to replace the current groundwater supply provided by the Anatolia GWTP. The construction of the Phase A NSA Project (P-10) and Phase B NSA Project (S-1) will allow for some of the Vineyard SWTP’s existing capacity to be used to supply the NSA. It is assumed that 65 percent of the Vineyard SWTP would be used to supply the NSA. The Mather wells are used below their capacities in dry years since SCWA operational staff prefer to minimize their use due to the possible impact to nearby contamination plumes.

7.2.1.2 Central Service Area

Once several projects are constructed, including the Phase A NSA Project (P-10) and Phase B NSA Project (S-1), some of the Vineyard SWTP's existing capacity will be used to also supply the NSA. The future West Jackson GWTP will be used to supply the CSA, although it will be connected to the transmission system such that it could also provide supply to the NSA.

7.2.1.3 South Service Area

New groundwater supply capacity would be needed during Phase 1. Additional groundwater supply capacity would be added in Phases 2 and 3. No new surface water supply capacity is specifically planned for the SSA, although the planned Phase 3 expansion of the Vineyard SWTP would provide some additional surface water. The proposed GWTPs for Phase 3 would provide a maximum day groundwater supply capacity that exceeds the SSA's projected buildout maximum day demand. These Phase 3 GWTPs could be used to provide dry year groundwater supply to other areas or groundwater storage, or function as additional backup facilities.

7.2.1.4 Zone 40 Summary

Table 7-7 presents the maximum day demand and supply capacity comparison for Zone 40 from 2013 through buildout. The maximum day use of each type of supply is quantified for the wet/average years and dry years. As can be seen in Table 7-7 and consistent with the established conjunctive use program, the total supply capacity exceeds the maximum day demand for each phase, but neither the groundwater nor surface water supply capacity alone can meet the maximum day demand.

As shown in Table 7-7, Zone 40 will utilize a varying mixture of groundwater and surface water supplies on the maximum demand day based on whether it is a wet/average year or a dry year. The ability to practice conjunctive use by maximizing the use of surface water in wet and average years and minimizing the use of surface water in dry years is limited by the available surface water and groundwater supply capacities and to some extent by distribution system constraints. Several observations are made regarding the maximum day supply capacity and use that pertains to all three phases:

1. In dry years, there is sufficient groundwater capacity to be able to significantly reduce the amount of surface water use on the maximum day compared to wet/average years.
2. In dry years, most of the groundwater capacity will be utilized on the maximum demand day.
3. In wet years, there is sufficient surface water capacity to be able to supply over half of the maximum day demand.
4. In wet years, up to half of the groundwater capacity will be used to help supply the maximum day demand.

Table 7-7. Maximum Day Demand to Supply Comparison for Zone 40 - Baseline, mgd

Zone 40	2013	Phase 1			Phase 2		Phase 3			Buildout (2048)
		2015	2020	2025	2030	2035	2040	2045	2050	
Maximum day demand										
Zone 40 total	61.5	69.1	81.3	96.5	112.5	128.6	145.2	159.1	164.1	164.1
Existing supply capacity										
Groundwater	72.5	72.5	66.0	66.0	66.0	66.0	66.0	66.0	66.0	66.0
Surface water	61.1	61.1	45.1	28.6	28.6	28.6	28.6	28.6	28.6	28.6
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
Total	136.6	136.6	114.1	97.6	97.6	97.6	97.6	97.6	97.6	97.6
Planned future supply capacity										
Groundwater	0.0	0.0	0.0	6.5	15.5	33.0	33.0	33.0	53.0	66.0
Surface water	0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	82.5	101.6
Recycled water							0.0	0.0	2.9	2.9
Total supply capacity										
Groundwater	72.5	72.5	66.0	72.5	81.5	99.0	99.0	99.0	119.0	132.0
Surface water	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	111.1	130.2
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	136.6	136.6	130.1	136.6	145.6	163.1	163.1	163.1	236.0	268.1
Use of supply: average/wet years										
Groundwater	20.4	25.8	21.1	46.4	56.8	64.7	72.2	76.5	56.1	37.0
Surface water	38.1	40.3	57.2	47.1	52.7	60.9	70.0	79.6	102.2	121.3
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	61.5	69.1	81.3	96.5	112.5	128.6	145.2	159.1	164.1	164.1
Use of supply: dry years										
Groundwater	58.5	64.3	60.4	68.5	76.7	92.3	95.0	95.0	104.3	104.3
Surface water	0.0	1.9	17.9	25.0	32.7	33.3	47.2	61.1	54.0	54.0
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	61.5	69.1	81.3	96.5	112.5	128.6	145.2	159.1	164.1	164.1

7.2.2 Annual Water Supply

Table 7-8 presents the annual supply to demand comparison for a normal climate year. Table 7-9 presents the annual supply to demand comparison for a single dry year and Table 7-10 presents the comparison for a multiple dry year. The presented supply values are the supplies available to Zone 40 assuming there are no

facility supply capacity constraints. The facility improvements needed to expand existing supply capacity are presented in Section 7.3. Projections of the use of each supply source that consider supply facility capacity constraints for each service area for normal and dry years are presented in Appendix B.

Table 7-8. Supply and Demand Comparison-Normal Year - Baseline, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2048)
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
Appropriative water ^(a)	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	146,800	140,000	131,500	122,500	113,500	104,200	96,400	95,200	95,200

^(a) Only 35,000 ac-ft/yr assumed to be available without the construction of seasonal storage, as described in Section 4.2.2.

Table 7-9. Supply and Demand Comparison-Single Dry Year - Baseline, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2048)
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply allocation	11,300	16,000	13,200	14,800	17,100	19,600	22,300	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	101,500	106,200	103,400	105,000	107,300	109,800	112,500	114,300	114,300
Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	62,800	60,700	49,400	42,000	35,300	28,500	23,400	22,400	22,400

Table 7-10. Supply and Demand Comparison-Multiple Dry Years - Baseline, ac-ft/yr

Year		2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2048)
First year	Supplies									
	US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
	Appropriative water ^(a)	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
	City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
	Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	146,800	140,000	131,500	122,500	113,500	104,200	96,400	95,200	95,200	
Second year	Supplies									
	US Bureau of Reclamation-CVP supply	17,000	24,000	19,800	22,100	25,600	29,400	33,500	33,800	33,800
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	107,200	114,200	110,000	112,300	115,800	119,600	123,700	125,600	125,600
	Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	68,500	68,700	56,000	49,300	43,800	38,300	34,600	33,700	33,700	
Third year	Supplies									
	US Bureau of Reclamation-CVP supply	11,300	16,000	13,200	14,800	17,100	19,600	22,300	22,500	22,500
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	101,500	106,200	103,400	105,000	107,300	109,800	112,500	114,300	114,300
	Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	62,800	60,700	49,400	42,000	35,300	28,500	23,400	22,400	22,400	

^(a) Only 35,000 ac-ft/yr assumed to be available without the construction of seasonal storage, as described in Section 4.2.2.

As can be seen in Tables 7-8, 7-9, and 7-10, as well as in Appendix B, the total water supply is greater than the projected demands. This analysis verifies the sufficiency of the water supply for the Baseline scenario.

7.2.3 Storage and Pumping Station Capacity Evaluation

Table 7-11 and 7-12 presents a summary comparison of the planned to required storage volume and pumping station capacities for this scenario. As shown in Tables 7-11 and 7-12, the planned storage facilities provide more than the required storage volumes and pump station capacities. The detailed storage and pumping station evaluation tables for each pressure zone are presented in Appendix B.

Table 7-11. Zone 40 Storage Capacity Evaluation Summary - Baseline				
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2048)
Provided storage volume, MG				
Existing	42.2	42.2	42.2	42.2
Future	0.0	13.5	17.5	36.0
Total	42.2	55.7	59.7	78.2
Required storage volume, MG				
Equalization	12.3	19.0	25.2	31.7
Fire	3.8	3.8	3.8	3.8
Emergency	10.3	15.8	21.0	26.4
Total	26.4	38.6	50.1	61.8
Difference (provided minus required)	15.8	17.1	9.6	16.3

Table 7-12. Zone 40 Pump Station Capacity Evaluation Summary - Baseline				
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2048)
Provided pump station capacity from storage, mgd				
Existing	107.6	118.2	112.3	103.4
Future	0.0	20.5	32.6	88.1
Total	107.6	138.7	144.9	191.5
Required pump station capacity from storage, mgd				
	65.8	96.6	126.2	158.3
Difference (provided minus required)	41.8	42.1	18.7	33.2

7.3 Water System Facilities and Capital Improvement Program

This section describes the water system facilities needed to supply the Baseline scenario and presents the CIP for Phases 1, 2, and 3.

7.3.1 Needed Water System Facilities

The water system facilities needed to serve the Baseline scenario through buildout are defined in this section.

7.3.1.1 Phase 1 (2016 to 2025)

The water system facilities needed to serve the Phase 1 demands are described for the NSA, CSA, and SSA.


North Service Area

As water demand continues to grow in the NSA, new water supply capacity will be needed to keep up with the demand growth. Two immediate options are available: 1) drill new wells at the Excelsior well field and expand the Anatolia GWTP; 2) construct the Phase A NSA Pipeline to deliver treated water from the Vineyard SWTP to the NSA. The Phase A NSA Pipeline involves converting the existing Excelsior raw water pipeline to convey treated water, in addition to other system modifications.

The Phase A NSA Pipeline option (P-10) was selected by SCWA in order to increase the surface water use in Zone 40 as part of the conjunctive use program. The existing Vineyard SWTP has additional capacity beyond what is needed to supply the CSA's current maximum day demand. The project includes the construction of the segment of the NSA Pipeline (66-inch in diameter) from the Vineyard SWTP to connect to the converted Excelsior raw water pipeline. The treatment unit at the Anatolia GWTP will be disconnected. The Anatolia storage tank will become a terminal storage tank to receive treated water from the Vineyard SWTP via the Phase A NSA Pipeline. The pump station capacity at the Anatolia facility would be expanded as part of P-10 to be able to provide peak hour supply with the supply provided by the Vineyard SWTP. The three existing groundwater wells at the Excelsior Well Field will be put on hiatus and occasionally used to provide groundwater for blending. In the future, the Excelsior well field will pump groundwater to the future West Jackson GWTP (CSA) for treatment located near the Excelsior well field. Once the Phase A NSA Project is completed, surface water can be delivered to the NSA from the Vineyard SWTP up to 11,000 gpm (or 15.8 MGD), which is enough to supply surface water to the NSA for several years until demand grows beyond the capacity of the pipeline.

Once the demand for surface water in the NSA exceeds the capacity of the 30-inch Excelsior pipeline, a new pipeline would be constructed. This new pipeline would be part of the Phase B NSA Project (S-1), which would also include the NSA terminal storage and pumping facility. The Phase B NSA Project (S-1) would provide for conveyance of surface water supply from the Vineyard SWTP to the NSA terminal storage and pumping facility from which the surface water supply would be distributed to the NSA, including peak hour and fire flow needs. The Phase B NSA Pipeline (54-inch in diameter) starts from Florin Road at Excelsior Road, extending east on Florin Road and then turning north in Eagles Nest Road, Kiefer Road, and the west bank of Folsom South Canal, and ultimately ending at the NSA terminal tanks (10 MG) located in Mather South. There may be approaches to optimize the Phase B NSA Project (S-1) by not having all of the Vineyard SWTP surface water supply conveyed to the NSA terminal storage and pumping facility. For example, additional storage facilities could be located in the southern portions of the NSA to be supplied off of either the Phase A or B NSA Project pipelines that would provide the maximum day as well as the peak hour and fire flow supplies for their local areas instead of having to deliver it all from the NSA terminal storage and pumping facility.

During Phase 1, several other pipeline projects would be constructed to deliver water to several areas within the NSA that are likely to experience growth, including the Cordova Hills, Rio del Oro, and Mather South subareas, as well as subareas located in the Sunrise/Douglas region. The locations of the Phase 1 projects in the NSA are shown on Figure 7-5.

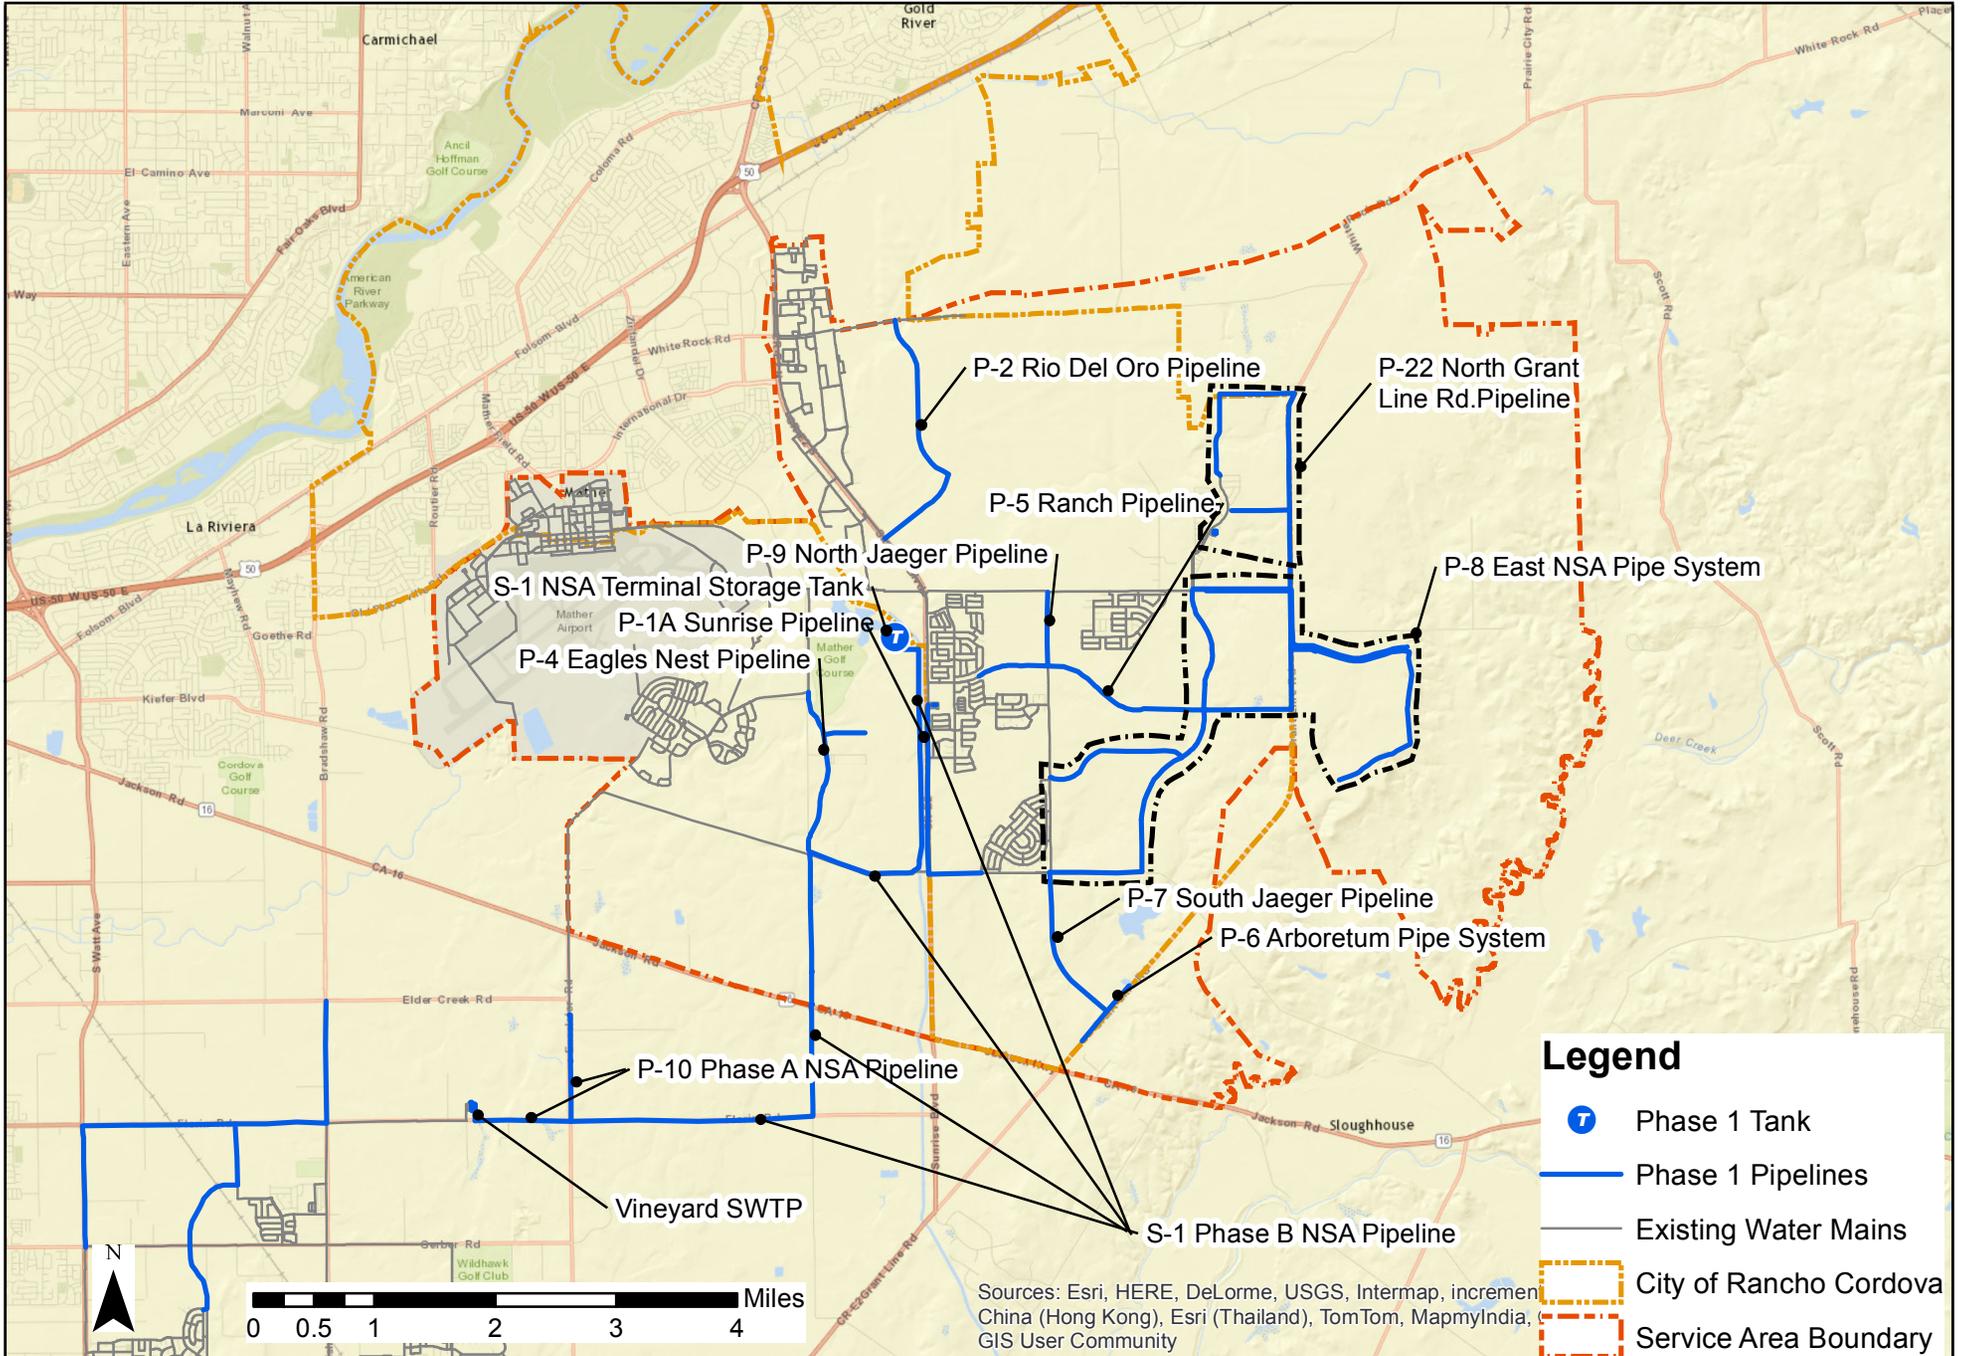

Legend

- Phase 1 Tank
- Phase 1 Pipelines
- Existing Water Mains
- City of Rancho Cordova
- Service Area Boundary



PROJECT	143542	SITE
DATE	8/4/15	TITLE

Water Supply Master Plan Amendment
Phase 1 CIP Projects - NSA, Baseline

Figure 7-5

Central Service Area

During Phase 1, several pipeline projects would be constructed in the CSA to improve the interconnectedness and looping of the transmission system. No new storage facilities are planned for the CSA in Phase 1. The locations of the Phase 1 projects in the CSA are shown on Figure 7-6.

South Service Area

New groundwater supply facilities will be needed once the max day demand for the SSA reaches the existing groundwater and recycled water capacity. The water supply and storage in the SSA would be increased with the expansion of the Poppy Ridge GWTP (GWTP-1). Several pipeline projects would be constructed to deliver water to the Southeast Policy area and improve interconnectivity. The locations of the Phase 1 projects in the SSA are shown on Figure 7-6.

7.3.1.2 Phase 2 (2026 to 2035)

The water system facilities needed to serve the Phase 2 demands are described for the NSA, CSA, and SSA. The timing for the Phases 2 and 3 pipelines cannot be accurately defined into either Phase 2 or 3 due to the uncertainty about the specific locations and timing of development. Therefore, the pipeline projects for Phases 2 and 3 are not specifically identified by project number.

North Service Area

Additional pipelines would be constructed within the NSA to supply increased demand in the NSA. The locations of the Phase 2 projects in the NSA are shown on Figure 7-7.

Central Service Area

The next water supply facility in the CSA would be the 18 mgd West Jackson GWTP (GWTP-2) that would use the Excelsior well field as its source of groundwater supply. The West Jackson GWTP would be located in the northern part of the CSA. The Excelsior well field would be reactivated to supply the West Jackson GWTP with some additional wells added as part of the GWTP-2 project.

Additional pipelines would be constructed within the CSA to supply increased demand in the CSA. The locations of the Phase 2 projects in the CSA are shown on Figure 7-8.

South Service Area

The Big Horn GWTP Expansion (GWTP-7) would be constructed in the SSA in Phase 2. Additional pipelines would be constructed within the SSA. The locations of the Phase 2 projects in the SSA are shown on Figure 7-8.


7.3.1.3 Phase 3 (2036 to Buildout)

The water system facilities needed to serve Phase 3 demands are described for the NSA, CSA, and SSA.

North Service Area

In Phase 3, the Vineyard WTP would be expanded to 100 mgd from its present capacity of 50 mgd (SW-1). This added surface water supply capacity would be used to supply both the NSA and the CSA, with some supply for the SSA.

Additional storage facilities would be constructed in the NSA in Phase 3 consisting two storage facilities (S-3 and S-4). Additional pipelines would be constructed within the NSA to supply increased demands. The locations of the Phase 3 projects in the NSA are shown on Figure 7-7.

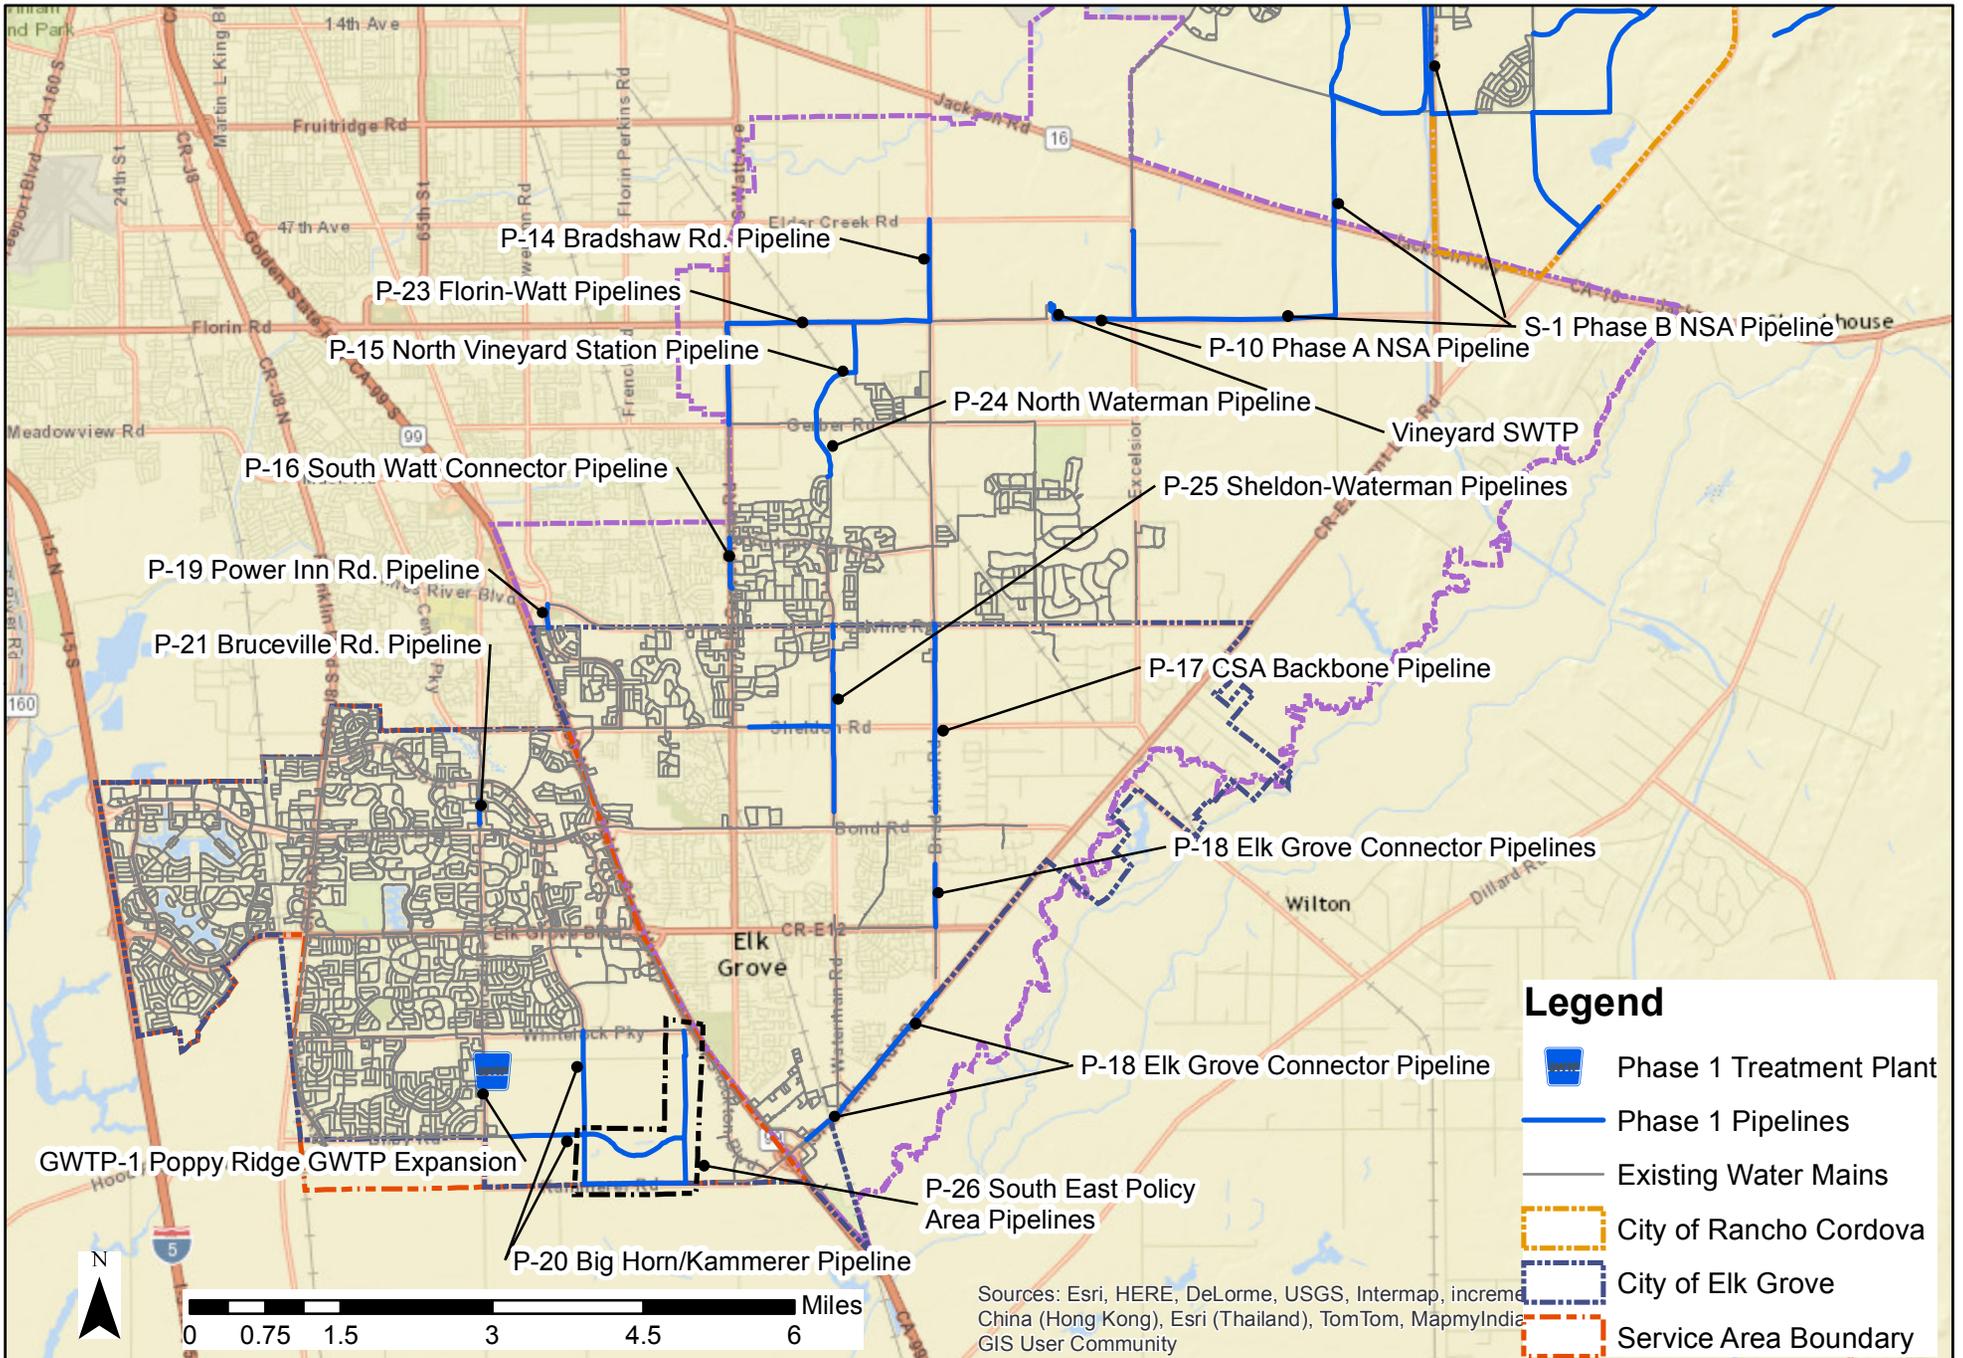

Legend

-  Phase 1 Treatment Plant
-  Phase 1 Pipelines
-  Existing Water Mains
-  City of Rancho Cordova
-  City of Elk Grove
-  Service Area Boundary



PROJECT
143542


DATE
8/4/15

SITE

TITLE


Water Supply Master Plan Amendment
Phase 1 CIP Projects - CSA & SSA, Baseline

Figure 7-6

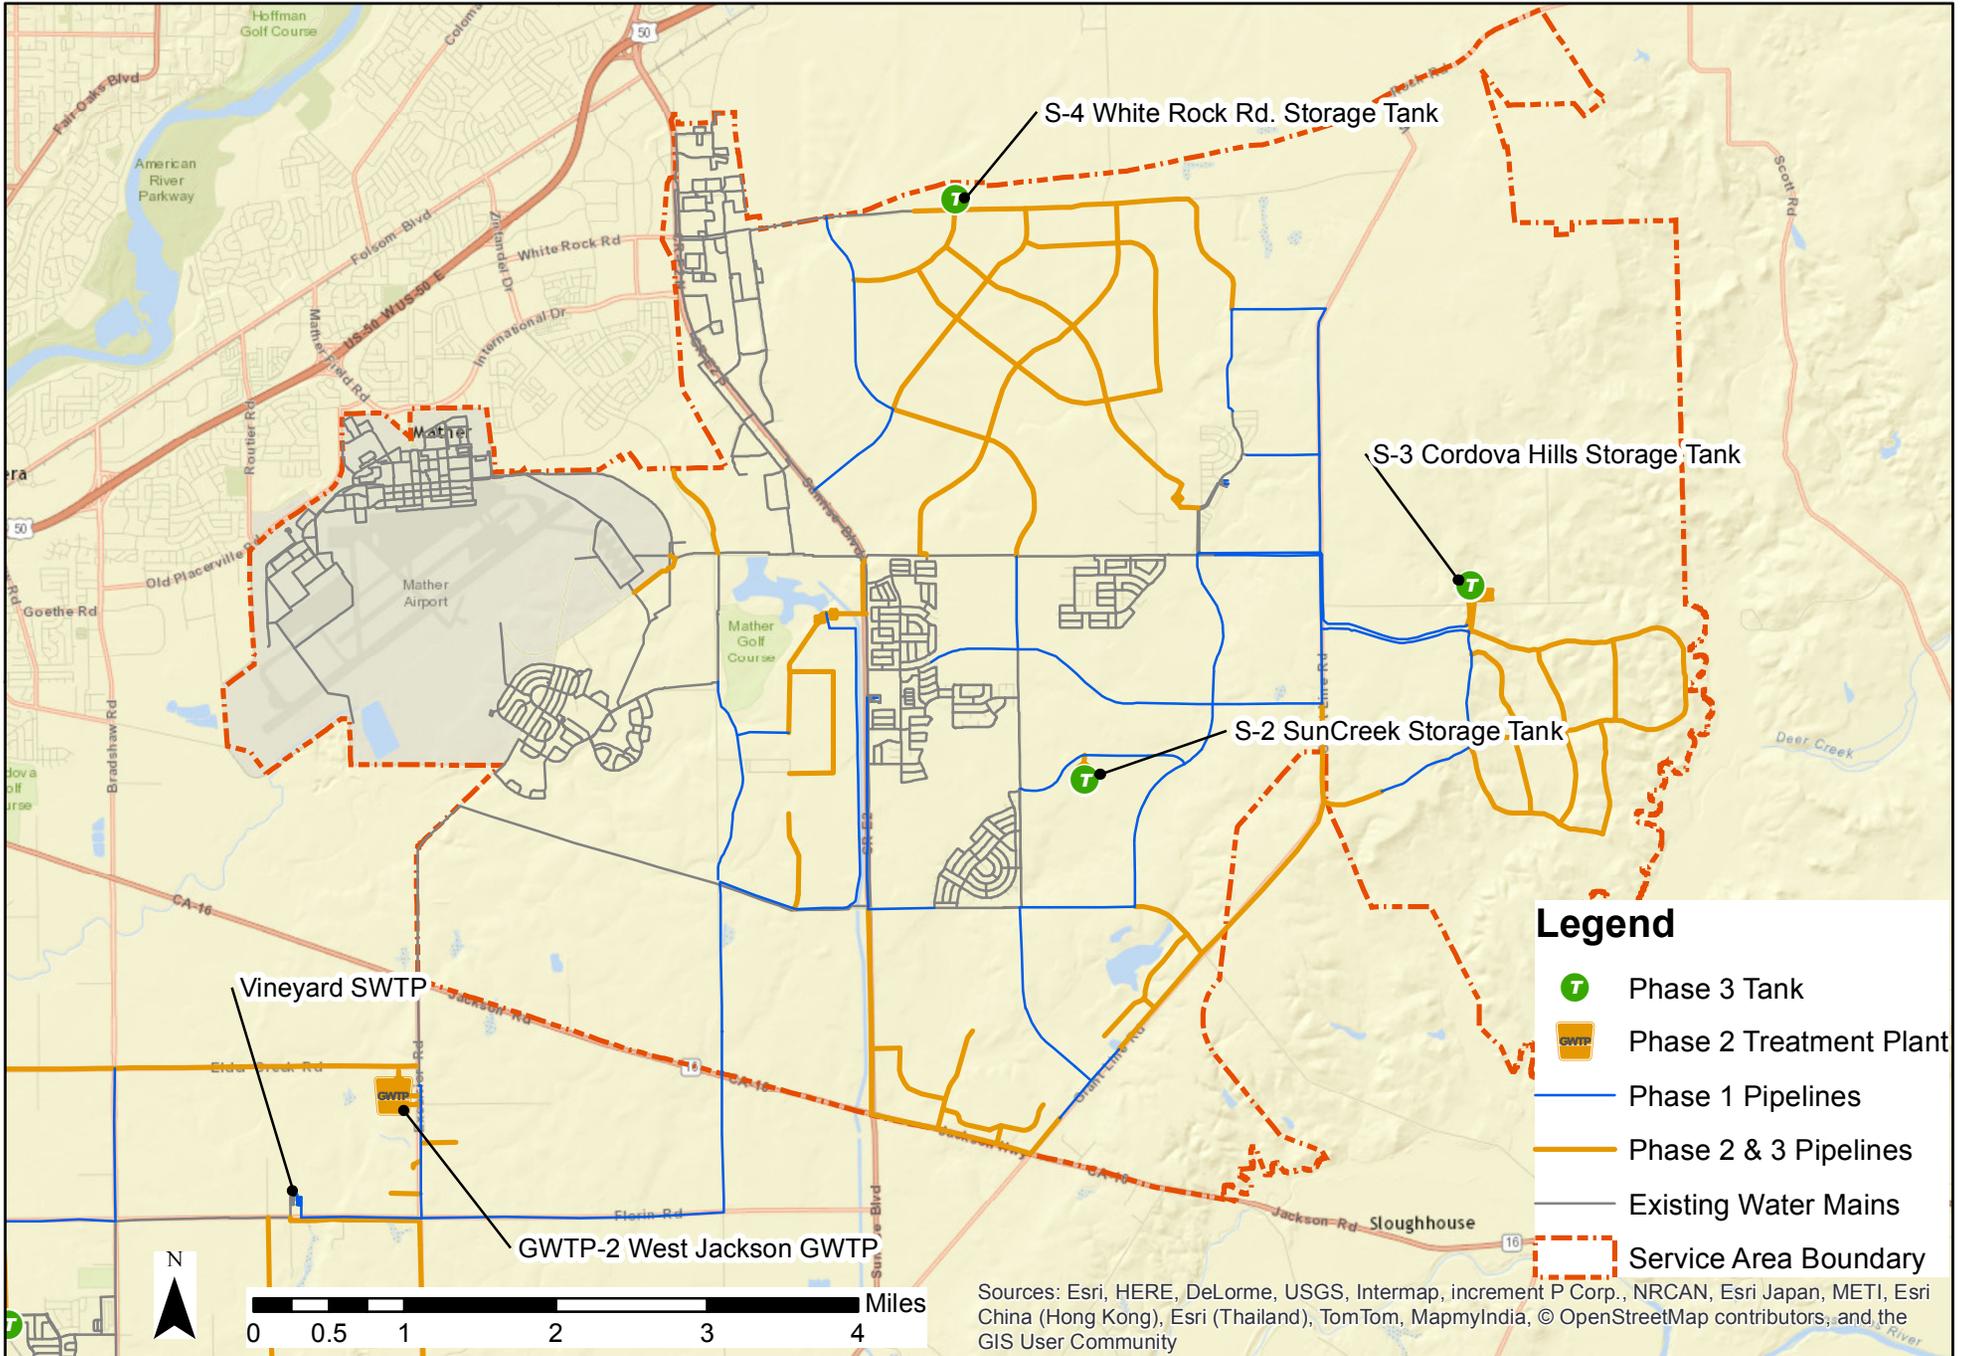

Sources: Esri, HERE, DeLorme, USGS, Intermap, increment P Corp., NRCAN, Esri Japan, METI, Esri China (Hong Kong), Esri (Thailand), TomTom, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

 DEPARTMENT OF WATER RESOURCES SACRAMENTO COUNTY WATER AGENCY	PROJECT	SITE	Water Supply Master Plan Amendment Phase 2 & 3 CIP Projects - NSA, Baseline	Figure 7-7
	DATE	TITLE		
	143542			
	8/4/15			

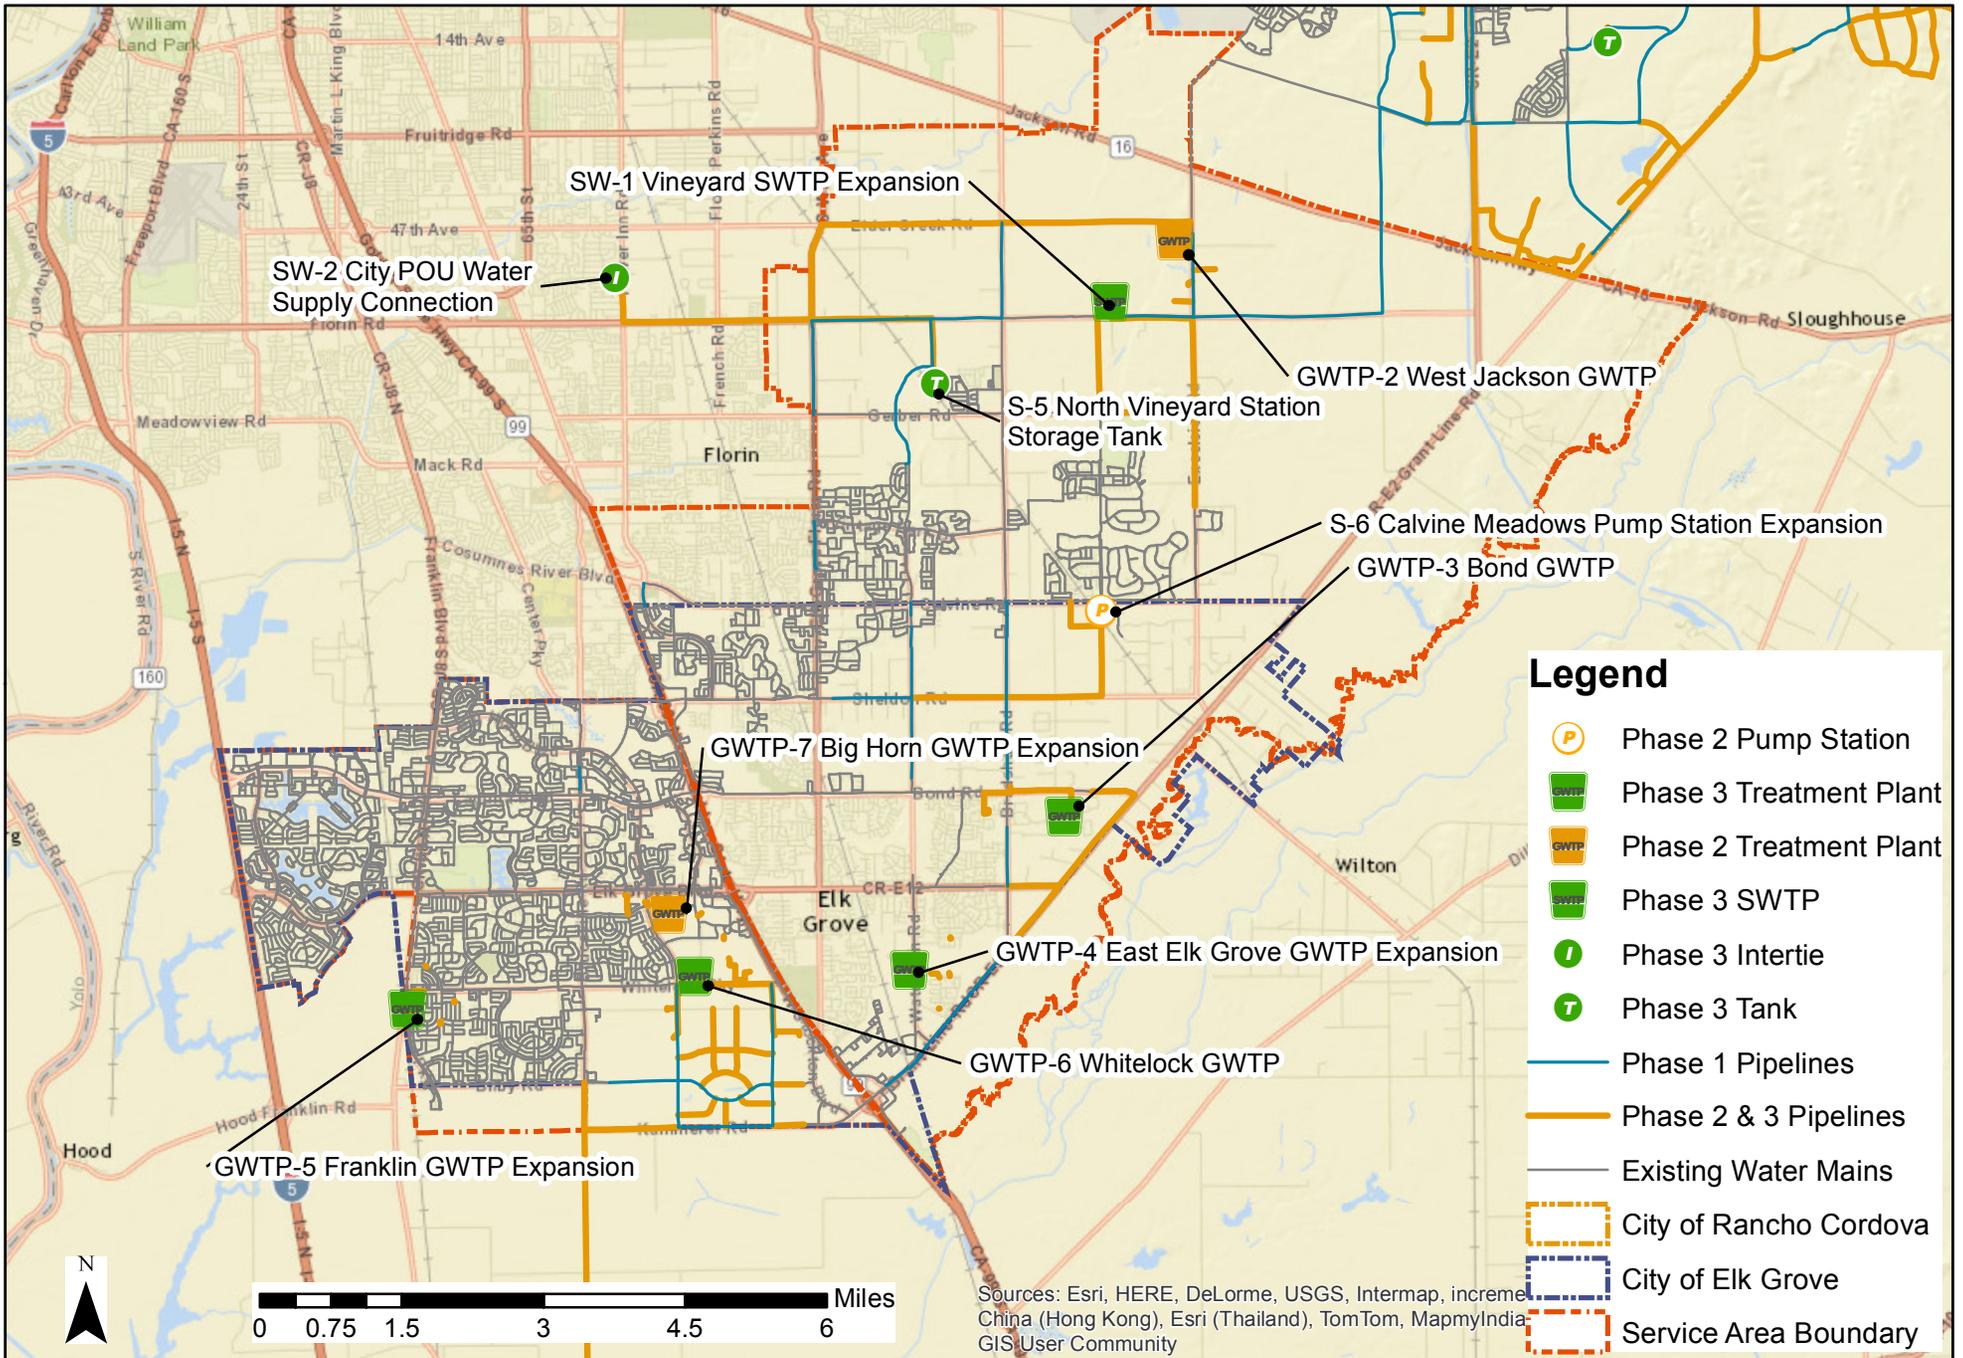

PROJECT	143542	SITE
DATE	8/4/15	TITLE

Water Supply Master Plan Amendment
Phase 2 & 3 CIP Projects - CSA & SSA, Baseline

Figure 7-8

Central Service Area

The surface water supply capacity for the CSA would be increased with the expansion of the Vineyard SWTP (SW-1) from 50 mgd to 100 mgd. The groundwater supply capacity would be increased in the CSA by the construction of one new GWTP and the expansion of one of the existing GWTPs (GWTP 3 and GWTP-4). In addition to the storage that would be constructed at these two GWTPs, one additional storage reservoir would be constructed in the CSA (S-5) and the pump station at a storage facility would be expanded (S-6). Additional pipelines would be constructed within the NSA to supply increased demands.

Facilities would also be added to deliver the POU surface water (19.1 mgd at maximum day) wholesaled by the City (SW-2). In the 2006 WSIP, it was assumed that the POU would be diverted and treated at the City's Fairbairn WTP, and then conveyed to the City's Florin Reservoir through the transmission main in Power Inn Road. The POU water connection to the City would be established at the Florin Reservoir. The water would be pumped out of Florin Reservoir by low-head pumps; then it would be conveyed in a dedicated transmission main (POU Water Pipeline), and finally the water would fill the North Vineyard Station Storage tank. From there, the water would be pumped out to the CSA.

The delivery of POU water would be significantly impacted by the Hodge flow standard. Recent studies by the City indicated that the POU water for Zone 40 would be subject to cutbacks under certain hydrologic conditions as opposed to being a highly reliable surface water supply as previously thought. Future study and update would be needed once the availability of the POU water is determined.

The locations of the Phase 3 projects in the CSA are shown on Figure 7-8.

South Service Area

The groundwater supply capacity would be increased in the SSA by the construction of two new GWTPs (GWTP-5 and GWTP-6). As shown in Table B-3 in Appendix B, these two GWTPs would provide a total groundwater supply capacity for the SSA that exceeds the SSA's projected maximum day demand at buildout. Consideration should be given to locating these two proposed GWTPs closer to where there is a need for dry year groundwater supply capacity, such as the CSA.

Facilities would also be added to increase the recycled water supply (RW-1). The recycled water project (RW-1) consists of the construction of pipelines, storage, and pumping capacity to deliver recycled water to new customers in the SSA. New storage would consist of the storage provided at the two GWTPs. Additional pipelines would be constructed within the SSA during Phase 3. The locations of the Phase 3 projects in the SSA are shown on Figure 7-8, except for the recycled water project. The specific configuration of the recycled water project has not been defined.

7.3.1.4 Summary

The future water system facilities are categorized as supply facilities, storage facilities, and pipelines. Table 7-13 presents the water supply facilities planned for Zone 40. Each GWTP project consists of wells, a groundwater treatment facility, a storage tank, and a pump station that pumps from the storage tank into the distribution system. Some of the GWTP projects already have wells that were previously drilled but not equipped and some would require the equipping and drilling of new wells. Table 7-13 presents the number of wells that would be equipped and/or drilled and equipped for the pertinent GWTP projects.

Table 7-14 presents the storage facility projects planned for Zone 40. Table 7-15 presents the pipeline projects that are 16 inches in diameter or larger planned for Phase 1 for all of Zone 40. Table 7-16 presents the pipelines that would be needed during Phases 2 and 3 for all of Zone 40.

Table 7-13. Additional Supply Facilities - Baseline

	Supply facility	Treatment/ supply capacity, mgd	Wells		Storage, MG	Pumping station capacity, mgd	Area served	Phase added
			Wells to be drilled and equipped	Wells to be equipped only (already drilled)				
GWTP-1	Poppy Ridge GWTP expansion	6.5		3	3.5	17.0	SSA	Phase 1
GWTP-2	West Jackson GWTP	18.0	5		4.0	21.6	CSA	Phase 2
SW-1	Vineyard WTP expansion	50.0					NSA/CSA	Phase 3
GWTP-3	Bond GWTP	6.5	3		0.5	10.8	CSA	Phase 3
GWTP-4	East Elk Grove GWTP expansion	6.5	2	1		13.0	CSA	Phase 3
SW-2	City POU water supply facilities	19.1					CSA	Phase 3
GWTP-5	Franklin GWTP	7.0	1	3	2.0	21.6	SSA	Phase 3
GWTP-6	Whitelock GWTP	13.0	6		3.0	14.4	SSA	Phase 3
GWTP-7	Big Horn GWTP expansion	8.5	4			17.0	SSA	Phase 2
RW-1	Recycled water supply	4.0					SSA	Phase 3
	Total	139.1	21	7	13.0	115.4		

Table 7-14. Additional Storage Facilities - Baseline

	Storage facility	Capacity, MG	Pumping station, mgd	Area served	Phase added
S-1	Phase B NSA Project	10.0	64.0	NSA	1
S-2	Suncreek	3.0	18.0	NSA	3
S-3	Cordova Hills	3.0	21.6	NSA	3
S-4	White Rock	3.0	14.4	NSA	3
S-5	North Vineyard Station	4.0	21.6	CSA	3
S-6	Calvine Meadows Pump Station Expansion		7.2	CSA	3
	Total	23.0	146.8		

Table 7-15. Phase 1 Pipelines - Baseline				
	Pipeline	Size, in	Length, ft	Area served
P-1A	Sunrise Blvd. Pipeline	16	9,676	NSA
P-2	Rio del Oro Pipeline	24	11,593	NSA
P-4	Eagles Nest Road Pipeline	20-30	7,239	NSA
P-5	Ranch Pipeline	24	7,000	NSA
P-6	Arboretum Pipe System	16	3,167	NSA
P-7	South Jaeger Pipeline	16	5,238	NSA
P-8	East NSA Pipeline System	16-30	61,389	NSA
P-9	North Jaeger Pipeline	24	6,365	NSA
P-10	Phase A NSA Project	42-66	44,662	NSA
P-14A	Bradshaw Road Pipeline	16-24	5,332	CSA
P-15	North Vineyard Station (Florin to Gerber) Pipeline	24-36	11,847	CSA
P-16	South Watt Connect Pipeline	24	2,693	CSA
P-17	CSA Backbone Pipeline	24-30	9,948	CSA
P-18	Elk Grove Loop Connector Pipelines	16-24	11,322	CSA
P-19	Power Inn Road Pipeline	24	1,273	CSA
P-20	Big Horn to Kammerer Pipeline	20	7,832	SSA
P-21	Bruceville Road Pipeline	18	1,267	SSA
P-22	North Grant Line Road Pipeline	20-24	17,000	NSA
P-23	Florin-Watt Pipelines	20-24	10,000	CSA
P-24	North Waterman Pipeline	16	3,000	CSA
P-25	Sheldon-Waterman Pipelines	18-24	15,000	CSA
P-26	South East Policy Area Pipelines	18-24	22,000	SSA
	Total	--	274,843	--

Table 7-16. Phase 2 and 3 Pipelines - Baseline	
Pipeline size, in	Length, ft
16	82,803
18	4,740
20	0
24	64,864
30	4,681
36	29,502
42	3,371
54	40,704
Total	230,665

7.3.2 Capital Improvement Plan

This section presents the CIP for Phases 1, 2, and 3.

7.3.2.1 Phase 1 CIP – 10 Year Plan (FY 2015-16 to 2024-25)

The Phase 1 CIP represents the projects that will be constructed over the near term time period. The development of the Phase 1 CIP requires consideration of the timing and duration of each project. The Phase 1 CIP consists of groundwater, storage, and pipeline projects. No surface water and stand alone storage projects are planned for Phase 1, other than the storage that is part of the GWTP project.

Table 7-17 presents the estimated costs of the Phase 1 water facilities for all of Zone 40. Included in the Phase 1 CIP is an item for non-specific project costs that cover the labor costs of SCWA’s planning, development, and development sections.

The timing of the Phase 1 projects presented in Table 7-17 are based on information SCWA has received from developers’ engineers regarding the timing of development projects and keeping a somewhat consistent rate of annual expenditure over the duration of Phase 1. The cost of each project would occur over a duration of several years. All of the projects would be completed by the time the end of Phase 1 is reached.

Table 7-17. Phase 1 CIP Cost Estimate - Baseline

Projects		Service area	Capital cost	Project timing	
No.	Name			Start, FY	End, FY
Groundwater projects (SCWA projects)					
GWTP-1	Poppy Ridge GWTP Expansion	SSA	\$13,832,800	2016	2018
	Well site acquisitions	CSA/SSA	\$180,000	2018	2023
	subtotal		\$14,012,800		
Regional transmission and storage projects (SCWA projects)					
S-1	Phase B NSA Project	NSA	\$84,586,140	2016	2023
P-10	Phase A NSA Project	NSA	\$10,088,000	2016	2019
	Tank site acquisition	NSA	\$800,000	2017	2018
	subtotal		\$95,474,140		
Pipeline projects (Developer projects)					
P-1A	Sunrise Blvd. Pipeline	NSA	\$3,302,200	2018	2020
P-2	Rio del Oro Pipeline	NSA	\$3,663,200	2016	2018
P-4	Eagles Nest Road Pipeline	NSA	\$3,779,200	2019	2021
P-5	Ranch Pipeline	NSA	\$2,202,300	2023	2025
P-6	Arboretum Pipe System	NSA	\$1,104,300	2021	2023
P-7	South Jaeger Pipeline	NSA	\$1,145,500	2020	2022
P-8	East NSA Pipeline System	NSA	\$18,212,400	2016	2021
P-9	North Jaeger Pipeline	NSA	\$2,027,300	2017	2018
P-14A	Bradshaw Road Pipeline	CSA	\$2,724,200	2017	2019
P-15	North Vineyard Station (Florin to Gerber) Pipeline	CSA	\$5,025,600	2018	2020
P-16	South Watt Connect Pipeline	CSA	\$1,742,400	2019	2021
P-17	CSA Backbone Pipeline	CSA	\$5,008,300	2023	2025
P-18	Elk Grove Loop Connector Pipelines	CSA	\$4,715,500	2023	2025
P-19	Power Inn Road Pipeline	CSA	\$584,300	2024	2025
P-20	Big Horn to Kammerer Pipeline	SSA	\$2,494,500	2017	2019
P-21	Bruceville Road Pipeline	SSA	\$509,400	2024	2025
P-22	North Grant Line Road Pipeline	NSA	\$4,588,800	2022	2024
P-23	Florin-Watt Pipelines	CSA	\$4,150,400	2023	2025
P-24	North Waterman Pipeline	CSA	\$568,900	2019	2020
P-25	Sheldon-Waterman Pipelines	CSA	\$5,685,700	2022	2025
P-26	South East Policy Area Pipelines	SSA	\$5,868,800	2021	2024
	subtotal		\$78,475,800		

Table 7-17. Phase 1 CIP Cost Estimate - Baseline					
Projects		Service area	Capital cost	Project timing	
No.	Name			Start, FY	End, FY
Non-specific project costs			\$30,000,000	2016	2025
Studies					
	Recycled Water Master Plan		\$250,000	2016	2025
	Water Master Plan		\$400,000	2016	2025
	EIR		\$500,000	2016	2025
	subtotal		\$1,150,000		
Total			\$ 219,112,740		

7.3.2.2 Phase 2 CIP – 10 Year Plan (2026 to 2035)

Phase 2 represents the 10 year period following the end of Phase 1. Since Phase 2 is further in the future, the timing of projects is more speculative and less precise. The level of precision provided in the Phase 1 CIP is not needed for Phase 2 since the capacity charges are developed using the Phase 1 CIP costs and not the CIP costs from the subsequent phases.

The new pipelines that are needed for Zone 40 during Phases 2 and 3 are defined. However, the timing of when each pipeline project is needed is dependent on the location and timing of development. Therefore, this document does not identify the specific pipe segments that would need to be constructed in either Phase 2 or 3. The approach used for the development of the CIP is to assume that approximately half the cost of the Phases 2 and 3 pipelines would occur in Phase 2 and half would occur in Phase 3. Table 7-18 presents the cost estimate for the Phases 2 and 3 pipelines for all of Zone 40.

Table 7-19 presents the cost estimate for the Phase 2 CIP projects for all of Zone 40. The Phase 2 CIP consists of groundwater and pipeline projects. No surface water projects are planned for Phase 2.

Table 7-18. Phases 2 and 3 Pipeline Cost Estimate - Baseline		
Diameter, in	Length, ft	Capital Cost
16	82,803	\$34,629,723
18	4,740	\$2,244,180
20	-	
24	64,864	\$35,014,206
30	4,681	\$3,190,782
36	29,502	\$23,806,783
42	3,371	\$3,167,568
54	40,704	\$57,518,458
Total	206,007	\$159,571,700

Table 7-19. Phase 2 CIP - Baseline			
Projects		Service area	Capital cost
No.	Name		
Groundwater Projects			
GWTP-2	West Jackson GWTP	CSA	\$28,932,200
GWTP-7	Big Horn GWTP Expansion	SSA	\$14,744,100
Pipeline Projects		NSA/CSA/SSA	\$79,785,850
Total			\$123,462,150

7.3.2.3 Phase 3 CIP – 17 Year Plan (2036 – Buildout)

The Phase 3 CIP consists of surface water, groundwater, recycled water, storage, and pipeline projects. Table 7-20 presents the cost estimate for the Phase 3 CIP projects for all of Zone 40. The cost estimate for the City POU supply connection (SW-2) is for the construction of the interconnection and the pipeline to convey the water into the CSA’s water transmission system. It does not include the City’s capacity buy-in cost that was estimated in 2005 to be \$32 million.

Table 7-20. Phase 3 CIP - Baseline			
Projects		Service area	Capital cost
No.	Name		
Surface water projects			
SW-1	Vineyard WTP Expansion	NSA/CSA	\$200,000,000
SW-2	City POU Supply Connection ^(a)	CSA	\$2,034,400
	subtotal		\$202,034,400
Groundwater projects			
GWTP-3	Bond GWTP	CSA	\$14,725,800
GWTP-4	East Elk Grove GWTP Expansion	CSA	\$13,687,000
GWTP-5	Franklin GWTP	SSA	\$18,544,000
GWTP-6	Whitelock GWTP	SSA	\$26,143,800
	subtotal		\$73,100,600
Recycled water projects			
RW-1	Recycled Water Project	SSA	\$20,000,000
Storage projects			
S-2	Suncreek Storage	NSA	\$11,864,500
S-3	Cordova Hills Storage	NSA	\$12,848,700
S-4	White Rock Road Storage	NSA	\$10,880,400
S-5	North Vineyard Station Storage	CSA	\$5,467,500

Table 7-20. Phase 3 CIP - Baseline			
Projects		Service area	Capital cost
No.	Name		
S-6	Calvine Meadows Pump Station Expansion	CSA	\$5,084,800
	subtotal		\$46,145,900
Pipeline projects		NSA/CSA/SSA	\$79,785,850
Total			\$421,066,750

^(a) Does not include the City's capacity buy-in cost

7.3.2.4 CIP Summary

Table 7-21 summarizes the Zone 40 CIP costs by project category and phase. The Phases A and B NSA projects in Phase 1 have been categorized as storage projects for the purpose of Table 7-21.

Table 7-21. Zone 40 CIP Cost Summary - Baseline				
Project categories	Phase 1	Phase 2	Phase 3	Total
Surface water projects			\$202,034,400	\$202,034,400
Groundwater projects	\$14,012,800	\$43,676,300	\$73,100,600	\$130,789,700
Recycled water projects			\$20,000,000	\$20,000,000
Storage projects	\$95,474,140		\$46,145,900	\$141,620,040
Pipeline projects	\$78,475,800	\$79,785,850	\$79,785,850	\$238,047,500
Non-specific project costs	\$30,000,000			\$30,000,000
Studies	\$1,150,000			\$1,150,000
Total	\$219,112,740	\$123,462,150	\$421,066,750	\$763,641,640

Section 8

NewBridge

This section describes the demographics, water demands, water supplies, and needed water system improvements for the NewBridge scenario.

8.1 Water Demands

This section describes the future land use, demographics, and demand projections for the NewBridge scenario.

8.1.1 Buildout Demographics

This section describes the projected developed area and demographics for the proposed NewBridge development and for the overall NewBridge scenario.

8.1.1.1 Proposed NewBridge Development

The source of land use information for the NewBridge Developments shown below in Table 8-1. This land use information is the basis of the acreage, demographic, and population estimates described in this section, as well as the water demand projection.

Table 8-1. Source of Land Use Information for NewBridge Development	
Subarea name	Agency providing land use data and date
NewBridge	MacKay & Soms, 4/30/13

The demographics and water demands for the proposed development were estimated based on the amount of acreage by land use category obtained from the source of land use information presented in Table 8-1. It is anticipated that the land use plans for the proposed development will possibly be revised, perhaps several times, before final approval. It is anticipated that these revisions would not significantly change the overall total buildout water demand for Zone 40 from the projections presented in this report, as well as the planned water system improvements. If the land use changes and resulting demographics, water demands, and facility needs are determined to be significant, the report would be amended as necessary.

The NewBridge growth area consists of 1,100 acres that are proposed to be used for residential, commercial/office, open space, and public uses. Public uses include an elementary school, electric facility, and fire station as well as a park and community garden. Residential land uses include low, medium, and high density residential units and some acreage for mixed use.

Currently in this area there is a rendering plant site owned by the Sacramento Rendering Company, rural uses, a cemetery and pet cemetery, and a small electric facility operated by SMUD in the southwest corner of the site near the Folsom South Canal. The remainder of the site is non-irrigated lands, wetlands, and river riparian areas.


Proposed land uses and estimates for buildout connections, DUs, and population are shown in Table 8-2. The amount of acreage by land use category was calculated by SCWA staff. The number of connections and dwelling units and the population were estimated based on the acreage by land use category. A water demand estimate table was subsequently provided by the developer that had slightly different buildout acreages by land use category than presented in Table 8-2 (SCWA, 2015). The proposed land uses are illustrated on Figure 8-1.

Table 8-2. Land Use Area and Buildout Demographics for the NewBridge Area				
Land use category	Buildout gross area from GIS, acres	Connections	Dwelling units	Population
Rural estate	-	-	-	-
Single family	236	1,047	1,047	3,456
Multi-family - low density	119	132	1,322	3,636
Multi-family - high density	42	59	890	2,270
Commercial	38	17	-	-
Industrial	-	-	-	-
Public	13	1	-	-
Public recreation	44	41	-	-
Mixed land use	13	6	-	-
Right-of-way	48	45	-	-
Self-supported/supplied by others				
Non-irrigated	439	-	-	-
Industrial-unutilized	-	-	-	-
Agricultural	106	-	-	-
Total	1,100^a	1,300^a	3,300^a	9,400^a

^a Totals are rounded to the 100s place

8.1.1.2 NewBridge Scenario

The 2010 and buildout developed land use acreages by land use category are summarized in Table 8-3. The acreages presented in Table 8-3 are net acres for 2010 and gross acres for this scenario at buildout. The buildout land use for the study area is illustrated on Figure 8-2.

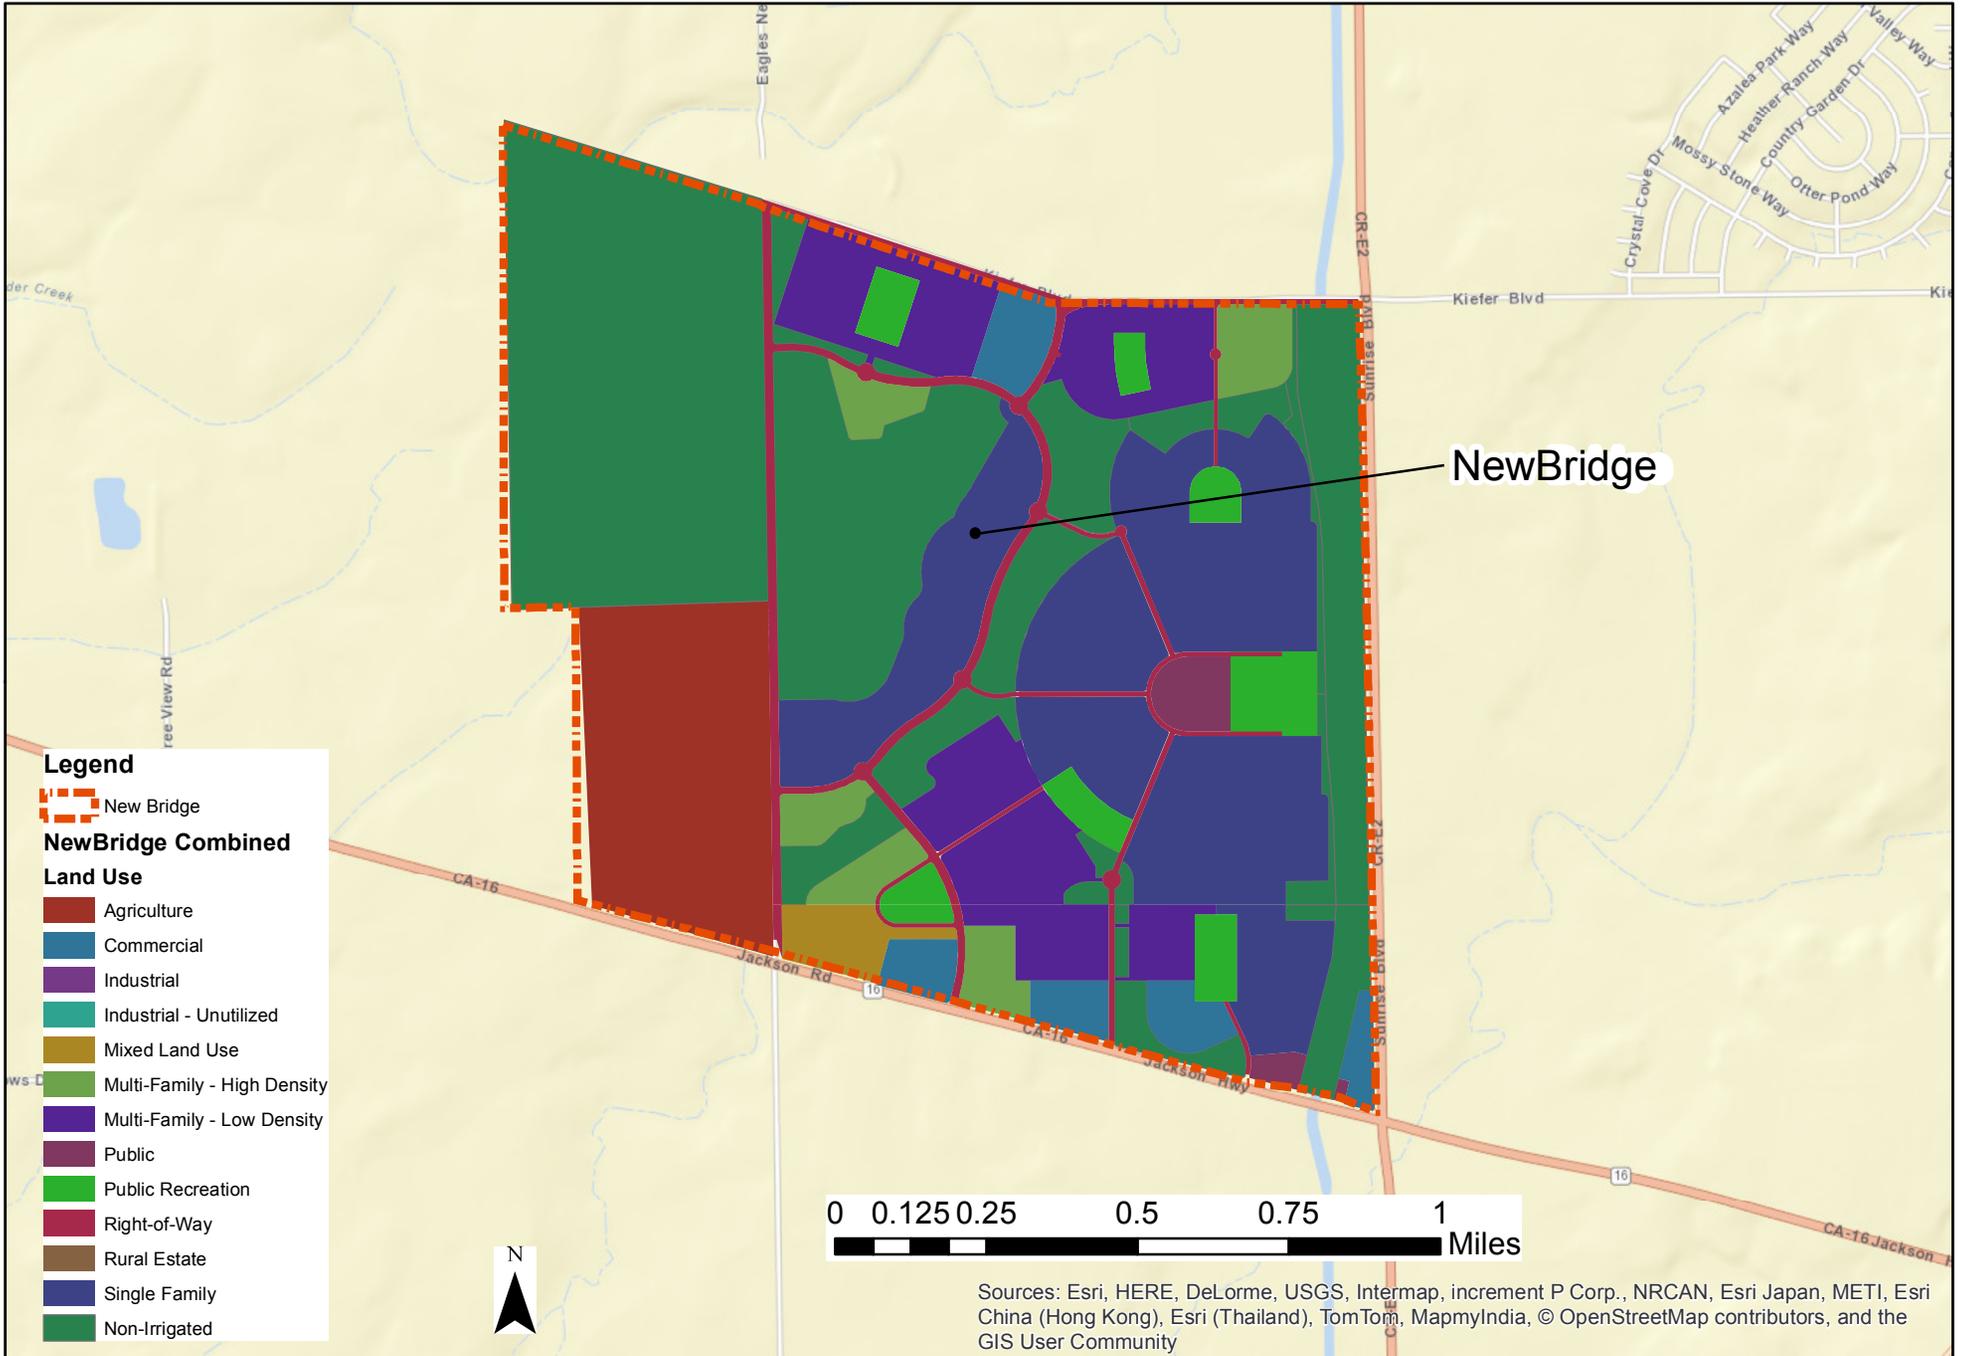


Sources: Esri, HERE, DeLorme, USGS, Intermap, increment P Corp., NRCAN, Esri Japan, METI, Esri China (Hong Kong), Esri (Thailand), TomTom, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

 	PROJECT 148130	SITE	Zone 40 Water Supply Master Plan Amendment Buildout Land Use - NewBridge Area	Figure 8-1
	DATE 7/29/15	TITLE		

Table 8-3. 2010 and Buildout Area By Land Use - NewBridge

Land use category	2010 developed area, net acres	Buildout area, gross acres
Rural estate	1,380	6,610
Single family	6,970	16,880
Multi-family - low density	220	3,600
Multi-family - high density	390	1,190
Commercial	1,520	3,800
Industrial	1,110	3,450
Industrial-unutilized	340	580
Public	920	2,120
Public recreation	1,270	4,300
Mixed land use	20	210
Right-of-way	70	280
Subtotal, municipal water supply land area	14,210	43,020
Self-supported/supplied by others	-	3,390
Non-irrigated	500	8,680
Agricultural	-	14,320
Total	14,710	69,410

Note: Elk Grove wholesale area is not included in the 2010 developed area acreage because it was not available. It is included in the buildout acreage.

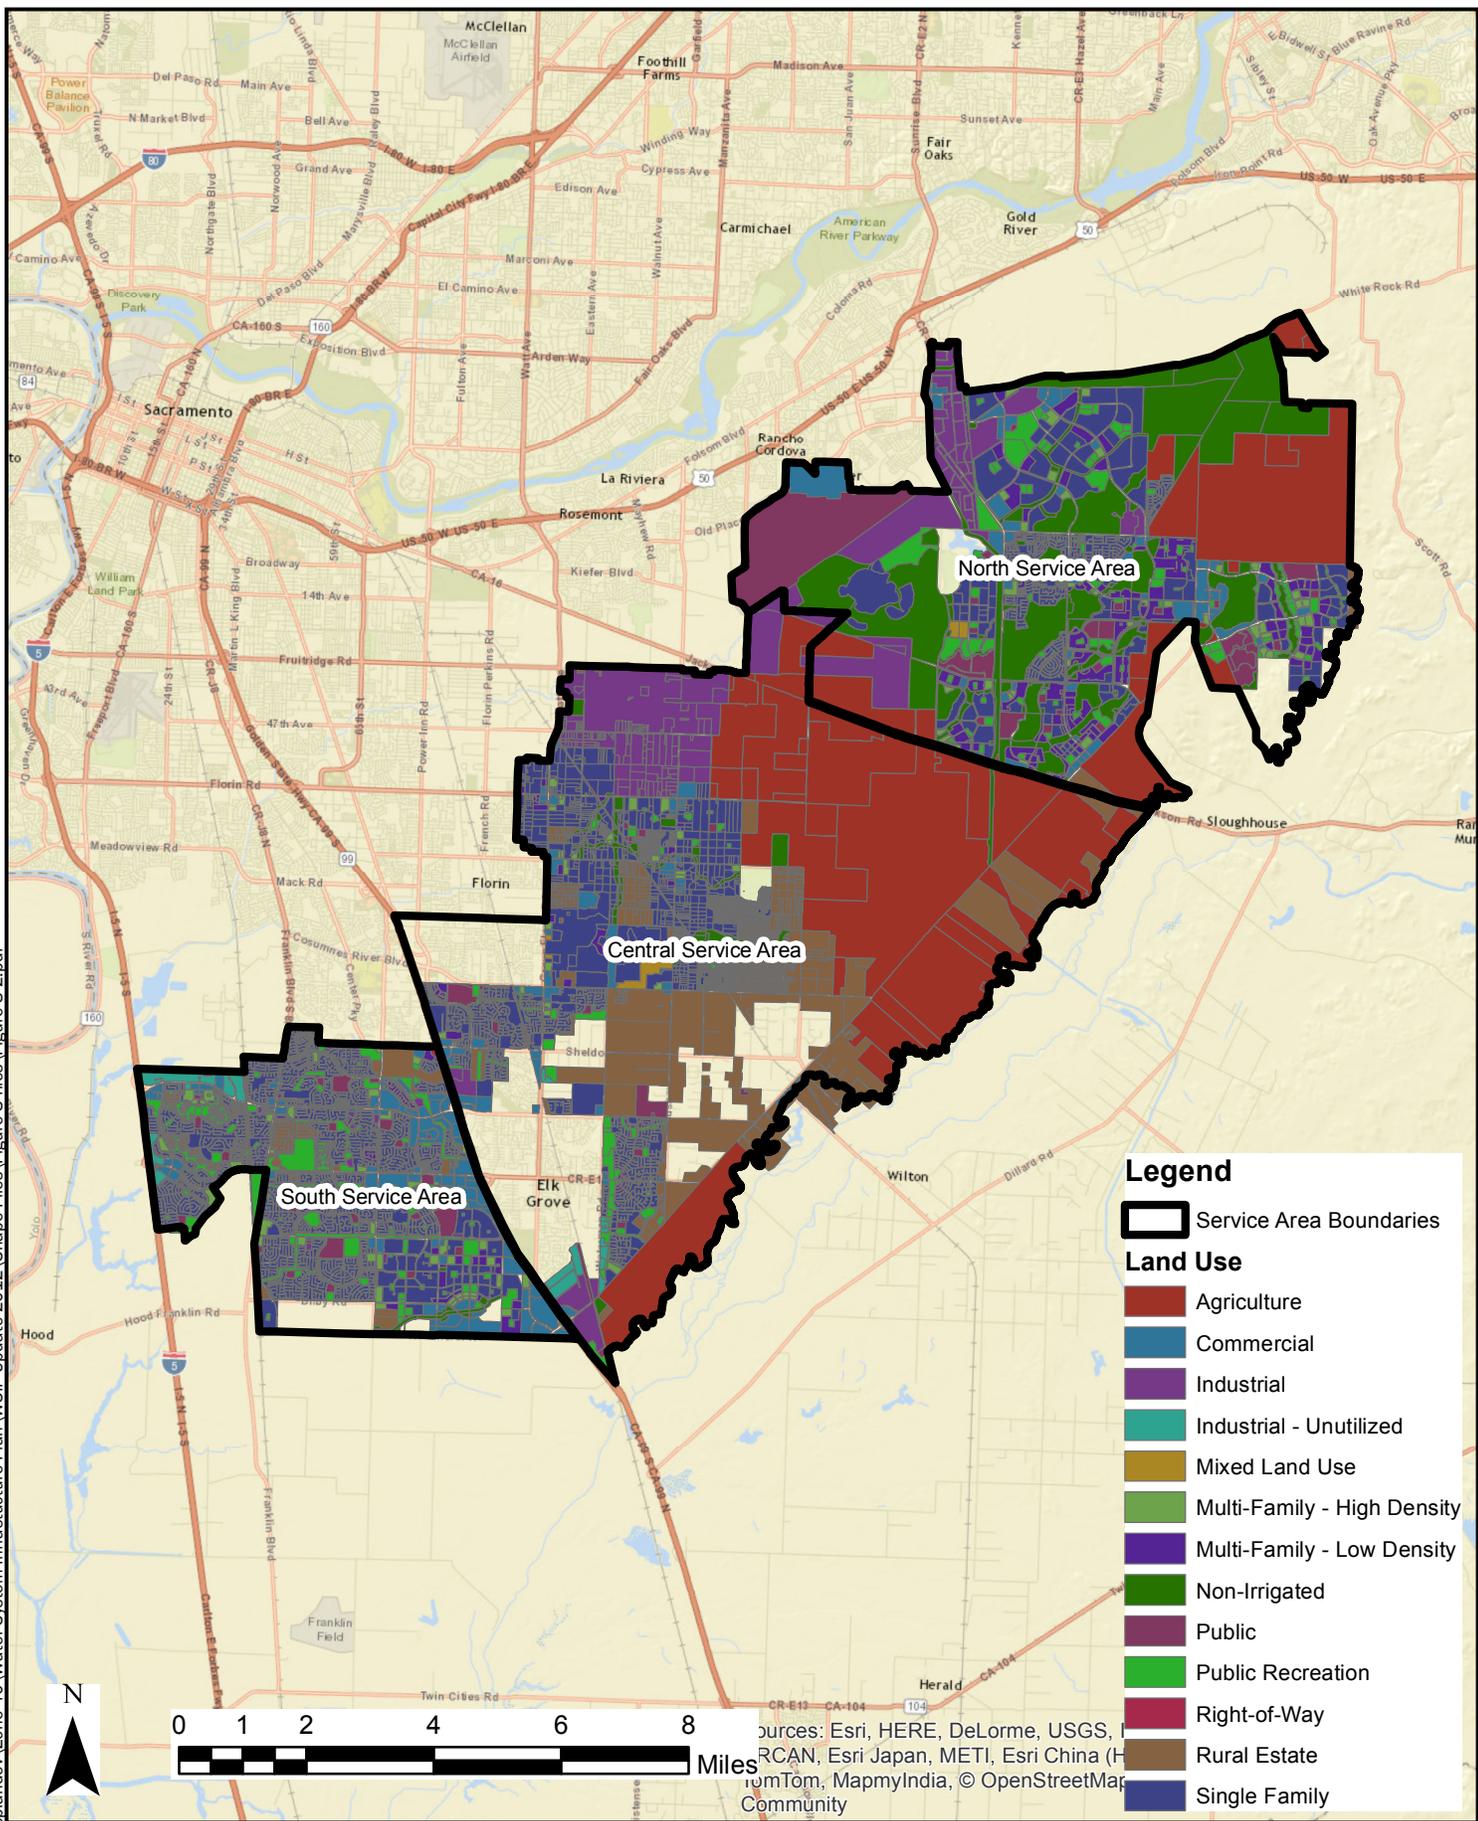


DATE 07/30/15	PROJECT 148130	SITE
		TITLE

Zone 40 Water Supply Master Plan Amendment

Buildout Land Use - NewBridge

Figure 8-2

The historical and projected population for this scenario is shown on Figure 8-3. The projected DUs, population, and connections at buildout by land use category are presented in Table 8-4. Population per DU and per connection, DUs per connection, and connections per acre by land use category are also shown in this table. The number of people per connection projected at buildout is significantly higher than the 2010 value because of the proportionally large increase in multi-family land use area compared to single family land use area from 2010 to buildout. A larger proportion of the residential dwelling units and connections will be multifamily at buildout compared to 2010, which will result in a higher number of people per connection.

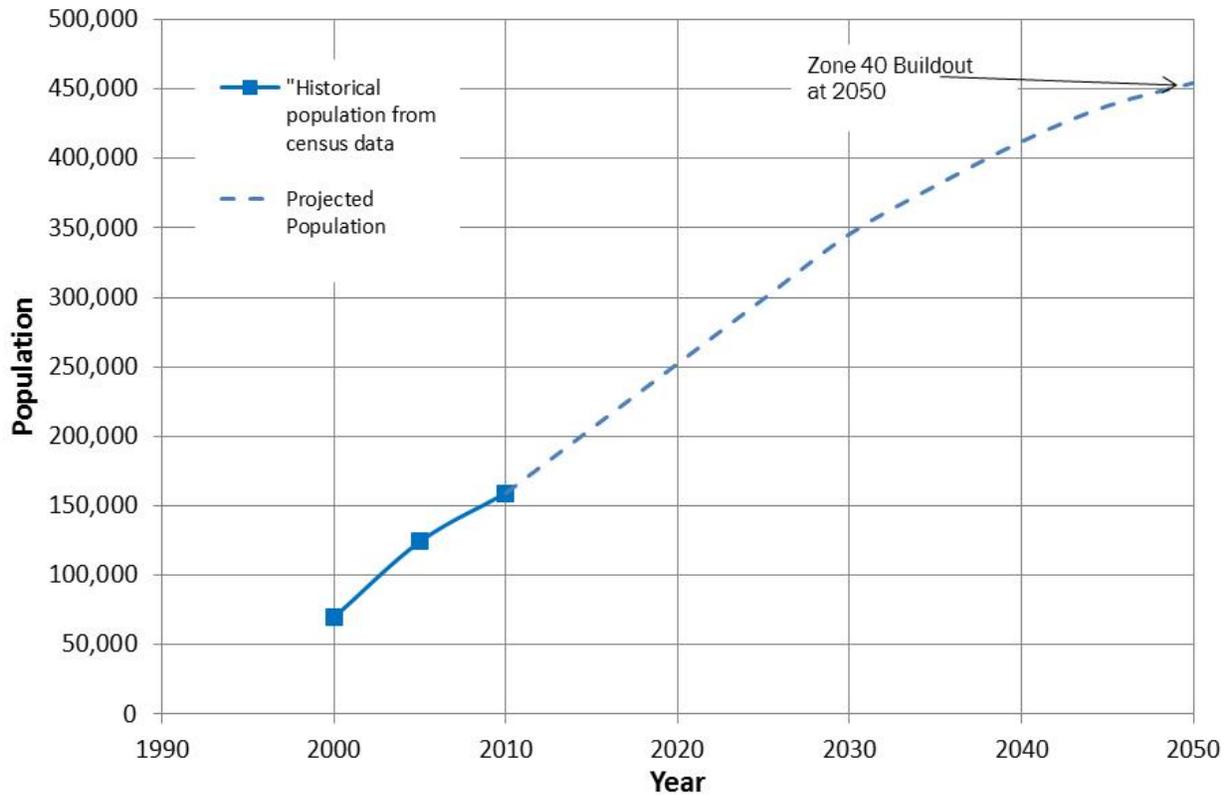

Elk Grove wholesale population is included. 2010 Elk Grove wholesale population is estimated to equal 10,144 people based on 3,210 Elk Grove wholesale connections and 3.16 people per connection in 2010.

Figure 8-3. Historical and Projected Population –NewBridge

Table 8-4. Buildout Dwelling Units, Population, and Connections by Land Use Category- NewBridge

Land use category	Dwelling units	Population	Connections	Population/ dwelling unit	Population/ connection	Dwelling units/ connection	Connections/ acre
Rural estate	3,193	10,648	3,193	3.3	3.3	1	0.5
Single family	81,511	269,055	81,511	3.3	3.3	1	4.8
Multi-family - low density	40,055	110,201	4,025	2.8	27.4	10	1.1
Multi-family - high density	25,213	64,359	1,634	2.6	39.4	15	1.4
Commercial	-	-	1,662				0.4
Industrial	-	-	1,391				0.4
Industrial-unutilized	-	-	-				-
Public	-	-	200				0.1
Public recreation	-	-	3,621				0.8
Mixed land use	-	-	40				0.2
Right-of-way	-	-	425				1.5
Self-supported/ supplied by others	-	-	-	-	-	-	-
Non-irrigated	-	-	-	-	-	-	-
Agricultural	-	-	-	-	-	-	-
Total	150,000^(a)	454,300^(a)	97,700^(a)	3.0	4.6	1.5	1.7

^(a) Totals are rounded to the 100's place.

The 2010 and projected buildout DUs, population, and connections by service area are shown in Table 8-5. The projected buildout number of DUs and population for the NSA, CSA, and SSA are very similar; however the numbers of connections in the NSA are significantly less than the CSA and SSA. This is because there is a greater number of multi-family DUs in the NSA than the CSA and SSA. Since there are several multi-family dwelling units per connection, a lower number of connections is projected in the NSA to serve the similar number of dwelling units. Table 8-6 shows the number of connections by service area in five-year increments through 2050 and at buildout. The projected number of connections through buildout for each of the growth scenarios is illustrated on Figure 8-4.

Table 8-5. 2010 and Buildout Dwelling Units, Population, and Connections by Service Area – NewBridge

Service area	2010			Buildout		
	Dwelling units	Population	Connections	Dwelling units	Population	Connections
NSA	4,000	11,700	4,600	49,200	145,200	26,800
CSA	17,400	56,600	15,600	49,400	150,700	32,800
SSA	30,600	91,300	28,900	51,300	158,400	38,100
Total	52,000	159,600	49,100	150,000	454,300	97,700

Note: 2010 dwelling units, population, and connections in Elk Grove wholesale area are estimated and included in the CSA values. Elk Grove wholesale area service connections in 2010 are estimated to be 3,200 connections and the DUs are estimated to be 3,500 based on a 1.1 DU per connection factor. The population is estimated to equal 10,144 people.

Table 8-6. Projected Connections in 5-Year Increments – NewBridge

Service area	2010	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
NSA										
NewBridge	-	-	300	700	1,000	1,300	1,300	1,300	1,300	1,300
Remaining NSA	4,600	5,600	7,200	9,300	11,500	14,700	18,500	22,200	25,400	25,400
Total	4,600	5,600	7,500	10,000	12,500	16,100	19,800	23,600	26,700	26,800
CSA	15,600	16,600	18,400	20,900	23,400	27,000	30,800	32,900	32,900	32,800
SSA	28,900	30,300	32,800	35,300	37,800	38,100	38,100	38,100	38,100	38,100
Total Zone 40	49,100	52,500	58,700	66,200	73,700	81,200	88,700	94,600	97,700	97,700

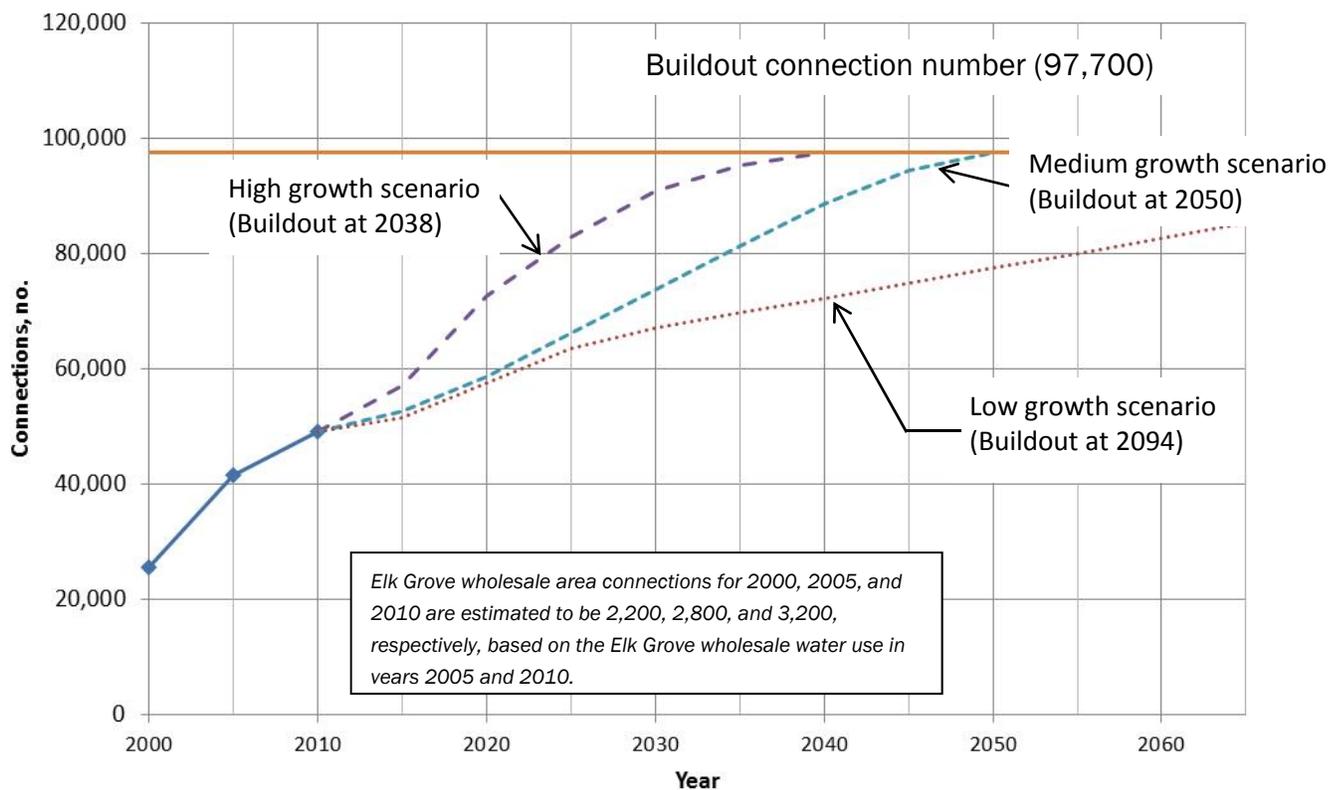


Figure 8-4. Historical and Projected Connections at High, Medium, and Low Growth Rates –NewBridge

8.1.2 Buildout Water Demands

This section presents the buildout water demand for the NewBridge area and for the overall NewBridge scenario. The buildout water demands for the NewBridge new growth area is shown on Table 8-7. A water demand estimate table was subsequently provided by the developer that had a water demand projection of 1,600 ac-ft/yr, compared to the 1,300 ac-ft/yr presented in Table 8-7 (SCWA, 2015). This difference

amounts to 0.3 percent of the total Zone 40 buildout demand. As described in Section 8.1.1.1, SCWA anticipates that further revisions to development plans may occur. If the land use changes and resulting water demands and facility needs are determined to be significant, the report would be amended as necessary.

Table 8-7. NewBridge Area Buildout Water Demands

Land use	Buildout gross area from GIS, acres	Gross UWDF, ac-ft/yr/ac	Water demand, ac-ft/yr
Rural estate		1.37	
Single family	236	2.13	504
Multi-family - low density	119	2.44	289
Multi-family - high density	42	3.33	140
Commercial	38	2.02	78
Industrial		2.02	
Public	13	0.81	10
Public recreation	44	2.80	123
Mixed land use	13	2.15	28
Right-of-way	48.2	0.18	9
Self-supported/supplied by others			
Non-irrigated	439		
Industrial-unutilized			
Agricultural	106		
Subtotal	1,099		1,181
Water loss (7.5% of sales)			89
Total	1,099		1,300 ^(a)

^(a) Total is rounded to the 100's place.

Based on the buildout land area in Table 8-3 and the unit water demand factors in Table 3-4, the buildout water demand by land use category is shown in Table 8-8 for the NewBridge scenario. The recycled water demand in the SSA is included in the demand projections in Table 8-8 to provide the total Zone 40 water demand for this scenario. There is no recycled water demand assumed for the NewBridge area.

Table 8-8. Buildout Water Demand by Land Use Category – NewBridge

Land use category	Water demand, ac-ft/yr
Rural estate	9,100
Single family	36,000
Multi-family - low density	8,800
Multi-family - high density	4,000
Commercial	7,700
Industrial	7,000
Public	1,700
Public recreation	12,000
Mixed land use	400
Right-of-way	100
Subtotal (land use with water demand)	86,700
Water system losses (7.5% of water sales)	6,500
Self-supplied/supported by others	0
Industrial-unutilized	0
Non-irrigated	0
Agricultural	0
Total production	93,200

8.1.3 Water Demand Growth Projection

Water demand growth projections are determined based on the projected connection growth described in Section 8.1.1.2. The projected water demands by service area are shown in Table 8-9 and illustrated on Figure 8-5.

Table 8-9. Projected Water Demand in 5-Year Increments – NewBridge, ac-ft/yr

Service area	2013	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
NSA										
NewBridge	-	-	300	600	1,000	1,300	1,300	1,300	1,300	1,300
Remaining NSA	4,200	5,300	7,100	9,600	12,300	16,500	21,400	26,600	31,400	31,400
Total	4,200	5,300	7,400	10,200	13,300	17,800	22,700	27,900	32,700	32,700
CSA	15,100	16,300	18,400	21,100	23,900	27,800	32,100	34,400	34,400	34,400
SSA	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100
Total	34,500	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200

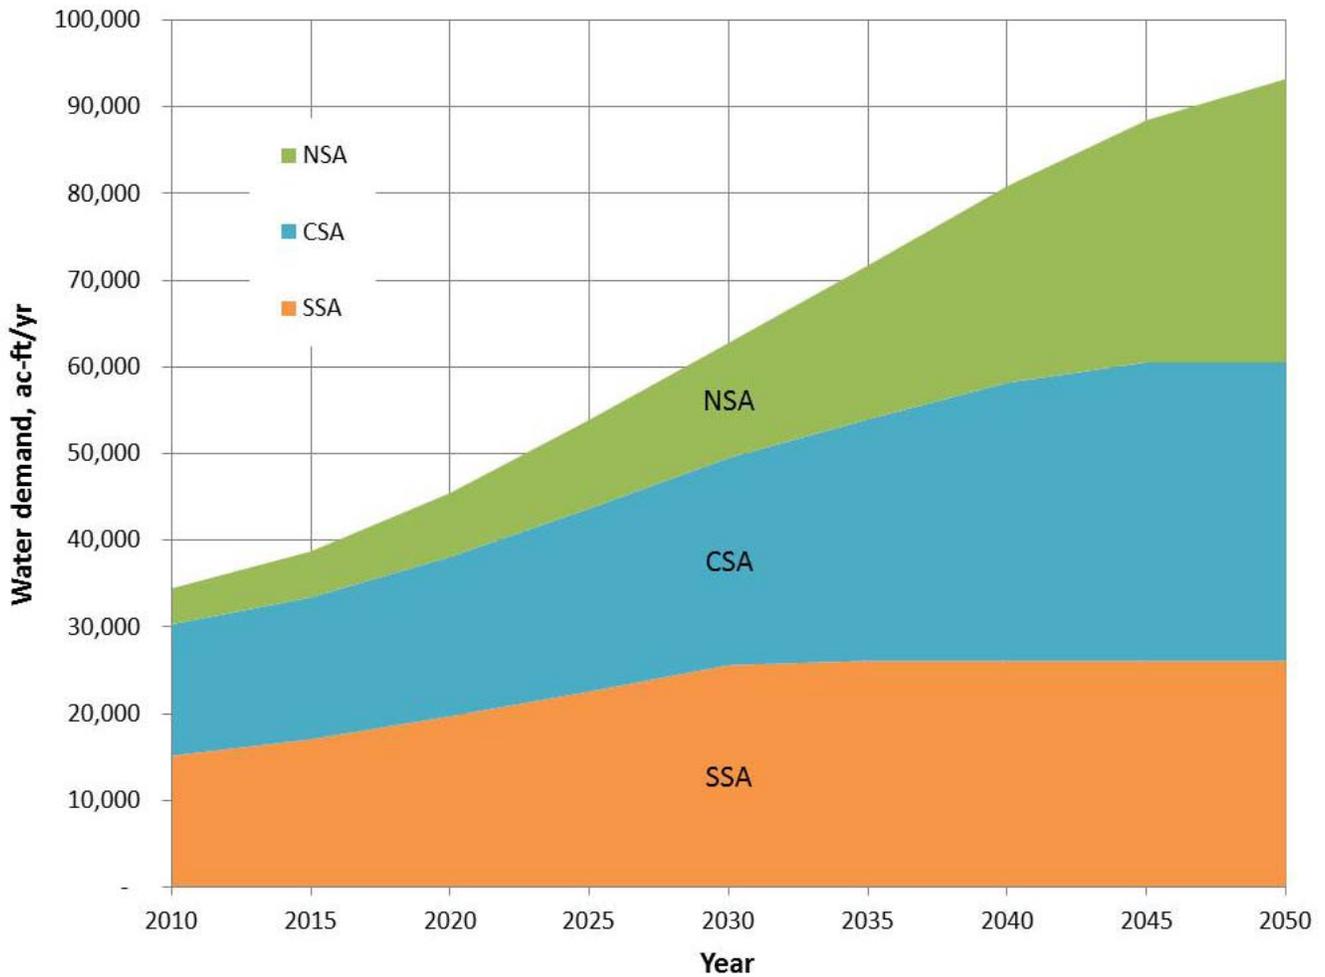


Figure 8-5. Water Demand Projection – NewBridge

8.2 Water Supply Capacity

This section quantifies the amount of supply capacity that would be needed to meet demands through buildout. The supply capacity and the use of the supply is presented on both a maximum day basis and an annual basis.

8.2.1 Maximum Day Demand Supply Capacity and Use

This section compares the projected maximum day demand to supply capacity for each of the three service areas through buildout. The maximum day demand to supply capacity comparison tables for each of the three service areas are presented in Appendix C. The future supply capacity is based on the proposed supply and conveyance facilities that are presented in Section 8.3. The maximum day use of each type of supply is quantified for the wet/average years and dry years.

8.2.1.1 North Service Area

Surface water supply from the existing Vineyard SWTP would be provided in Phase 1 to replace the current groundwater supply provided by the Anatolia GWTP. The construction of the Phase A NSA Project (P-10) and

Phase B NSA Project (S-1) will allow for some of the Vineyard SWTP's existing capacity to be used to supply the NSA. It is assumed that 65 percent of the Vineyard SWTP would be used to supply the NSA. The Mather wells are used below their capacities in dry years since SCWA operational staff prefer to minimize their use due to the possible impact to nearby contamination plumes.

8.2.1.2 Central Service Area

Once several projects are constructed, including the Phase A NSA Project (P-10) and Phase B NSA Project (S-1), some of the Vineyard SWTP's existing capacity will be used to also supply the NSA. The future West Jackson GWTP will be used to supply the CSA, although it will be connected to the transmission system such that it could also provide supply to the NSA.

8.2.1.3 South Service Area

New groundwater supply capacity would be needed during Phase 1. Additional groundwater supply capacity would be added in Phases 2 and 3. No new surface water supply capacity is specifically planned for the SSA, although the planned Phase 3 expansion of the Vineyard SWTP would provide some additional surface water. The proposed GWTPs for Phase 3 would provide a maximum day groundwater supply capacity that exceeds the SSA's projected buildout maximum day demand. These Phase 3 GWTPs could be used to provide dry year groundwater supply to other areas or groundwater storage, or function as additional backup facilities.

8.2.1.4 Summary

Table 8-10 presents the maximum day demand and supply capacity comparison for Zone 40 from 2013 through buildout. The maximum day use of each type of supply is quantified for the wet/average years and dry years. As can be seen in Table 8-10 and consistent with the established conjunctive use program, the total supply capacity exceeds the maximum day demand for each phase, but neither the groundwater nor surface water supply capacity alone can meet the maximum day demand.

As shown in Table 8-10, Zone 40 will utilize a varying mixture of groundwater and surface water supplies on the maximum demand day based on whether it is a wet/average year or a dry year. The ability to practice conjunctive use by maximizing the use of surface water in wet and average years and minimizing the use of surface water in dry years is limited by the available surface water and groundwater supply capacities and to some extent by distribution system constraints. Several observations are made regarding the maximum day supply capacity and use that pertains to all three phases:

1. In dry years, there is sufficient groundwater capacity to be able to significantly reduce the amount of surface water use on the maximum day compared to wet/average years.
2. In dry years, most of the groundwater capacity will be utilized on the maximum demand day.
3. In wet years, there is sufficient surface water capacity to be able to supply over half of the maximum day demand.
4. In wet years, up to half of the groundwater capacity will be used to help supply the maximum day demand.

Table 8-10. Maximum Day Demand to Supply Comparison for Zone 40 - NewBridge, mgd

Zone 40	2013	Phase 1			Phase 2		Phase 3	
		2015	2020	2025	2030	2035	2050	Buildout (2050)
Maximum day demand								
Zone 40 total	61.5	69.1	81.2	96.2	112.1	128.0	166.4	166.4
Existing supply capacity								
Groundwater ^(a)	72.5	72.5	66.0	66.0	66.0	66.0	66.0	66.0
Surface water ^(b)	61.1	61.1	45.1	28.6	28.6	28.6	28.6	28.6
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
Total	136.6	136.6	114.1	97.6	97.6	97.6	97.6	97.6
Planned future supply capacity								
Groundwater	0.0	0.0	0.0	6.5	15.5	33.0	53.0	66.0
Surface water ^(b)	0.0	0.0	16.0	32.5	32.5	32.5	82.5	101.6
Recycled water							2.9	2.9
Total supply capacity								
Groundwater	72.5	72.5	66.0	72.5	81.5	99.0	119.0	132.0
Surface water	61.1	61.1	61.1	61.1	61.1	61.1	111.1	130.2
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	136.6	136.6	130.1	136.6	145.6	163.1	236.0	268.1
Use of supply: average/wet years								
Groundwater	20.4	25.8	21.1	46.4	56.8	64.7	56.1	37.0
Surface water	38.1	40.3	57.1	46.9	52.3	60.3	104.4	123.5
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	61.5	69.2	81.2	96.2	112.1	128.0	166.4	166.4
Use of supply: dry years								
Groundwater	58.5	64.3	60.4	68.5	76.7	92.3	104.3	104.3
Surface water	0.0	1.9	17.8	24.7	32.3	32.7	56.3	56.3
Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	61.5	69.1	81.2	96.2	112.1	128.0	166.4	166.4

^(a) Groundwater supply decrease in 2020 due to Anatolia GWTP removed from service.

^(b) Reduction in existing capacity and added future surface water supply capacity in 2020 and 2025 because planned delivery to NSA from existing Vineyard SWTP accounted as future supply capacity as requested by SCWA staff.

8.2.2 Annual Water Supply

Table 8-11 presents the annual supply to demand comparison for a normal climate year. Table 8-12 presents the annual supply to demand comparison for a single dry year and Table 8-13 presents the comparison for a multiple dry year. The presented supply values are the supplies available to Zone 40 assuming there are no facility supply capacity constraints. The facility improvements needed to expand existing supply capacity are presented in Section 8.3. Projections of the use of each supply source that consider supply facility capacity constraints for each service area for normal and dry years are presented in Appendix C.

Table 8-11. Supply and Demand Comparison-Normal Year - NewBridge, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
Appropriative water ^(a)	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
Difference	146,800	140,000	131,600	122,700	113,800	104,600	97,100	93,900	93,900

^(a) Only 35,000 ac-ft/yr assumed to be available without the construction of seasonal storage, as described in Section 4.2.2.

Table 8-12. Supply and Demand Comparison-Single Dry Year - NewBridge, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply allocation	11,300	16,000	13,100	14,700	16,900	19,400	22,000	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	101,500	106,200	103,300	104,900	107,100	109,600	112,200	114,300	114,300
Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
Difference	62,800	60,700	49,400	42,100	35,400	28,700	23,800	21,100	21,100

Table 8-13. Supply and Demand Comparison-Multiple Dry Years – NewBridge, ac-ft/yr

Year		2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
First year	Supplies									
	US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
	Appropriative water ^(a)	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
	City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
	Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
	Difference	146,800	140,000	131,600	122,700	113,800	104,600	97,100	93,900	93,900
Second year	Supplies									
	US Bureau of Reclamation-CVP supply	17,000	24,000	19,700	22,000	25,400	29,000	32,900	33,800	33,800
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	107,200	114,200	109,900	112,200	115,600	119,200	123,100	125,600	125,600
	Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
	Difference	68,500	68,700	56,000	49,400	43,900	38,300	34,700	32,400	32,400
Third year	Supplies									
	US Bureau of Reclamation-CVP supply	11,300	16,000	13,100	14,700	16,900	19,400	22,000	22,500	22,500
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	101,500	106,200	103,300	104,900	107,100	109,600	112,200	114,300	114,300
	Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
	Difference	62,800	60,700	49,400	42,100	35,400	28,700	23,800	21,100	21,100

^(a) Only 35,000 ac-ft/yr assumed to be available without the construction of seasonal storage, as described in Section 4.2.2.

As can be seen in Tables 8-11, 8-12, and 8-13, as well as in Appendix C, the total water supply is greater than the projected demands. This analysis verifies the sufficiency of the water supply for the NewBridge scenario.

8.2.3 Storage and Pumping Station Capacity Evaluation

Table 8-14 and 8-15 presents a summary comparison of the planned to required storage volume and pumping station capacities for this scenario. As shown in Tables 8-14 and 8-15, the planned storage facilities provide more than the required storage volumes and pump station capacities. The detailed storage evaluation tables for each pressure zone are presented in Appendix C.

Table 8-14. Zone 40 Storage Capacity Evaluation Summary				
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2050)
Provided storage volume, MG				
Existing	42.2	42.2	42.2	42.2
Future	0.0	13.5	17.5	36.0
Total	42.2	55.7	59.7	78.2
Required storage volume, MG				
Equalization	12.3	19.0	25.2	32.1
Fire	3.8	3.8	3.8	3.8
Emergency	10.3	15.8	21.0	26.8
Total	26.4	38.6	50.1	62.7
Difference (provided minus required)	15.8	17.1	9.6	15.5


Table 8-15. Zone 40 Pump Station Capacity Evaluation Summary				
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2050)
Provided pump station capacity from storage, mgd				
Existing	107.6	118.2	112.3	102.7
Future	0.0	20.5	32.6	88.1
Total	107.6	138.7	144.9	190.8
Required pump station capacity from storage, mgd				
	65.8	96.6	126.2	160.6
Difference (provided minus required)	41.8	42.1	18.7	30.2


8.3 Water System Facilities and Capital Improvement Program

This section describes the water system facilities needed to supply the NewBridge scenario, develops the costs, and presents the CIP for Phases 1, 2, and 3.

8.3.1 Needed Water System Facilities

The water system facilities needed to serve the Phase 1, 2, and 3 demands are the same as the facilities defined for Baseline scenario. The exception is that additional pipelines would be needed in the NSA to supply the NewBridge development. The locations of the Phase 1 projects in the NSA are shown on Figure 8-6. To supply NewBridge, a series of pipelines would be constructed to initially convey water supply from the Anatolia groundwater treatment and storage facility and subsequently from the future NSA terminal storage tank (P-1 and P-3). These pipelines would be sized to convey supply to meet peak hour and maximum day plus fire flow demands. The locations of the Phase 1 projects in the CSA and SSA are shown on Figure 8-7. The locations of the Phase 2 and 3 projects in the NSA are shown on Figure 8-8. The locations of the Phase 2 and 3 projects in the CSA and SSA are shown on Figure 8-9.

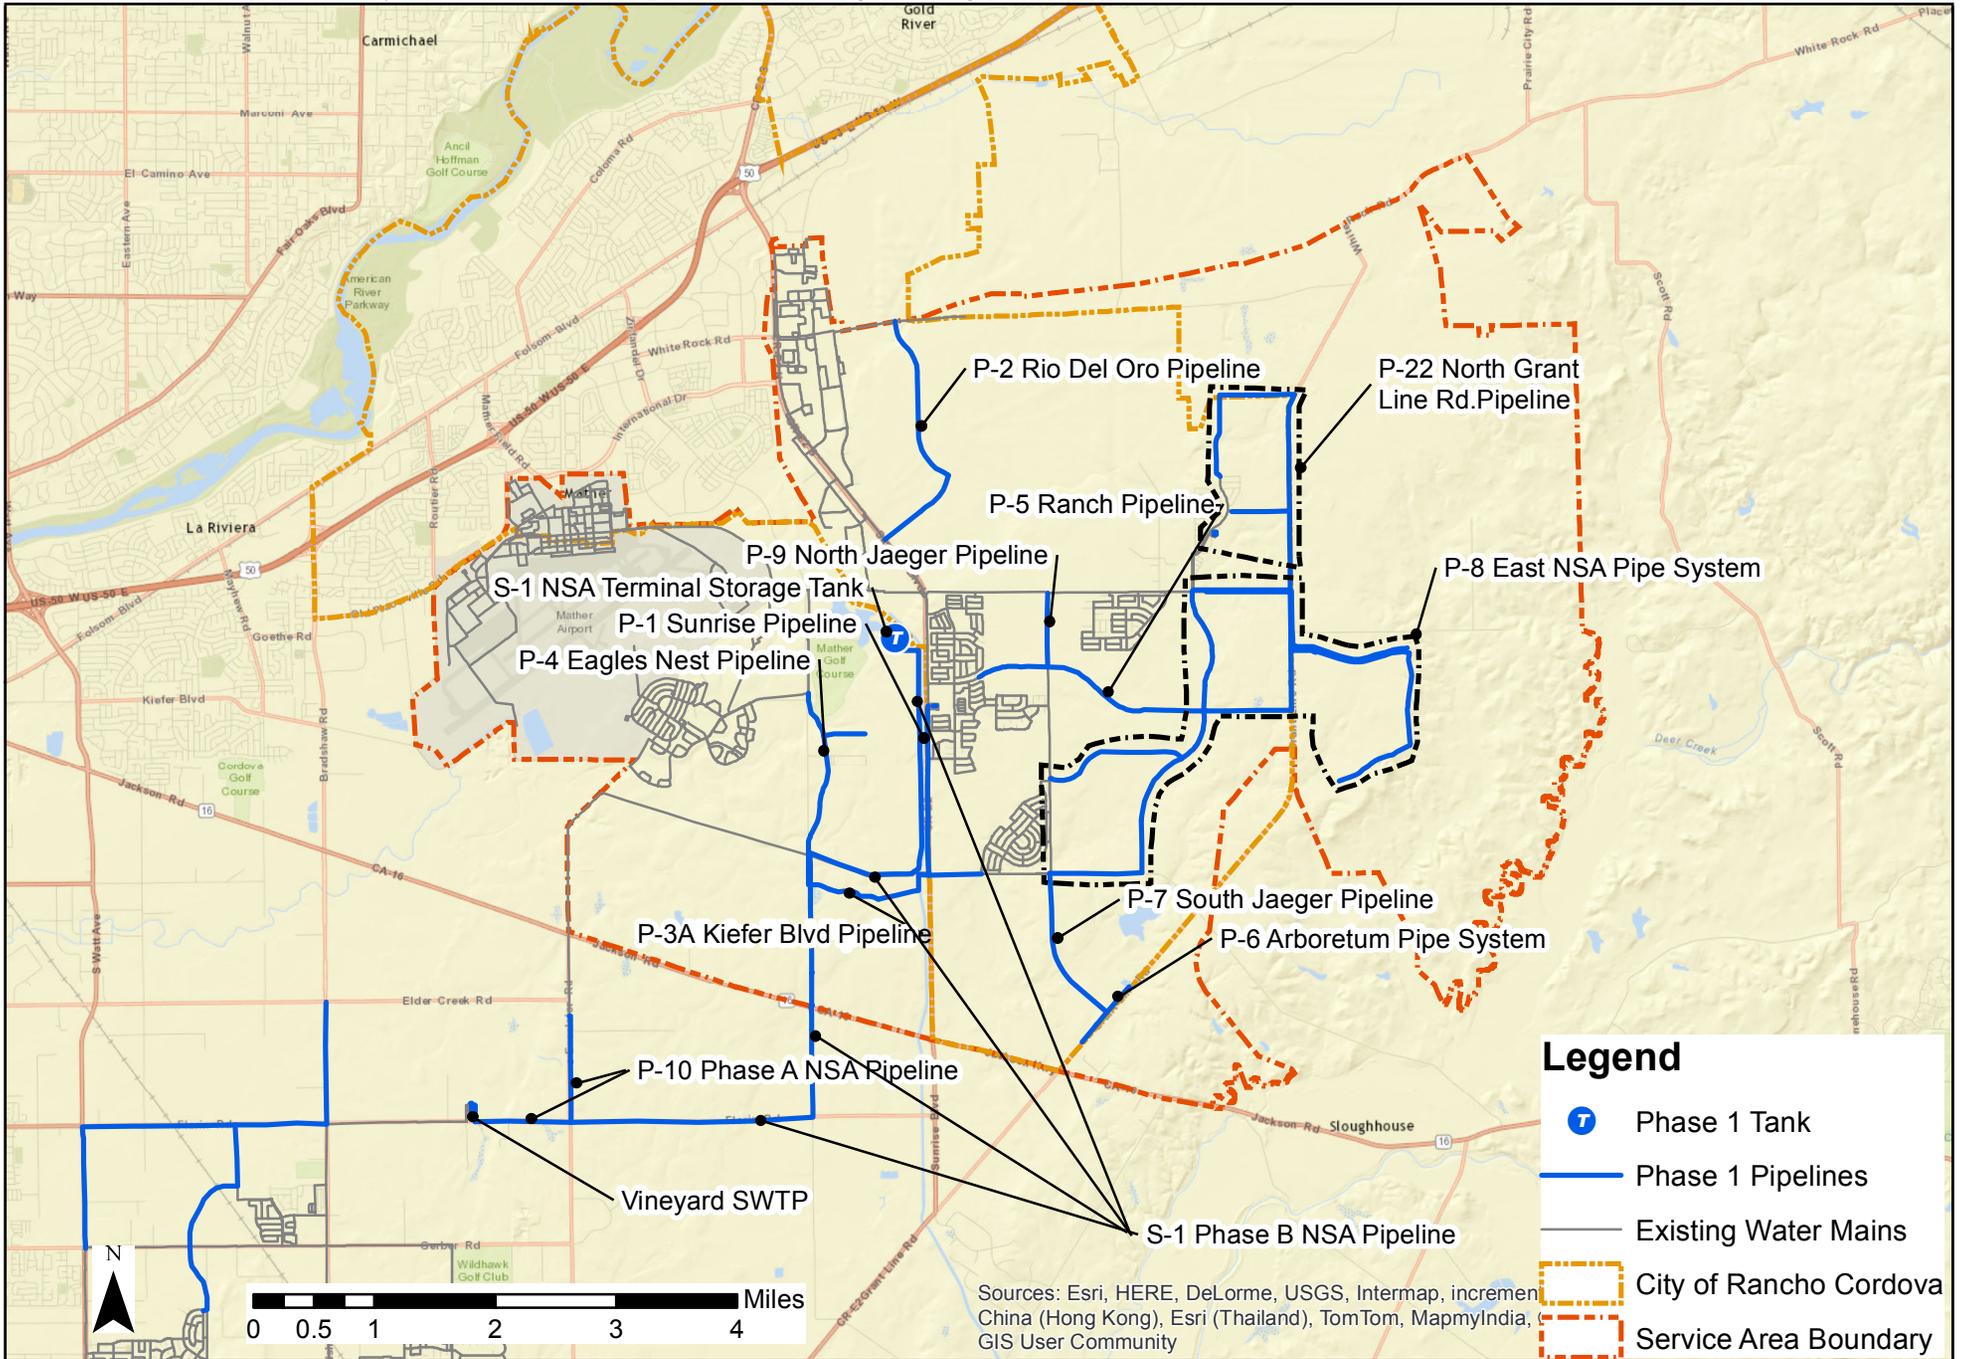

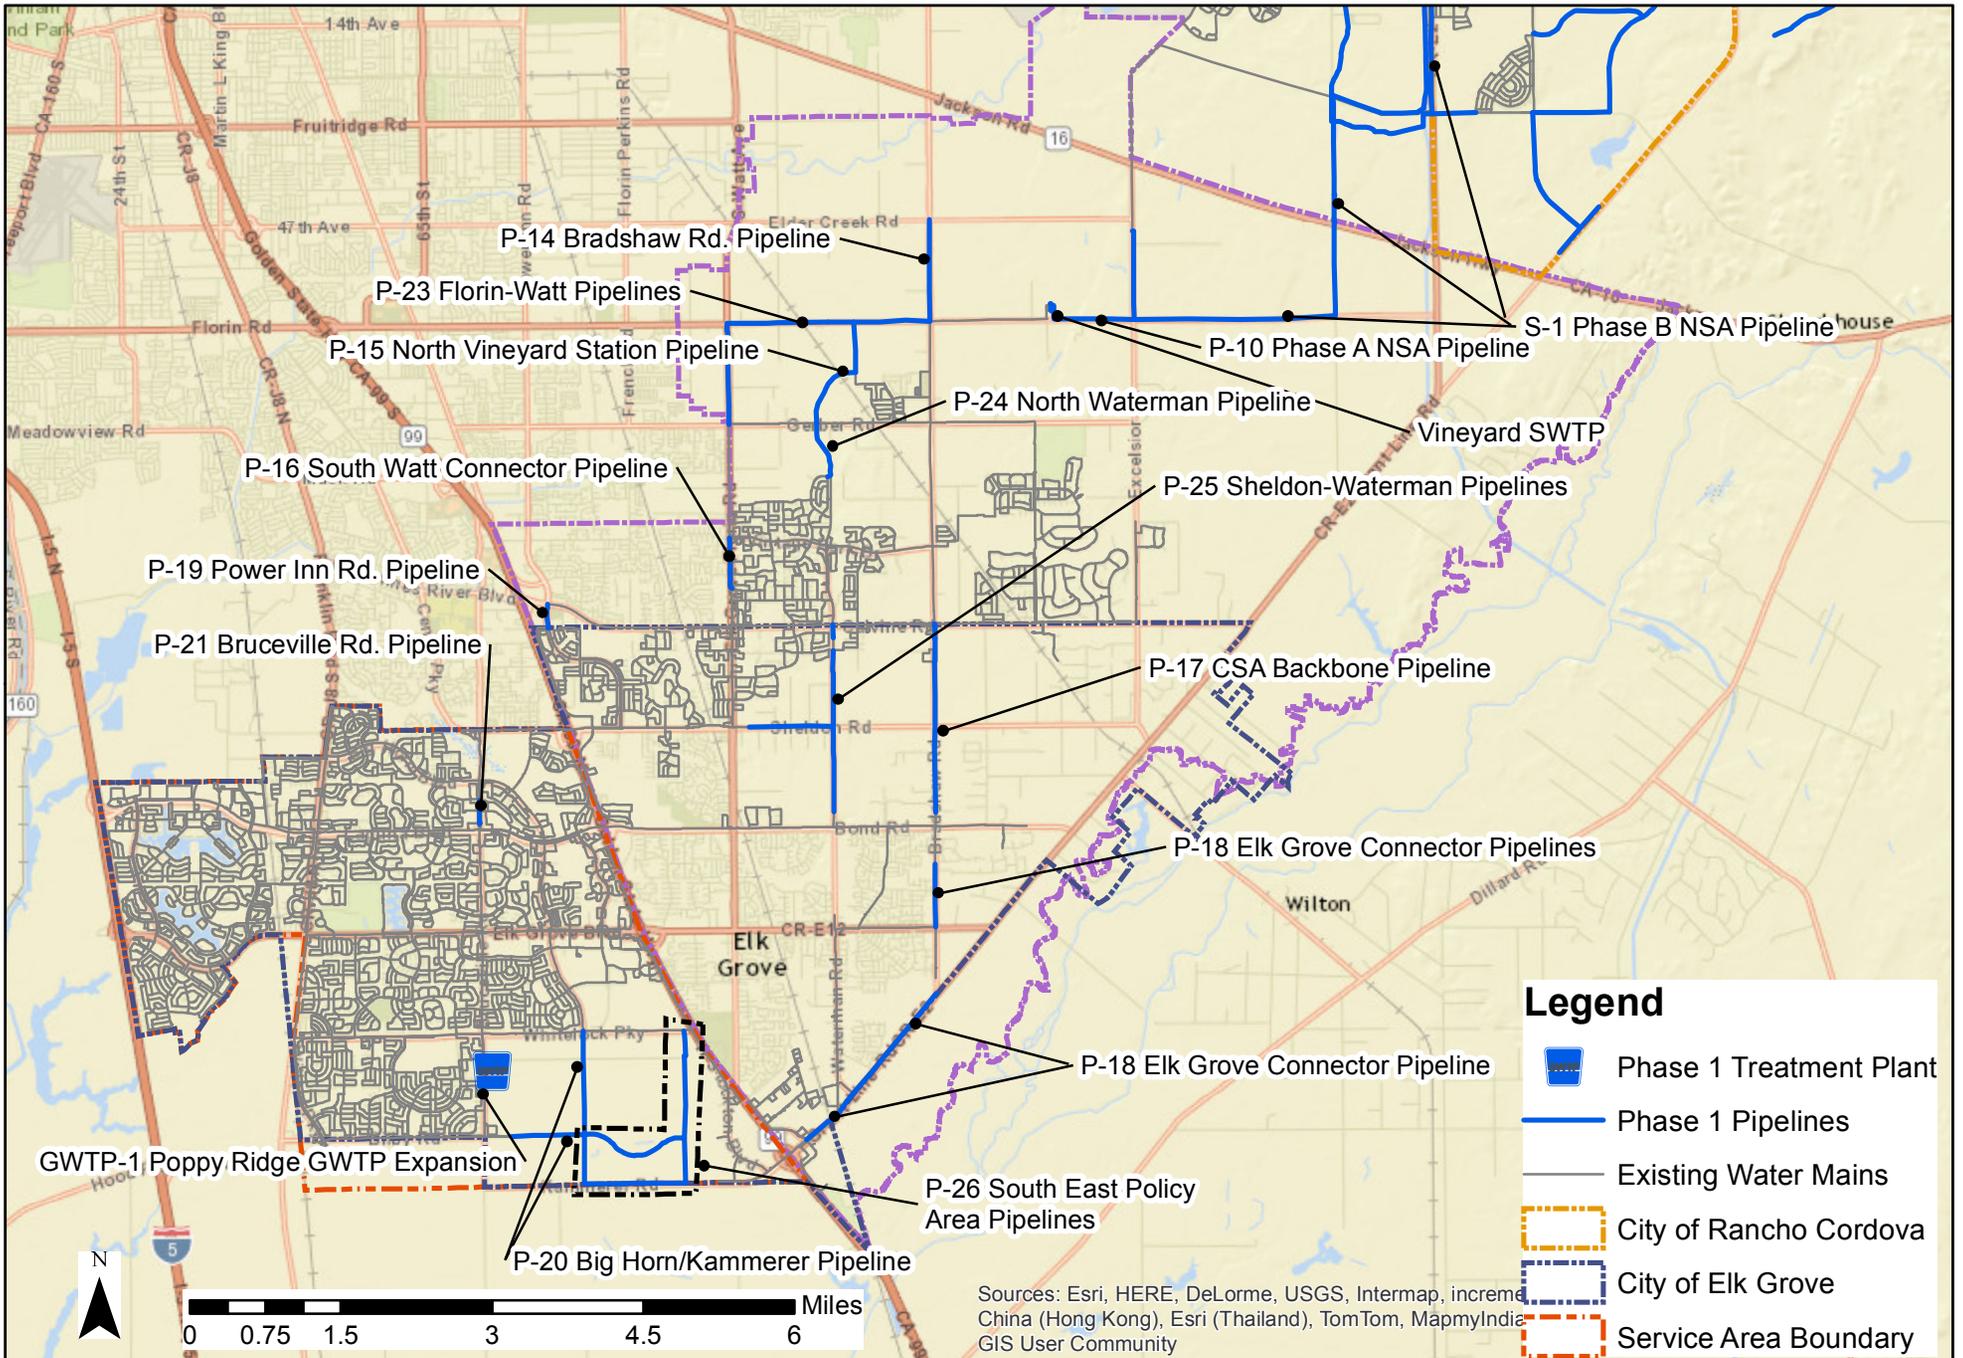

PROJECT
143542

DATE
8/4/15


SITE

TITLE

Water Supply Master Plan Amendment

Phase 1 CIP Projects - CSA & SSA, NewBridge


Figure 8-7

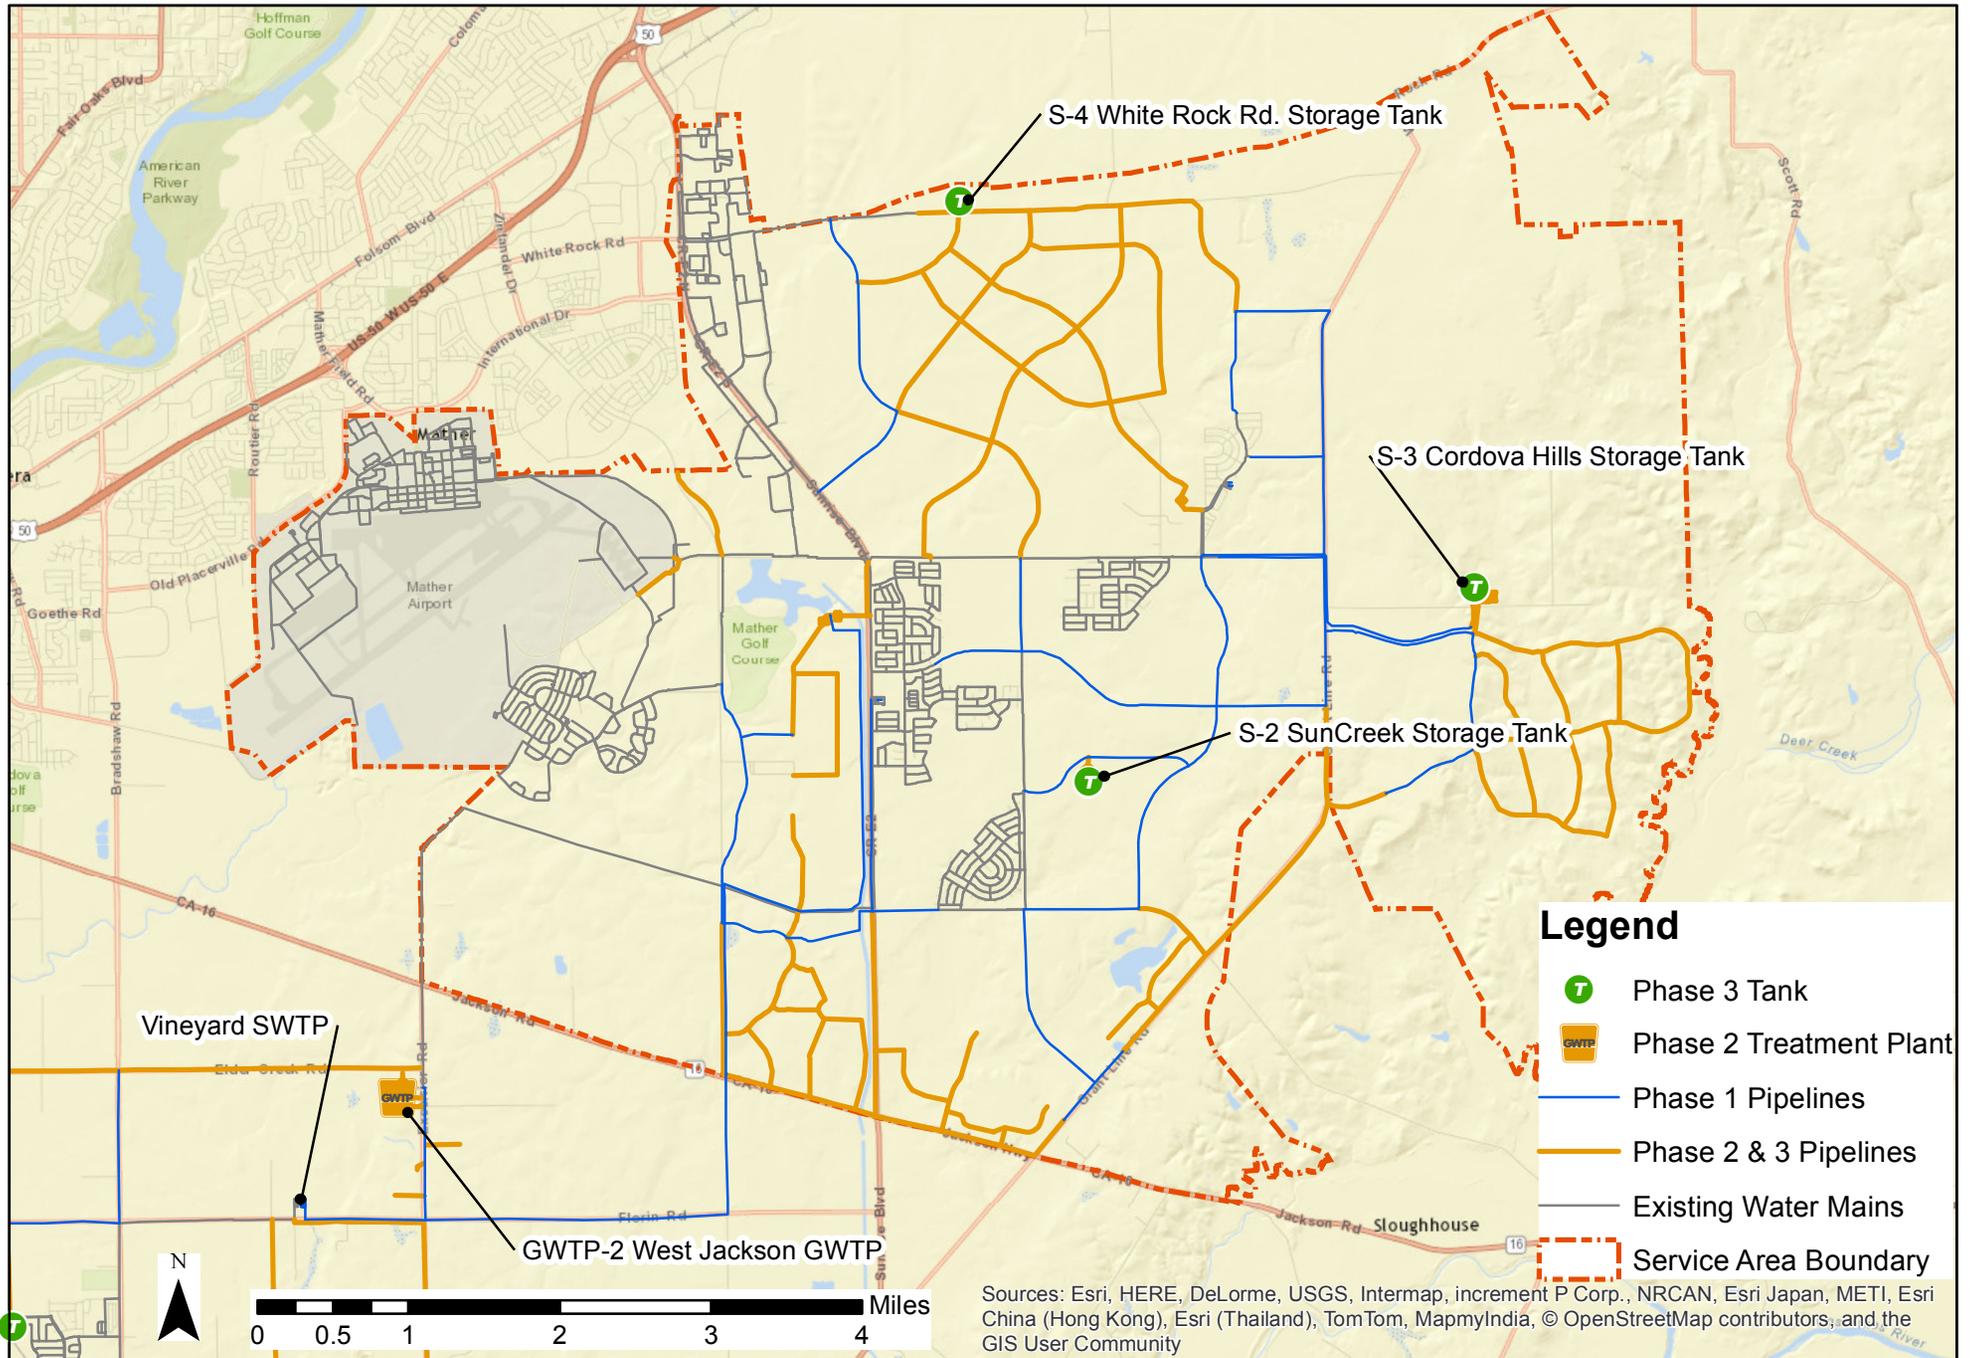

- Legend**
- T Phase 3 Tank
 - GWTP Phase 2 Treatment Plant
 - Phase 1 Pipelines
 - Phase 2 & 3 Pipelines
 - Existing Water Mains
 - - - Service Area Boundary

Sources: Esri, HERE, DeLorme, USGS, Intermap, increment P Corp., NRCAN, Esri Japan, METI, Esri China (Hong Kong), Esri (Thailand), TomTom, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

 DEPARTMENT OF WATER RESOURCES SACRAMENTO COUNTY WATER AGENCY	PROJECT 143542	SITE	Water Supply Master Plan Amendment Phase 2 & 3 CIP Projects - NSA, NewBridge	Figure 8-8
	DATE 8/4/15	TITLE		

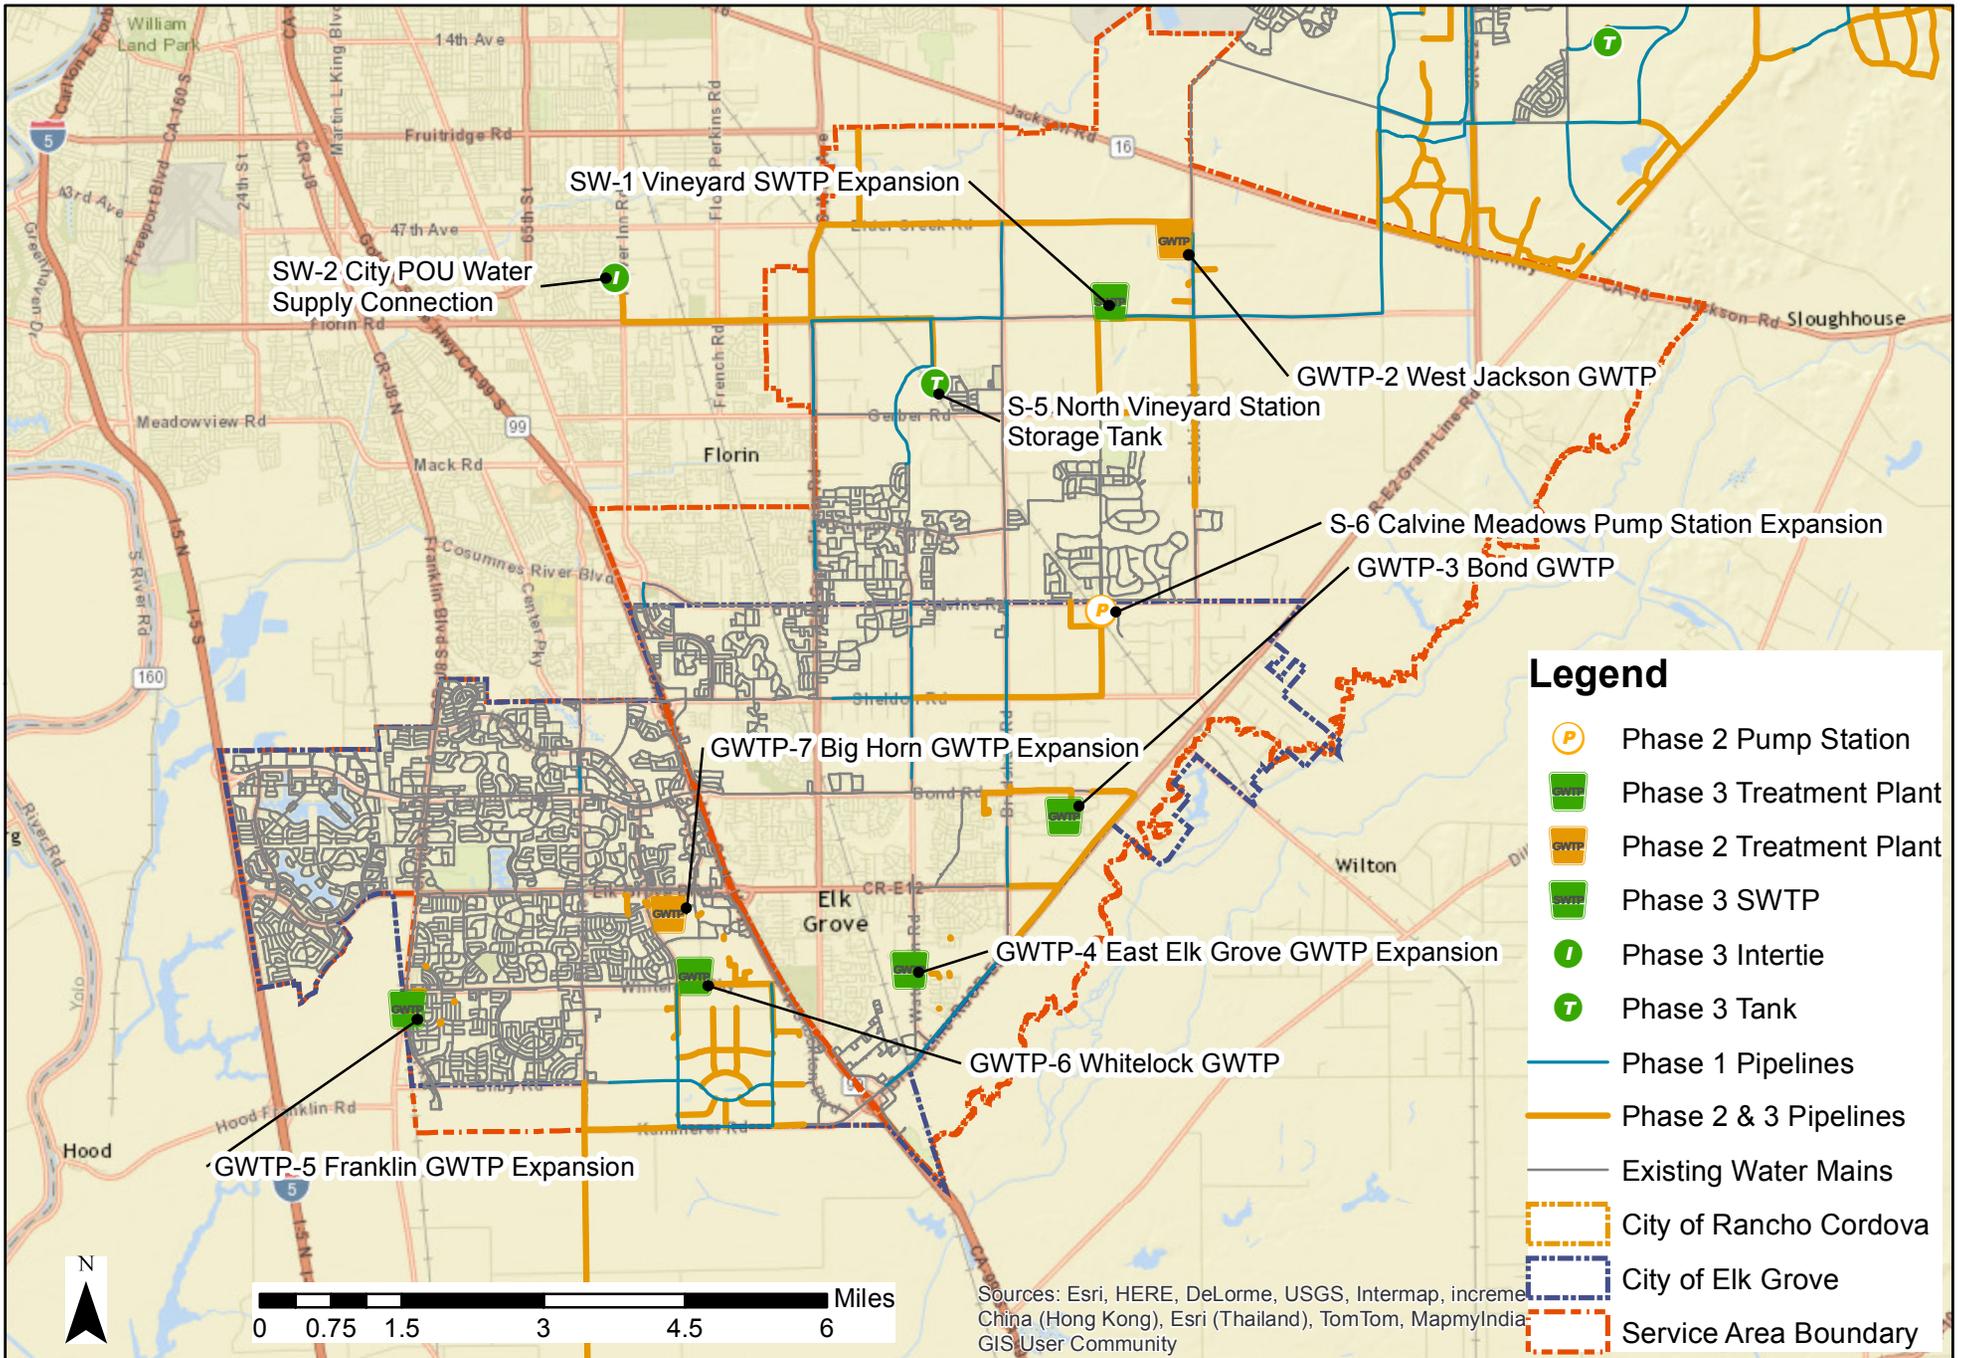

Sources: Esri, HERE, DeLorme, USGS, Intermap, increment P Corp., GEBCO, China (Hong Kong), Esri (Thailand), TomTom, MapmyIndia, © 2015 DeLorme, GeoEye, (GeoEye), Swire, (Swire), IGN, (IGN), the GIS User Community

 DEPARTMENT OF WATER RESOURCES SACRAMENTO COUNTY WATER AGENCY	PROJECT	SITE	Water Supply Master Plan Amendment Phase 2 & 3 CIP Projects - CSA & SSA, NewBridge	Figure 8-9
	DATE	TITLE		
	143542			
	8/4/15			

The future water system facilities are categorized as supply facilities, storage facilities, and pipelines. Table 8-16 presents the planned water supply facilities for all of Zone 40. Each GWTP project consists of wells, a groundwater treatment facility, a storage tank, and a pump station that pumps from the storage tank into the distribution system. Some of the GWTP projects already have wells that were previously drilled but not equipped and some would require the equipping and drilling of new wells. Table 8-16 presents the number of wells that would be equipped and/or drilled and equipped for the pertinent GWTP projects.

Table 8-17 presents the storage facility projects planned for Zone 40. Table 8-18 presents the pipeline projects that are 16 inches in diameter or larger planned for Phase 1 for all of Zone 40, and identifies the pipelines needed to serve NewBridge. Table 8-19 presents the pipelines that would be needed during Phases 2 and 3 for all of Zone 40.

Table 8-16. Additional Supply Facilities – NewBridge

	Supply facility	Treatment/ supply capacity, mgd	Wells		Storage, MG	Pumping station capacity, mgd	Area served	Phase added
			Wells to be drilled and equipped	Wells to be equipped only (already drilled)				
GWTP-1	Poppy Ridge GWTP expansion	6.5		3	3.5	17.0	SSA	Phase 1
GWTP-2	West Jackson GWTP	18.0	5		4.0	21.6	CSA	Phase 2
SW-1	Vineyard WTP expansion	50.0					NSA/CSA	Phase 3
GWTP-3	Bond GWTP	6.5	3		0.5	10.8	CSA	Phase 3
GWTP-4	East Elk Grove GWTP expansion	6.5	2	1		13.0	CSA	Phase 3
SW-2	City POU water supply facilities	19.1					CSA	Phase 3
GWTP-5	Franklin GWTP	7.0	1	3	2.0	21.6	SSA	Phase 3
GWTP-6	Whitelock GWTP	13.0	6		3.0	14.4	SSA	Phase 3
GWTP-7	Big Horn GWTP expansion	8.5	4			17.0	SSA	Phase 2
RW-1	Recycled water supply	4.0					SSA	Phase 3
	Total	139.1	21	7	13.0	115.4		

Table 8-17. Additional Storage Facilities – NewBridge

	Storage facility	Capacity, MG	Pumping station, mgd	Area served	Phase added
S-1	Phase B NSA Project	10.0	64.0	NSA	1
S-2	Suncreek	3.0	18.0	NSA	3
S-3	Cordova Hills	3.0	21.6	NSA	3
S-4	White Rock	3.0	14.4	NSA	3
S-5	North Vineyard Station	4.0	21.6	CSA	3
S-6	Calvine Meadows Pump Station Expansion		7.2	CSA	3
	Total	23.0	146.8		

Table 8-18. Phase 1 Pipelines - NewBridge					
	Pipeline	Size, in	Length, ft	Area served	NewBridge^(a)
P-1	Sunrise Blvd. Pipeline	16	7,371	NSA	X
P-2	Rio del Oro Pipeline	24	11,593	NSA	
P-3A	Shortened Kiefer Blvd. Pipeline	18-24	9,956	NSA	X
P-4	Eagles Nest Road Pipeline	20-30	7,239	NSA	
P-5	Ranch Pipeline	24	7,000	NSA	
P-6	Arboretum Pipe System	16	3,167	NSA	
P-7	South Jaeger Pipeline	16	5,238	NSA	
P-8	East NSA Pipeline System	16-30	61,389	NSA	
P-9	North Jaeger Pipeline	24	6,365	NSA	
P-10	Phase A NSA Project	42-66	44,662	NSA	X
P-14A	Bradshaw Road Pipeline	16-24	5,300	CSA	
P-15	North Vineyard Station (Florin to Gerber) Pipeline	24-36	11,847	CSA	
P-16	South Watt Connect Pipeline	24	2,693	CSA	
P-17	CSA Backbone Pipeline	24-30	9,948	CSA	
P-18	Elk Grove Loop Connector Pipelines	16-24	11,322	CSA	
P-19	Power Inn Road Pipeline	24	1,273	CSA	
P-20	Big Horn to Kammerer Pipeline	20	7,832	SSA	
P-21	Bruceville Road Pipeline	18	1,267	SSA	
P-22	North Grant Line Road Pipeline	20-24	17,000	NSA	
P-23	Florin-Watt Pipelines	20-24	10,000	CSA	
P-24	North Waterman Pipeline	16	3,000	CSA	
P-25	Sheldon-Waterman Pipelines	18-24	15,000	CSA	
P-26	South East Policy Area Pipelines	18-24	22,000	SSA	
	Total	--	282,462	--	--

^(a) Pipelines that are needed to serve the new growth area are identified with an "X".

Table 8-19. Phase 2 and 3 Pipelines – NewBridge	
Pipeline size, in	Length, ft
16	105,319
18	7,863
20	-
24	64,864
30	4,681
36	29,502
42	3,371
54	40,704
Total	256,304

8.3.2 Capital Improvement Plan

This section presents the CIP for Phases 1, 2, and 3.

8.3.2.1 Phase 1 CIP – 10 Year Plan (FY 2015-16 to 2024-25)

The Phase 1 CIP represents the projects that will be constructed over the near term time period and provides the basis for the development of the capacity charge. The development of the Phase 1 CIP requires consideration of the timing and duration of each project. The Phase 1 CIP consists of groundwater, storage, and pipeline projects. No surface water and stand alone storage projects are planned for Phase 1, other than the storage that is part of the GWTP project.

Table 8-20 presents the estimated costs of the Phase 1 water facilities for all of Zone 40. Included in the Phase 1 CIP is an item for non-specific project costs that cover the labor costs of SCWA’s planning, development, and development sections.

The timing of the Phase 1 projects presented in Table 8-20 are based on information SCWA has received from developers’ engineers regarding the timing of development projects and keeping a somewhat consistent rate of annual expenditure over the duration of Phase 1. The cost of each project would occur over a duration of several years. All of the projects would be completed by the time the end of Phase 1 is reached.

Table 8-20. Phase 1 CIP Cost Estimate - NewBridge

Projects		Service area	Capital cost	Project timing	
No.	Name			Start, FY	End, FY
Groundwater projects (SCWA projects)					
GWTP-1	Poppy Ridge GWTP Expansion	SSA	\$13,832,800	2016	2018
	Well site acquisitions	CSA/SSA	\$180,000	2018	2023
	subtotal		\$14,012,800		
Regional transmission and storage projects (SCWA projects)					
S-1	Phase B NSA Project	NSA	\$84,586,140	2016	2023
P-10	Phase A NSA Project	NSA	\$10,088,000	2016	2019
	Tank site acquisition	NSA	\$800,000	2017	2018
	subtotal		\$95,474,140		
Pipeline projects (Developer projects)					
P-1	Sunrise Blv. Pipeline	NSA	\$2,527,900	2018	2020
P-2	Rio del Oro Pipeline	NSA	\$3,663,200	2016	2018
P-3A	Kiefer Boulevard Pipeline	NSA	\$4,775,500	2020	2022
P-4	Eagles Nest Road Pipeline	NSA	\$3,779,200	2019	2021
P-5	Ranch Pipeline	NSA	\$2,202,300	2023	2025
P-6	Arboretum Pipe System	NSA	\$1,104,300	2021	2023
P-7	South Jaeger Pipeline	NSA	\$1,145,500	2020	2022
P-8	East NSA Pipeline System	NSA	\$18,212,400	2016	2021
P-9	North Jaeger Pipeline	NSA	\$2,027,300	2017	2018
P-14A	Bradshaw Road Pipeline	CSA	\$2,724,200	2017	2019
P-15	North Vineyard Station (Florin to Gerber) Pipeline	CSA	\$5,025,600	2018	2020
P-16	South Watt Connect Pipeline	CSA	\$1,742,400	2019	2021
P-17	CSA Backbone Pipeline	CSA	\$5,008,300	2023	2025
P-18	Elk Grove Loop Connector Pipelines	CSA	\$4,715,500	2023	2025
P-19	Power Inn Road Pipeline	CSA	\$584,300	2024	2025
P-20	Big Horn to Kammerer Pipeline	SSA	\$2,494,500	2017	2019
P-21	Bruceville Road Pipeline	SSA	\$509,400	2024	2025
P-22	North Grant Line Road Pipeline	NSA	\$4,588,800	2022	2024
P-23	Florin-Watt Pipelines	CSA	\$4,150,400	2023	2025
P-24	North Waterman Pipeline	CSA	\$568,900	2019	2020
P-25	Sheldon-Waterman Pipelines	CSA	\$5,685,700	2022	2025
P-26	South East Policy Area Pipelines	SSA	\$5,868,800	2021	2024

Table 8-20. Phase 1 CIP Cost Estimate - NewBridge					
Projects		Service area	Capital cost	Project timing	
No.	Name			Start, FY	End, FY
	subtotal		\$82,477,000		
Non-specific project costs			\$30,000,000	2016	2025
Studies					
	Recycled Water Master Plan		\$250,000	2016	2025
	Water Master Plan		\$400,000	2016	2025
	EIR		\$500,000	2016	2025
	subtotal		\$1,150,000		
Total			\$223,113,940		

8.3.2.2 Phase 2 CIP – 10 Year Plan (2026 to 2035)

Phase 2 represents the 10 year period following the end of Phase 1. Since Phase 2 is further in the future, the timing of projects is more speculative and less precise. The level of precision provided in the Phase 1 CIP is not needed for Phase 2 since the capacity charges are developed using the Phase 1 CIP costs and not the CIP costs from the subsequent phases.

The new pipelines that are needed for Zone 40 during Phases 2 and 3 are defined. However, the timing of when each pipeline project is needed is dependent on the location and timing of development. Therefore, this document does not identify the specific pipe segments that would need to be constructed in either Phase 2 or 3. The approach used for the development of the CIP is to assume that approximately half the cost of the Phases 2 and 3 pipelines would occur in Phase 2 and half would occur in Phase 3. Table 8-21 presents the cost estimate for the Phases 2 and 3 pipelines for all of Zone 40.

Table 8-22 presents the cost estimate for the Phase 2 CIP projects for all of Zone 40. The Phase 2 CIP consists of groundwater and pipeline projects. No surface water projects are planned for Phase 2.

Table 8-21. Phases 2 and 3 Pipeline Cost Estimate – NewBridge		
Diameter, in	Length, ft	Capital cost
16	105,319	\$43,952,717
18	7,863	\$3,715,324
20	-	\$-
24	64,864	\$34,939,742
30	4,681	\$3,183,996
36	29,502	\$23,756,153
42	3,371	\$3,160,832
54	40,704	\$57,396,135
Total	256,304	\$170,104,900

Table 8-22. Phase 2 CIP – NewBridge			
Projects		Service area	Capital cost
No.	Name		
Groundwater projects			
GWTP-2	West Jackson GWTP	CSA	\$28,932,200
GWTP-7	Big Horn GWTP Expansion	SSA	\$14,744,100
Pipeline projects		NSA/CSA/SSA	\$85,052,450
Total			\$128,728,750

8.3.2.3 Phase 3 CIP – 17 Year Plan (2036 – Buildout)

The Phase 3 CIP consists of surface water, groundwater, recycled water, storage, and pipeline projects. Table 8-23 presents the cost estimate for the Phase 3 CIP projects for all of Zone 40. The cost estimate for the City POU supply connection (SW-2) is for the construction of the interconnection and the pipeline to convey the water into the CSA’s water transmission system. It does not include the City’s capacity buy-in cost that was estimated in 2005 to be \$32 million.

Table 8-23. Phase 3 CIP – NewBridge			
Projects		Service area	Capital cost
No.	Name		
Surface water projects			
SW-1	Vineyard WTP Expansion	NSA/CSA	\$200,000,000
SW-2	City POU Supply Connection ^(a)	CSA	\$2,034,400
	subtotal		\$202,034,400
Groundwater projects			
GWTP-3	Bond GWTP	CSA	\$14,725,800
GWTP-4	East Elk Grove GWTP Expansion	CSA	\$13,687,000
GWTP-5	Franklin GWTP	SSA	\$18,544,000
GWTP-6	Whitelock GWTP	SSA	\$26,143,800
	subtotal		\$73,100,600
Recycled water projects			
RW-1	Recycled Water Project	SSA	\$20,000,000
Storage projects			
S-2	Suncreek Storage	NSA	\$11,864,500
S-3	Cordova Hills Storage	NSA	\$12,848,700
S-4	White Rock Road Storage	NSA	\$10,880,400
S-5	North Vineyard Station Storage	CSA	\$5,467,500

Table 8-23. Phase 3 CIP – NewBridge			
Projects		Service area	Capital cost
No.	Name		
S-6	Calvine Meadows Pump Station Expansion	CSA	\$5,084,800
	subtotal		\$46,145,900
Pipeline projects		NSA/CSA/SSA	\$85,052,450
Total			\$426,333,350

^(a) Does not include the City's capacity buy-in cost

8.3.2.4 CIP Summary

Table 8-24 summarize the Zone 40 CIP costs by project category and phase. The Phases A and B NSA projects in Phase 1 have been categorized as storage projects for the purposes of Table 8-24.

Table 8-24. Zone 40 CIP Cost Summary – NewBridge				
Project Categories	Phase 1	Phase 2	Phase 3	Total
Surface water projects			\$202,034,400	\$202,034,400
Groundwater projects	\$14,012,800	\$43,676,300	\$73,100,600	\$130,789,700
Recycled water projects			\$20,000,000	\$20,000,000
Storage projects	\$95,474,140		\$46,145,900	\$141,620,040
Pipeline projects	\$82,477,000	\$85,052,450	\$85,052,450	\$252,581,900
Non-specific project costs	\$30,000,000			\$30,000,000
Studies	\$1,150,000			\$1,150,000
Total	\$223,113,940	\$128,728,750	\$426,333,350	\$778,176,040

Section 9

Cumulative

This section describes the demographics, water demands, water supplies, and needed water system improvements for the Cumulative scenario.

9.1 Water Demands

This section describes the land use, demographics, and demand projections for the Cumulative scenario.

9.1.1 Buildout Demographics

This section describes the projected developed area and demographics for the proposed NewBridge, West Jackson, and Jackson Township new growth areas and for the overall Cumulative scenario.

9.1.1.1 New Growth Areas

Two of the growth areas, Jackson Township and NewBridge, are located within the NSA. One of the growth areas, West Jackson, is located within the CSA. The source of land use information is shown below in Table 9-1. This land use information is the basis of the acreage, demographic, and population estimates described in this section, as well as the water demand projection.

Table 9-1. Sources of Land Use Information for the New Growth Areas	
Subarea name	Agency providing land use data and date
NSA	
NewBridge	MacKay & Soms, 4/30/13
Jackson Township	Au Clair Consulting, 4/30/13
CSA	
West Jackson	Wood Rodgers, 4/30/13

The demographics and water demands for the proposed developments were estimated based on the amount of acreage by land use category obtained from the source of land use information presented in Table 9-1. It is anticipated that the land use plans for the proposed development will possibly be revised, perhaps several times, before final approval. It is anticipated that these revisions would not significantly change the overall total buildout water demand for Zone 40 from the projections presented in this report, as well as the planned water system improvements. If the land use changes and resulting demographics, water demands, and facility needs are determined to be significant, the report would be amended as necessary. The number of connections and dwelling units and the population for each growth area were estimated based on the acreage by land use category. The amount of acreage by land use category was calculated by SCWA staff.

NewBridge


The NewBridge growth area consists of 1,100 acres that are proposed to be used for residential, commercial/office, open space, and public uses. Public uses include an elementary school, electric facility, and fire station as well as a park and community garden. Residential land uses include low, medium, and high density residential units and some acreage for mixed use.

Currently in this area there is a rendering plant site owned by the Sacramento Rendering Company, rural uses, a cemetery and pet cemetery, and a small electric facility operated by SMUD in the southwest corner of the site near the Folsom South Canal. The remainder of the site is non-irrigated lands, wetlands, and river riparian areas.

Proposed land uses and estimates for buildout connections, DUs, and population are shown in Table 9-2. The proposed land uses are illustrated on Figure 9-1.

Table 9-2. Land Use Area and Buildout Demographics for the NewBridge Area				
Land use category	Buildout gross area from GIS, acres	Connections	Dwelling units	Population
Rural estate	-	-	-	-
Single family	236	1,047	1,047	3,456
Multi-family - low density	119	132	1,322	3,636
Multi-family - high density	42	59	890	2,270
Commercial	38	17	-	-
Industrial	-	-	-	-
Public	13	1	-	-
Public recreation	44	41	-	-
Mixed land use	13	6	-	-
Right-of-way	48	45	-	-
Self-supported/supplied by others				
Non-irrigated	439	-	-	-
Industrial-unutilized	-	-	-	-
Agricultural	106	-	-	-
Total	1,100^(a)	1,300^(a)	3,300^(a)	9,400^(a)

^(a) Totals are rounded to the 100's place.

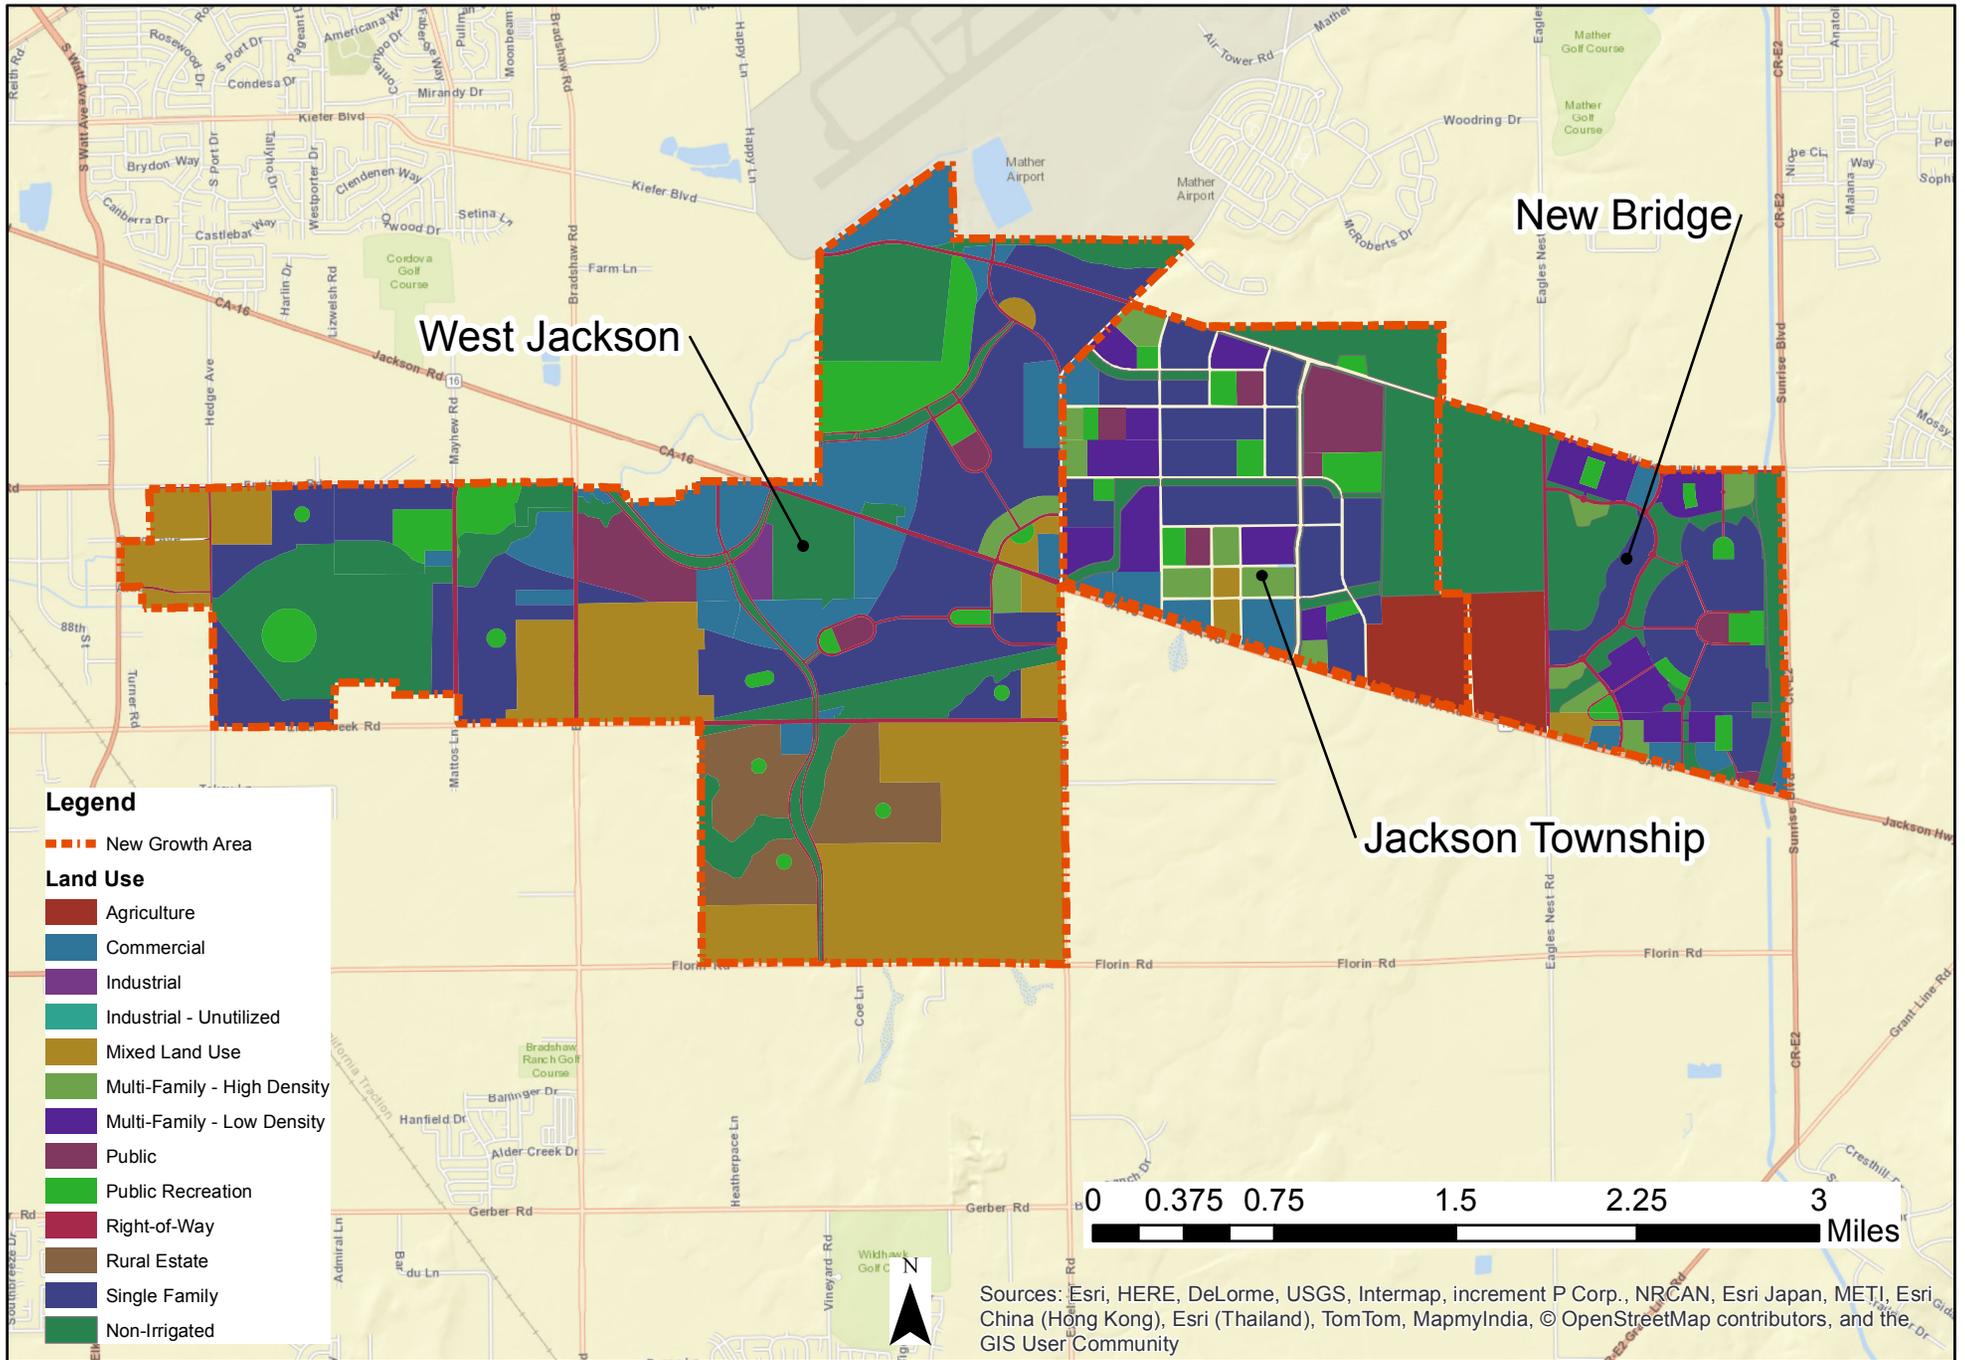

 	PROJECT 148130	SITE	Zone 40 Water Supply Master Plan Amendment New Growth Areas Land Use	Figure 9-1
	DATE 7/29/15	TITLE		

Jackson Township

The Jackson Township growth area consists of 1,300 acres that are proposed for the development of residential, commercial, office and mixed use buildings, elementary schools, a joint middle/high school, a fire station and community center, parks, wetland space, open space, and agriculture. Currently the land is used for agriculture as well as the Sacramento Raceway.

Proposed land uses and estimates for buildout connections, DUs, and population are shown in Table 9-3. The proposed land uses are illustrated on Figure 9-1.

Table 9-3. Land Use Area and Buildout Demographics for the Jackson Township Area

Land use category	Buildout gross area from GIS, acres	Connections	Dwelling units	Population
Rural estate	-	-	-	-
Single family	348	1,541	1,541	5,085
Multi-family - low density	157	175	1,745	4,799
Multi-family - high density	84	118	1,777	4,531
Commercial	90	40	-	-
Industrial	-	-	-	-
Public	5	0	-	-
Public recreation	176	163	-	-
Mixed land Use	20	9	-	-
Right-of-way	-	-	-	-
Self-supported/supplied by others	0	0	-	-
Non-irrigated	280	-	-	-
Industrial-unutilized	-	-	-	-
Agricultural	110	-	-	-
Total	1,300 ^(a)	2,000 ^(a)	5,100 ^(a)	14,400 ^(a)

^(a) Totals are rounded to the 100's place.

West Jackson

The West Jackson growth area within Zone 40 consists of 4,100 acres proposed for the development of residential property, mixed land uses, and commercial and office land uses, with the remainder for recreation, public, and non-irrigated lands. The portion of West Jackson that is outside of the Zone 40 service area will be served water by Cal Am and is not included in this analysis. The area currently is made up of existing and former mining properties and rural residential, agricultural, and industrial land use types. Most of the mining activities have been completed and the mining sites reclaimed, but some of the properties are still used for mining related activities.

Proposed land uses and estimates for buildout connections, DUs, and population are shown in Table 9-4. The proposed land uses are illustrated on Figure 9-1.

Table 9-4. Land Use Area and Buildout Demographics for the West Jackson Area

Land use category	Buildout gross area from GIS, acres	Connections	Dwelling units	Population
Rural estate	256	107	107	352
Single family	914	4,048	4,048	13,360
Multi-family - low density	-	-	-	-
Multi-family - high density	34	47	710	1,810
Commercial	441	198	-	-
Industrial	21	9	-	-
Public	-	-	-	-
Public recreation	341	316	-	-
Mixed land Use	1,006	451	-	-
Right-of-way	297	275	-	-
Self-supported/supplied by others				
Non-irrigated	838	-	-	-
Industrial-unutilized	-	-	-	-
Agricultural	-	-	-	-
Total	4,100 ^(a)	5,500 ^(a)	4,900 ^(a)	15,500 ^(a)

^(a) Totals are rounded to the 100's place.


9.1.1.2 Cumulative Scenario

The 2010 and buildout developed land use acreages by land use category are summarized in Table 9-5. The acreages presented in Table 9-5 are net acres for 2010 and gross acres for the study area at buildout. The buildout land use for the study area is illustrated on Figure 9-2.

Table 9-5. 2010 and Buildout Area By Land Use - Cumulative

Land use category	2010 developed area, net acres	Buildout area, gross acres
Rural estate	1,380	6,870
Single family	6,970	18,140
Multi-family - low density	220	3,750
Multi-family - high density	390	1,310
Commercial	1,520	4,330
Industrial	1,110	3,470
Industrial-unutilized	340	580
Public	920	2,120
Public recreation	1,270	4,820
Mixed land use	20	1,230
Right-of-way	70	580
Subtotal, municipal water supply land area	14,210	47,200
Self-supported/supplied by others	-	870
Non-irrigated	500	9,800
Agricultural	-	11,620
Total	14,710	69,490

Note: Elk Grove wholesale area is not included in the 2010 developed area acreage and is included in the buildout acreage because it was not available.

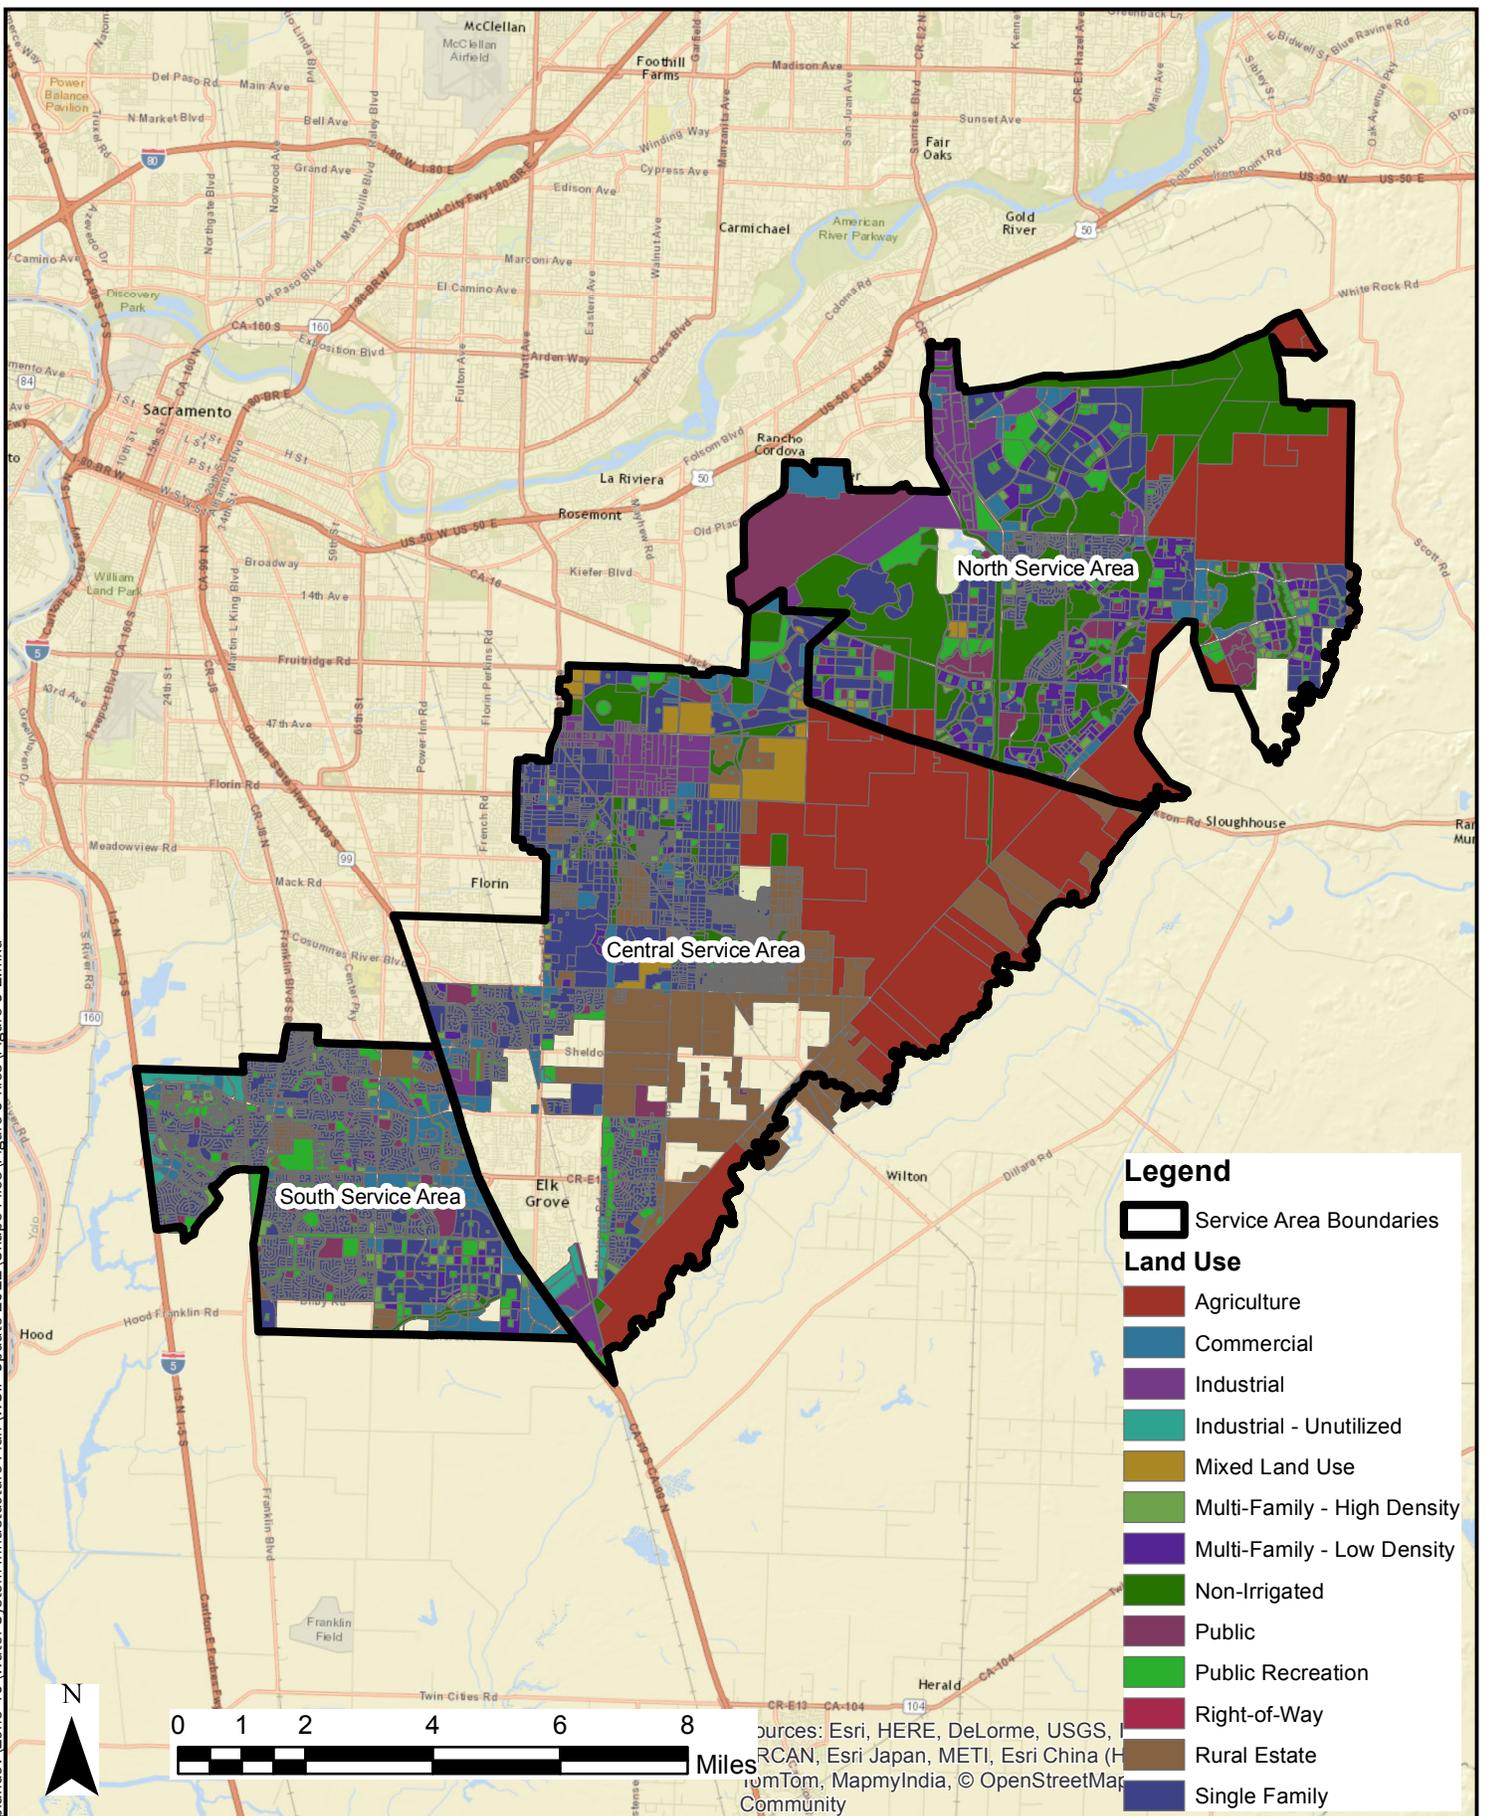


DATE	PROJECT	SITE
07/30/15	148130	

Zone 40 Water Supply Master Plan Amendment
Buildout Land Use - Cumulative

Figure 9-2

The historical and projected population is shown on Figure 9-3. The projected DUs, population, and connections at buildout by land use category are presented in Table 9-6. Population per DU and per connection, DUs per connection, and connections per acre by land use category are also shown in this table. The number of people per connection projected at buildout is significantly higher than the 2010 value because of the proportionally large increase in multi-family land use area compared to single family land use area from 2010 to buildout. A larger proportion of the residential dwelling units and connections will be multifamily at buildout compared to 2010, which will result in a higher number of people per connection.

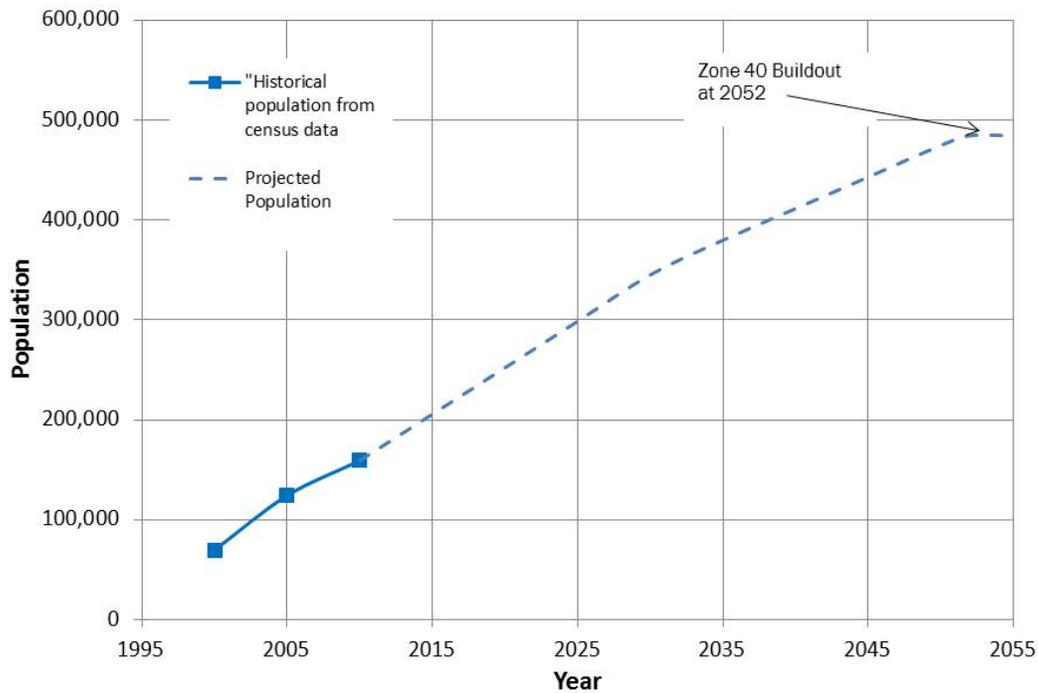

Elk Grove wholesale population is included. 2010 Elk Grove wholesale population is estimated to equal 10,144 people based on 3,210 Elk Grove wholesale connections and 3.16 people per connection in 2010.

Figure 9-3. Historical and Projected Population

Table 9-6. Buildout Dwelling Units, Population, and Connections by Land Use Category - Cumulative							
Land use category	Dwelling units	Population	Connections	Population/ dwelling unit	Population/ connection	Dwelling units/ connection	Connections/ acre
Rural estate	3,300	11,000	3,300	3.3	3.3	1.0	0.5
Single family	87,100	287,500	87,100	3.3	3.3	1.0	4.8
Multi-family - low density	41,800	115,000	4,200	2.8	27.4	10.0	1.1
Multi-family - high density	27,700	70,700	1,800	2.6	39.3	15.0	1.4
Commercial			1,900				0.4
Industrial			1,400				0.4
Industrial-unutilized							-
Public			200				0.1

Table 9-6. Buildout Dwelling Units, Population, and Connections by Land Use Category - Cumulative

Land use category	Dwelling units	Population	Connections	Population/ dwelling unit	Population/ connection	Dwelling units/ connection	Connections/ acre
Public recreation			4,100				0.9
Mixed land use			500				0.4
Right-of-way			700				1.2
Self-supported/ supplied by others			-				
Non-irrigated			-				
Agricultural			-				
Total	159,900	484,200	105,200	3.0	4.6	1.5	1.5

The 2010 and projected buildout DUs, population, and connections by service area are shown in Table 9-7. The projected buildout number of DUs and population for the NSA, CSA, and SSA are very similar; however the numbers of connections in the NSA are significantly less than the CSA and SSA. This is because there is a greater number of multi-family DUs in the NSA than the CSA and SSA. Since there are several multi-family dwelling units per connection, a lower number of connections is projected in the NSA to serve the similar number of dwelling units. Table 9-8 shows the projected number of connections by service area in five-year increments through 2050 and at buildout. The projected number of connections through buildout for each of the growth scenarios is illustrated on Figure 9-4.

Table 9-7. 2010 and Buildout Dwelling Units, Population, and Connections by Service Area - Cumulative

Service area	2010			Buildout		
	Dwelling units	Population	Connections	Dwelling units	Population	Connections
NSA	4,000	11,700	4,600	54,300	159,600	28,800
CSA	17,400	56,600	15,600	54,300	166,200	38,300
SSA	30,600	91,300	28,900	51,300	158,400	38,100
Total	52,000	159,600	49,100	159,900	484,200	105,200

Note: 2010 dwelling units, population, and connections in Elk Grove wholesale area are estimated and included in the CSA values. Elk Grove wholesale area service connections in 2010 are estimated to be 3,200 connections and the DUs are estimated to be 3,500 based on a 1.1 DU per connection factor. The population is estimated to equal 10,144 people.

Table 9-8. Projected Connections in 5-Year Increments - Cumulative

Service area	2010	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
NSA										
Jackson Township	-	-	510	1,020	1,530	2,050	2,050	2,050	2,050	2,050
NewBridge	-	-	340	670	1,010	1,350	1,350	1,350	1,350	1,350
Remaining NSA	4,600	5,600	6,600	8,300	9,900	12,700	16,500	20,200	24,000	25,400
Total	4,600	5,600	7,500	10,000	12,500	16,100	19,800	23,600	27,300	28,800
CSA										
West Jackson	-	-	1,360	2,730	4,090	5,450	5,450	5,450	5,450	5,450
Remaining CSA	15,600	16,600	17,100	18,200	19,400	21,600	25,300	29,100	32,800	32,900
Total	15,600	16,600	18,400	20,900	23,400	27,000	30,800	34,500	38,300	38,300
SSA										
Total	28,900	30,300	32,800	35,300	37,800	38,100	38,100	38,100	38,100	38,100
Total Zone 40	49,100	52,600	58,800	66,300	73,800	81,300	88,800	96,300	103,800	105,200

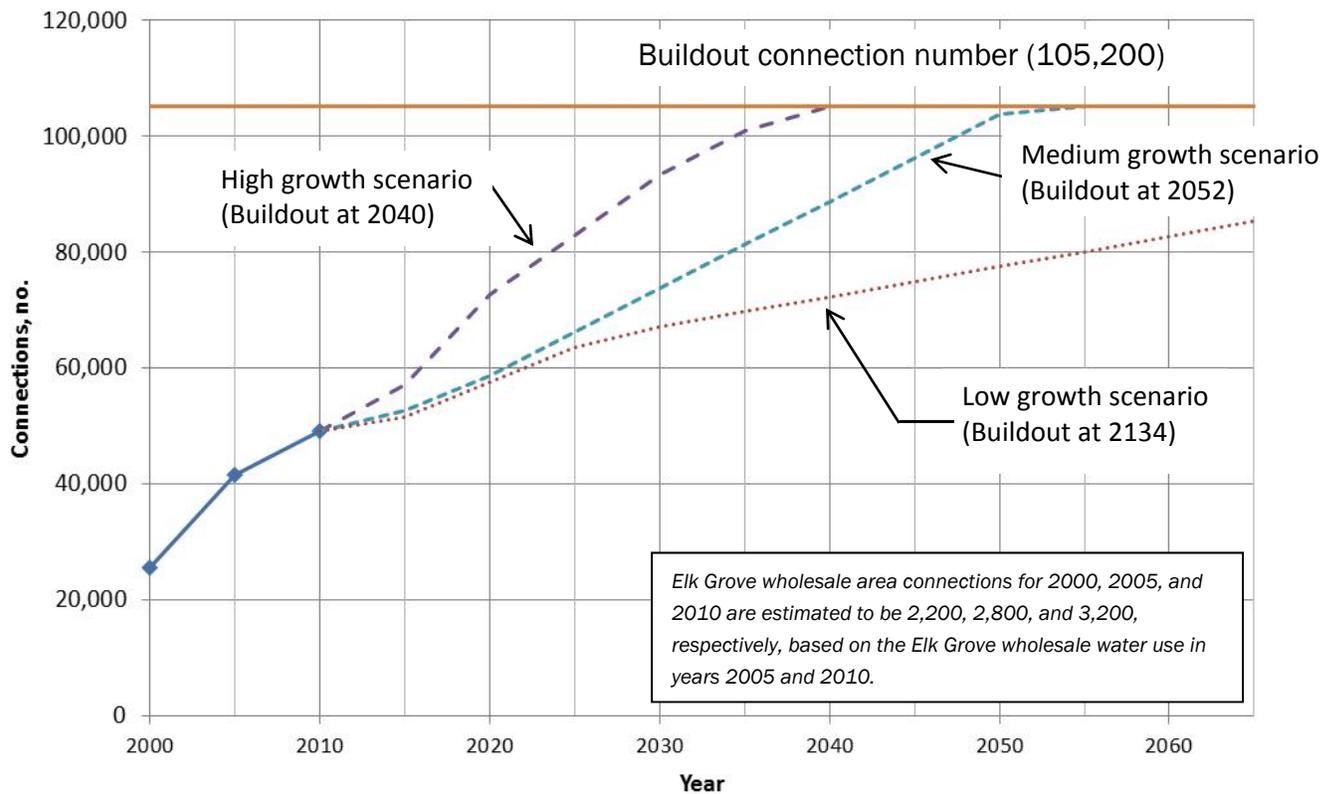


Figure 9-4. Historical and Projected Zone 40 Connections at High, Medium, and Low Growth Rates - Cumulative

9.1.2 Buildout Water Demands

This section presents the buildout water demand for the three new growth areas and for the overall Cumulative scenario. The buildout water demands for the NewBridge, Jackson Township, and West Jackson new growth areas are shown in Tables 9-9, 9-10, and 9-11, respectively.

Table 9-9. NewBridge Area Buildout Water Demands			
Land use	Buildout gross area from GIS, acres	Gross UWDF, ac-ft/yr/ac	Water demand, ac-ft/yr
Rural estate		1.37	
Single family	236	2.13	504
Multi-family - low density	119	2.44	289
Multi-family - high density	42	3.33	140
Commercial	38	2.02	78
Industrial		2.02	
Public	13	0.81	10
Public recreation	44	2.80	123
Mixed land use	13	2.15	28
Right-of-way	48.2	0.18	9
Self-supported/supplied by others			
Non-irrigated	439		
Industrial-unutilized			
Agricultural	106		
Subtotal	1,099		1,181
Water loss (7.5% of sales)			89
Total			1,270

Table 9-10. Jackson Township Area Buildout Water Demands

Land use	Buildout gross area from GIS, acres	Gross UWDF, ac-ft/yr/ac	Water demand, ac-ft/yr
Rural estate		1.37	
Single family	348	2.13	741
Multi-family - low density	157	2.44	382
Multi-family - high density	84	3.33	280
Commercial	90	2.02	181
Industrial		2.02	
Public	5	0.81	4
Public recreation	176	2.80	492
Mixed land use	20	2.15	42
Right-of-way		0.18	
Self-supported/supplied by others			
Non-irrigated	280		
Industrial-unutilized			
Agricultural	110		
Subtotal	1,268		2,123
Water loss (7.5% of sales)			159
Total			2,282

Table 9-11. West Jackson Area Buildout Water Demands

Land use	Buildout gross area from GIS, acres	Gross UWDF, ac-ft/yr/ac	Water demand, ac-ft/yr
Rural estate	256	1.37	351
Single family	914	2.13	1,947
Multi-family - low density		2.44	
Multi-family - high density	34	3.33	112
Commercial	441	2.02	891
Industrial	21	2.02	43
Public	-	0.81	-
Public recreation	341	2.80	955
Mixed land use	1,006	2.15	2,163
Right-of-way	297	0.18	54
Self-supported/supplied by others			

Table 9-11. West Jackson Area Buildout Water Demands			
Land use	Buildout gross area from GIS, acres	Gross UWDF, ac-ft/yr/ac	Water demand, ac-ft/yr
Non-irrigated	838		
Industrial-unutilized			
Agricultural			
Subtotal	4,149		6,516
Water loss (7.5% of sales)			489
Total			7,004

The buildout water demand by land use category for the Cumulative scenario is shown in Table 9-12. The recycled water demand in the SSA is included in the demand projections in Table 9-12 to provide the total water demand for this scenario. There is no recycled water demand assumed for the three new growth areas.

Table 9-12. Buildout Water Demand by Land Use Category - Cumulative	
Land use category	Water demand, ac-ft/yr
Rural estate	9,400
Single family	38,600
Multi-family - low density	9,200
Multi-family - high density	4,400
Commercial	8,700
Industrial	7,000
Public	1,700
Public recreation	13,500
Mixed land use	2,600
Right-of-way	100
Subtotal (land use with water demand)	95,300
Water system losses (7.5% of water sales)	7,100
Self-supplied/supported by others	0
Industrial-unutilized	0
Non-irrigated	0
Agricultural	0
Total production	102,400

9.1.3 Water Demand Growth Projection

The projected water demands by service area are shown in Table 9-13 and illustrated on Figure 9-5.

Table 9-13. Projected Water Demand in 5-Year Increments - Cumulative, ac-ft/yr										
Service area	2013	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
NSA										
Jackson Township			600	1,150	1,700	2,300	2,300	2,300	2,300	2,300
NewBridge			300	650	950	1,300	1,300	1,300	1,300	1,300
Remaining NSA	4,200	5,300	6,400	8,300	10,450	13,900	18,800	23,900	29,200	31,300
Total	4,200	5,300	7,300	10,100	13,100	17,500	22,400	27,500	32,800	34,900
CSA										
West Jackson			1,750	3,500	5,250	7,000	7,000	7,000	7,000	7,000
Remaining CSA	15,200	16,400	16,650	17,700	18,850	21,100	25,400	29,800	34,300	34,400
Total	15,200	16,400	18,400	21,200	24,100	28,100	32,400	36,800	41,300	41,400
SSA										
Total	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100
Total study area	34,500	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,400

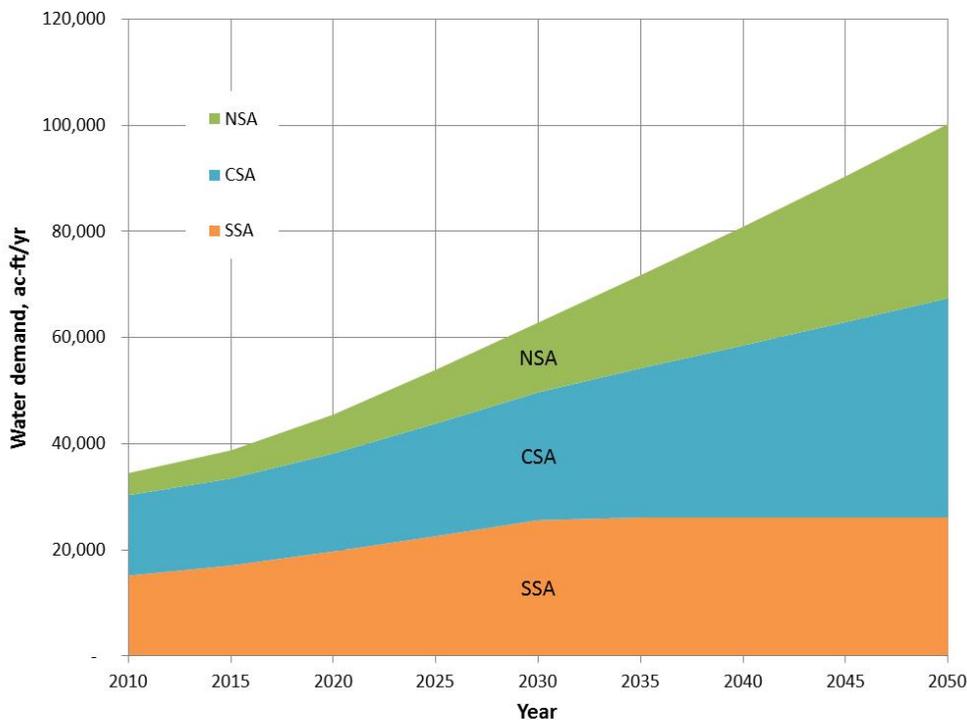


Figure 9-5. Water Demand Projection – Cumulative

9.2 Water Supply Capacity

This section quantifies the amount of supply capacity that would be needed to meet demands through buildout. The supply capacity and the use of the supply is presented on both a maximum day basis and an annual basis

9.2.1 Maximum Day Demand Supply Capacity and Use

This section compares the projected maximum day demand to supply capacity for each of the three service areas through buildout. The maximum day demand to supply capacity comparison tables for each of the three service areas are presented in Appendix D. The future supply capacity is based on the proposed supply and conveyance facilities that are presented in Section 9.3. The maximum day use of each type of supply is quantified for the wet/average years and dry years.

9.2.1.1 North Service Area

Surface water supply from the existing Vineyard SWTP would be provided in Phase 1 to replace the current groundwater supply provided by the Anatolia GWTP. The construction of the Phase A NSA Project (P-10) and Phase B NSA Project (S-1) will allow for some of the Vineyard SWTP's existing capacity to be used to supply the NSA. It is assumed that 65 percent of the Vineyard SWTP would be used to supply the NSA. The Mather wells are used below their capacities in dry years since SCWA operational staff prefer to minimize their use due to the possible impact to nearby contamination plumes.

9.2.1.2 Central Service Area

Once several projects are constructed, including the Phase A NSA Project (P-10) and Phase B NSA Project (S-1), some of the Vineyard SWTP's existing capacity will be used to also supply the NSA. The future West Jackson GWTP will be used to supply the CSA, although it will be connected to the transmission system such that it could also provide supply to the NSA.

9.2.1.3 South Service Area

New groundwater supply capacity would be needed during Phase 1. Additional groundwater supply capacity would be added in Phases 2 and 3. No new surface water supply capacity is specifically planned for the SSA, although the planned Phase 3 expansion of the Vineyard SWTP would provide some additional surface water. The proposed GWTPs for Phase 3 would provide a maximum day groundwater supply capacity that exceeds the SSA's projected buildout maximum day demand. These Phase 3 GWTPs could be used to provide dry year groundwater supply to other areas or groundwater storage, or function as additional backup facilities.

9.2.1.4 Summary

Table 9-14 and Figure 9-6 present the maximum day demand and supply capacity comparison for Zone 40 from 2013 through buildout. The maximum day use of each type of supply is quantified for the wet/average years and dry years. As can be seen in Table 9-14 and consistent with the established conjunctive use program, the total supply capacity exceeds the maximum day demand for each phase, but neither the groundwater nor surface water supply capacity alone can meet the maximum day demand.

As shown in Table 9-14, Zone 40 will utilize a varying mixture of groundwater and surface water supplies on the maximum demand day based on whether it is a wet/average year or a dry year. The ability to practice conjunctive use by maximizing the use of surface water in wet and average years and minimizing the use of surface water in dry years is limited by the available surface water and groundwater supply capacities and to some extent by distribution system constraints. Several observations are made regarding the maximum day supply capacity and use that pertains to all three phases:

1. In dry years, there is sufficient groundwater capacity to be able to significantly reduce the amount of surface water use on the maximum day compared to wet/average years.
2. In dry years, most of the groundwater capacity will be utilized on the maximum demand day.
3. In wet years, there is sufficient surface water capacity to be able to supply over half of the maximum day demand.
4. In wet years, up to half of the groundwater capacity will be used to help supply the maximum day demand.

Table 9-14. Maximum Day Demand to Supply Comparison for Zone 40 - Cumulative, mgd

Zone 40		2013	Phase 1			Phase 2		Phase 3			Buildout (2052)
			2015	2020	2025	2030	2035	2040	2045	2050	
Maximum day demand											
	Zone 40 total	61.5	69.2	81.2	96.3	112.2	128.1	144.4	161.4	179.0	183.0
Existing supply capacity ^(a)											
	Groundwater ^(b)	72.5	72.5	66.0	66.0	66.0	66.0	66.0	66.0	66.0	66.0
	Surface water	61.1	61.1	45.1	28.6	28.6	28.6	28.6	28.6	28.6	28.6
	Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
	Total	136.6	136.6	114.1	97.6						
Planned future supply capacity											
	Groundwater	0.0	0.0	0.0	6.5	15.5	33.0	33.0	33.0	53.0	66.0
	surface water ^(b)	0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	82.5	101.6
	Recycled water									2.9	2.9
Total supply capacity											
	Groundwater	72.5	72.5	66.0	72.5	81.5	99.0	99.0	99.0	119.0	132.0
	Surface water	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	111.1	130.2
	Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
	Total	136.6	136.6	130.1	136.6	145.6	163.1	163.1	163.1	236.0	268.1
Use of supply: average/wet years											
	Groundwater	20.4	25.8	21.1	46.6	57.1	65.2	72.9	80.7	68.4	49.5
	Surface water	38.1	40.3	57.1	46.7	52.1	59.9	68.5	77.6	104.7	127.6
	Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
	Total	61.5	69.2	81.2	96.3	112.2	128.1	144.4	161.4	179.0	183.0
Use of supply: dry years											
	Groundwater	58.5	64.3	60.5	68.5	77.1	92.8	100.5	108.3	108.2	108.2
	Surface water	0.0	1.9	17.7	24.8	32.1	32.3	40.9	50.0	65.0	69.0
	Recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
	Total	61.5	69.2	81.2	96.3	112.2	128.1	144.4	161.4	179.0	183.0

^(a) Groundwater supply decrease in 2020 due to Anatolia GWTP removed from service.

^(b) Reduction in existing capacity and added future surface water supply capacity in 2020 and 2025 because planned delivery to NSA from existing Vineyard SWTP accounted as future supply capacity as requested by SCWA staff.

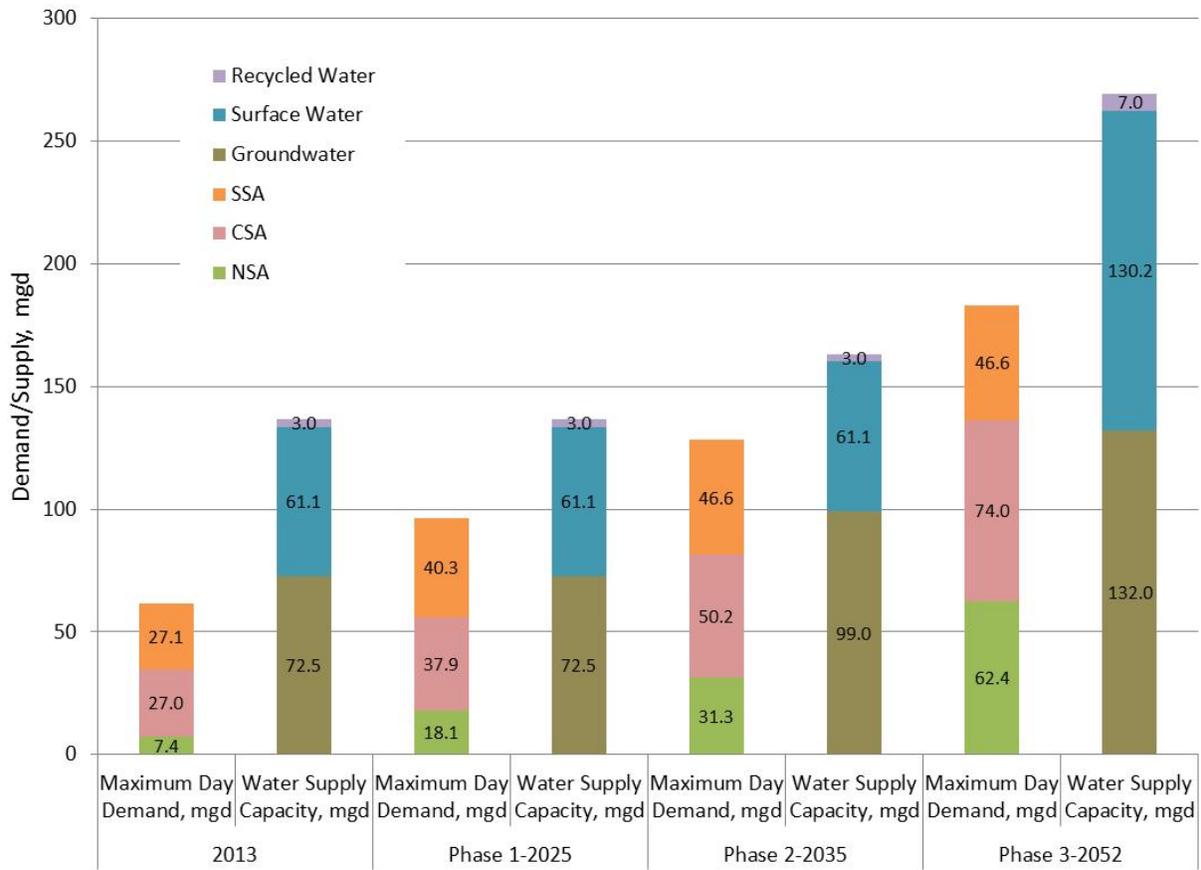


Figure 9-6. Maximum Day Demand to Supply Capacity Comparison by Phase - Cumulative

Figure 9-7 presents the maximum day use of the water supplies by type for wet/average years and dry years for 2013, Phase 1, Phase 2, and Phase 3.

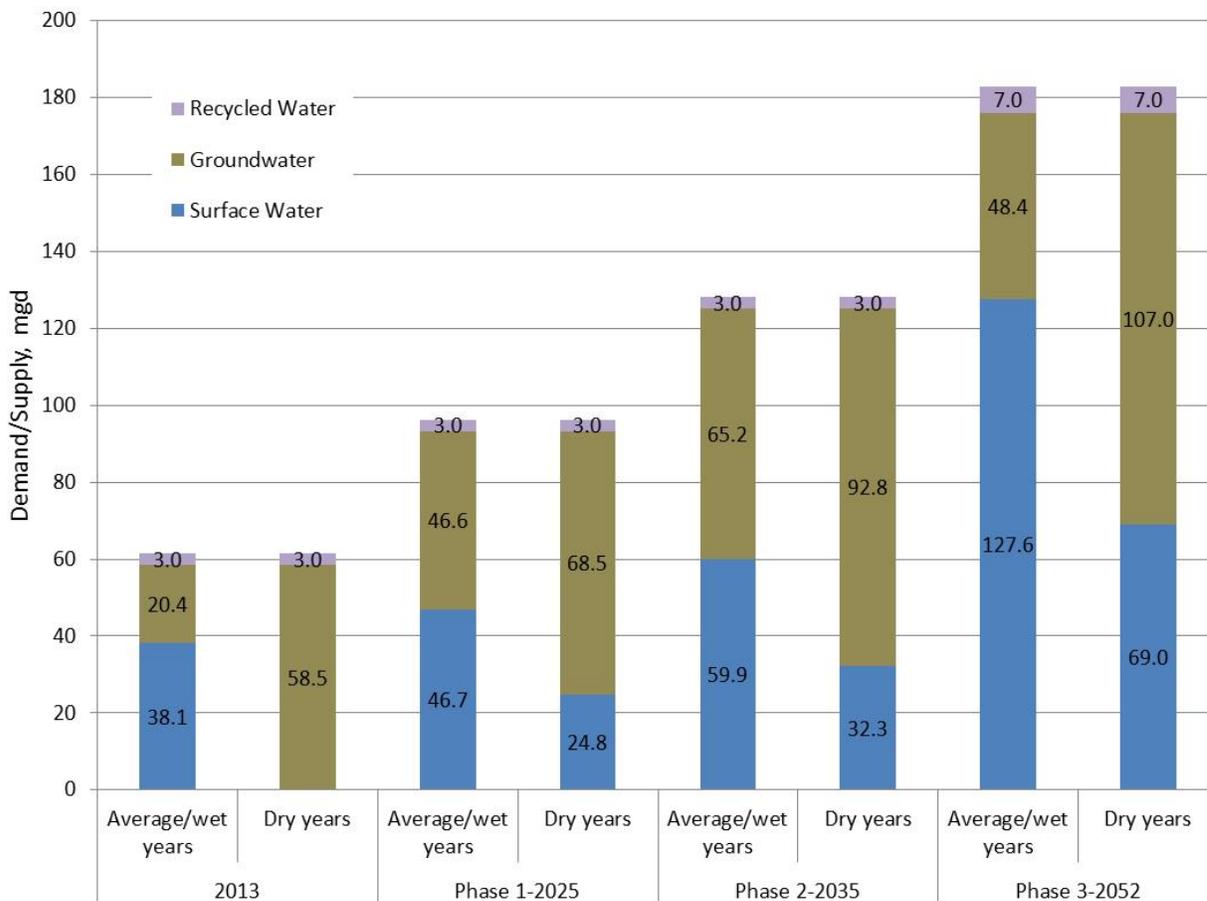


Figure 9-7. Maximum Day Use of Water Supplies by Phase and Climate Year Type - Cumulative

9.2.2 Annual Water Supply

Table 9-15 presents the annual supply to demand comparison for a normal climate year. Table 9-16 presents the annual supply to demand comparison for a single dry year and Table 9-17 presents the comparison for a multiple dry year. The presented supply values are the supplies available to Zone 40 assuming there are no facility supply capacity constraints. The facility improvements needed to expand existing supply capacity are presented in Section 9.3. Projections of the use of each supply source that consider supply facility capacity constraints for each service area for normal and dry years are presented in Appendix D. Figure 9-8 presents the projected use of water supplies by phase and climate year type.

As can be seen in Tables 9-15, 9-16, and 9-17, as well as in Appendix D, the total water supply is greater than the projected demands. This analysis verifies the sufficiency of the water supply for the Cumulative scenario.

Table 9-15. Supply and Demand Comparison-Normal Year - Cumulative, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
Appropriative water ^(a)	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
Difference	146,800	140,000	131,600	122,700	113,700	104,600	95,100	86,800	84,600

^(a) Only 35,000 ac-ft/yr assumed to be available without the construction of seasonal storage, as described in Section 4.2.2.

Table 9-16. Supply and Demand Comparison-Single Dry Year - Cumulative, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply allocation	11,300	16,000	13,100	14,600	16,800	19,200	21,800	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	101,500	106,200	103,300	104,800	107,000	109,400	112,000	114,300	114,300
Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
Difference	62,800	60,700	49,400	42,000	35,200	28,500	21,600	14,000	11,800

Table 9-17. Supply and Demand Comparison-Multiple Dry Years- Cumulative, ac-ft/yr

Year		2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)	
First year	Supplies										
	US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	
	Appropriative water ^(a)	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	
	City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	
	Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300	
	Supply totals	185,500	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
	Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500	
	Difference	146,800	140,000	131,600	122,700	113,700	104,600	95,100	86,800	84,600	
Second year	Supplies										
	US Bureau of Reclamation-CVP supply	17,000	24,000	19,700	21,900	25,100	28,800	32,600	33,800	33,800	
	Appropriative water	-	-	-	-	-	-	-	-	-	
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-	
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300	
	Supply totals	107,200	114,200	109,900	112,100	115,300	119,000	122,800	125,600	125,600	
	Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500	
	Difference	68,500	68,700	56,000	49,300	43,500	38,100	32,400	25,300	23,100	
Third year	Supplies										
	US Bureau of Reclamation-CVP supply	11,300	16,000	13,100	14,600	16,800	19,200	21,800	22,500	22,500	
	Appropriative water	-	-	-	-	-	-	-	-	-	
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-	
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300	
	Supply totals	101,500	106,200	103,300	104,800	107,000	109,400	112,000	114,300	114,300	
	Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500	
	Difference	62,800	60,700	49,400	42,000	35,200	28,500	21,600	14,000	11,800	

^(a) Only 35,000 ac-ft/yr assumed to be available without the construction of seasonal storage, as described in Section 4.2.2.

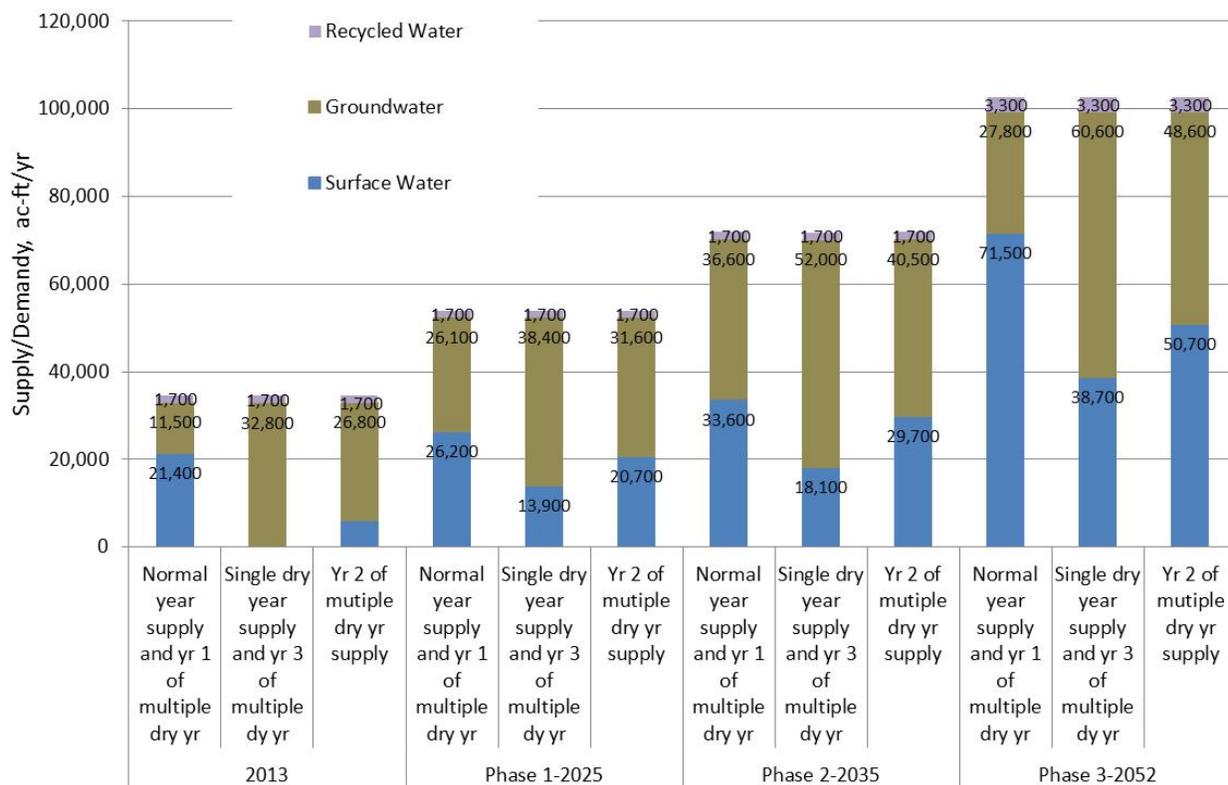


Figure 9-8. Zone 40 Annual Use of Water Supplies by Phase and Climate Year Type

9.2.3 Storage and Pumping Station Capacity Evaluation

Table 9-18 and 9-19 presents a summary comparison of the planned to required storage volume and pumping station capacities for this scenario. As shown in Tables 9-18 and 9-19, the planned storage facilities provide more than the required storage volumes and pump station capacities. The detailed storage evaluation tables for each pressure zone are presented in Appendix D.

Table 9-18. Zone 40 Storage Capacity Evaluation Summary - Cumulative

	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)
Provided storage volume, MG				
Existing	42.2	42.2	42.2	42.2
Future	0.0	13.5	17.5	36.0
Total	42.2	55.7	59.7	78.2
Required storage volume, MG				
Equalization	12.3	19.0	25.2	32.9
Fire	3.8	3.8	3.8	3.8
Emergency	10.3	15.8	21.0	27.4
Total	26.4	38.6	50.1	64.2
Difference (provided minus required)	15.8	17.1	9.6	14.0

Table 9-19. Zone 40 Pump Station Capacity Evaluation Summary - Cumulative


	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)
Provided pump station capacity from storage, mgd				
Existing	107.6	118.2	112.3	101.3
Future	0.0	20.5	32.6	88.1
Total	107.6	138.7	144.9	189.4
Required pump station capacity from storage, mgd				
	65.8	96.6	126.2	164.6
Difference (provided minus required)	41.8	42.1	18.7	24.8

9.3 Water System Facilities and Capital Improvement Program

This section describes the water system facilities needed to supply the Cumulative scenario, develops the costs, and presents the CIP for Phases 1, 2, and 3.

9.3.1 Needed Water System Facilities

The water system facilities needed to serve the Phase 1, 2, and 3 demands are the same as defined for the Baseline scenario. The exception is that additional pipelines would be needed in the NSA and CSA to supply the new growth areas. The locations of the Phase 1 projects in the NSA are shown on Figure 9-9. The locations of the Phase 1 projects in the CSA and SSA are shown on Figure 9-10. The locations of the Phase 2 and 3 projects in the NSA are shown on Figure 9-11. The locations of the Phase 2 and 3 projects in the CSA and SSA are shown on Figure 9-12.

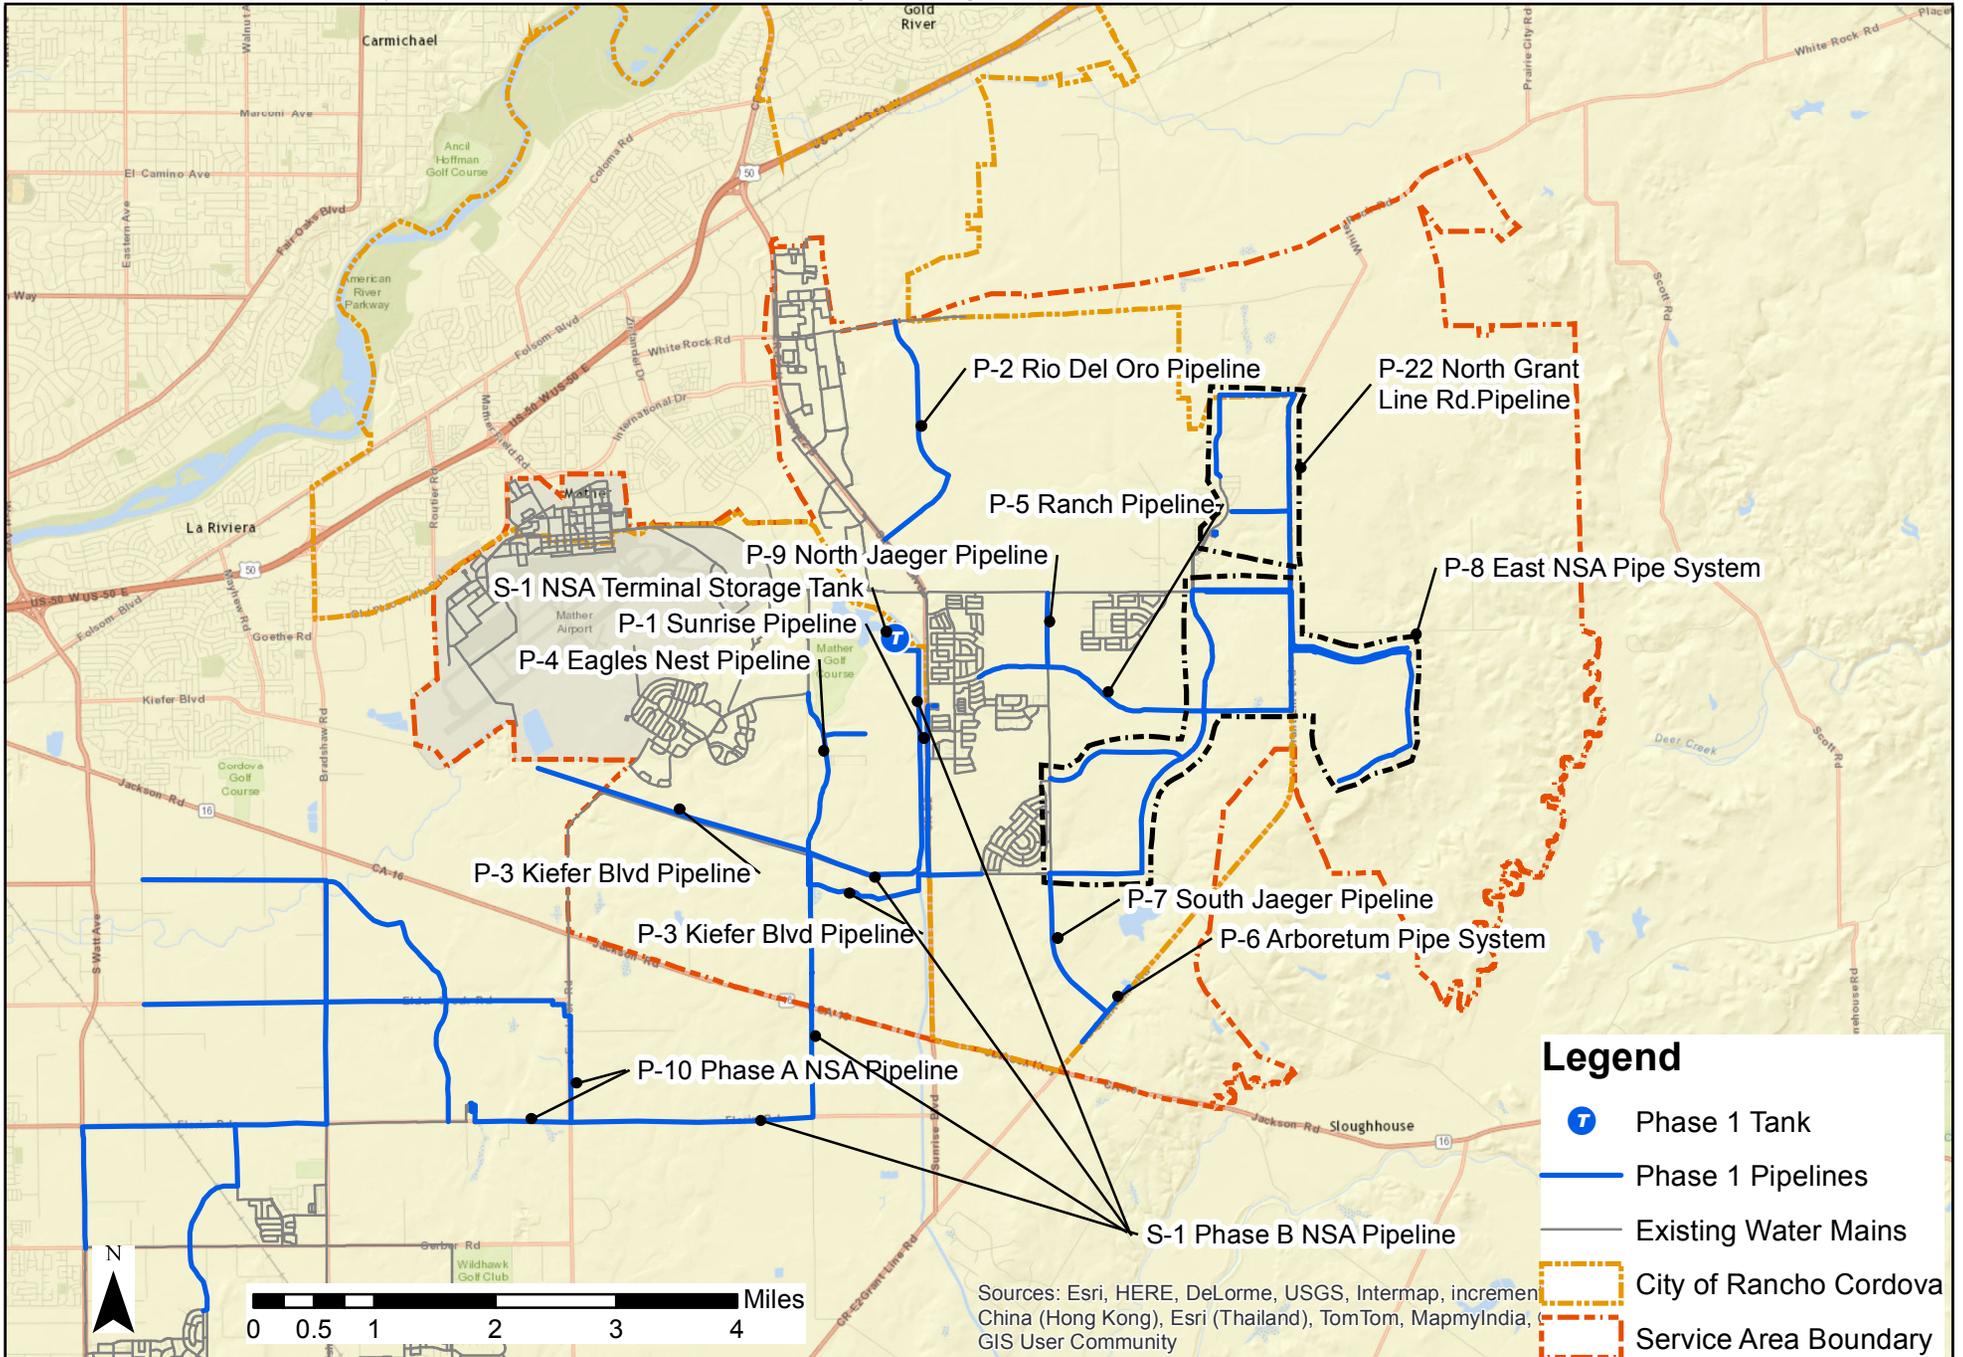


Zone 40 Water Supply Master Plan Amendment

Phase 1 CIP Projects - NSA - Cumulative

Figure 9-9



PROJECT	148130	SITE
DATE	7/30/15	TITLE

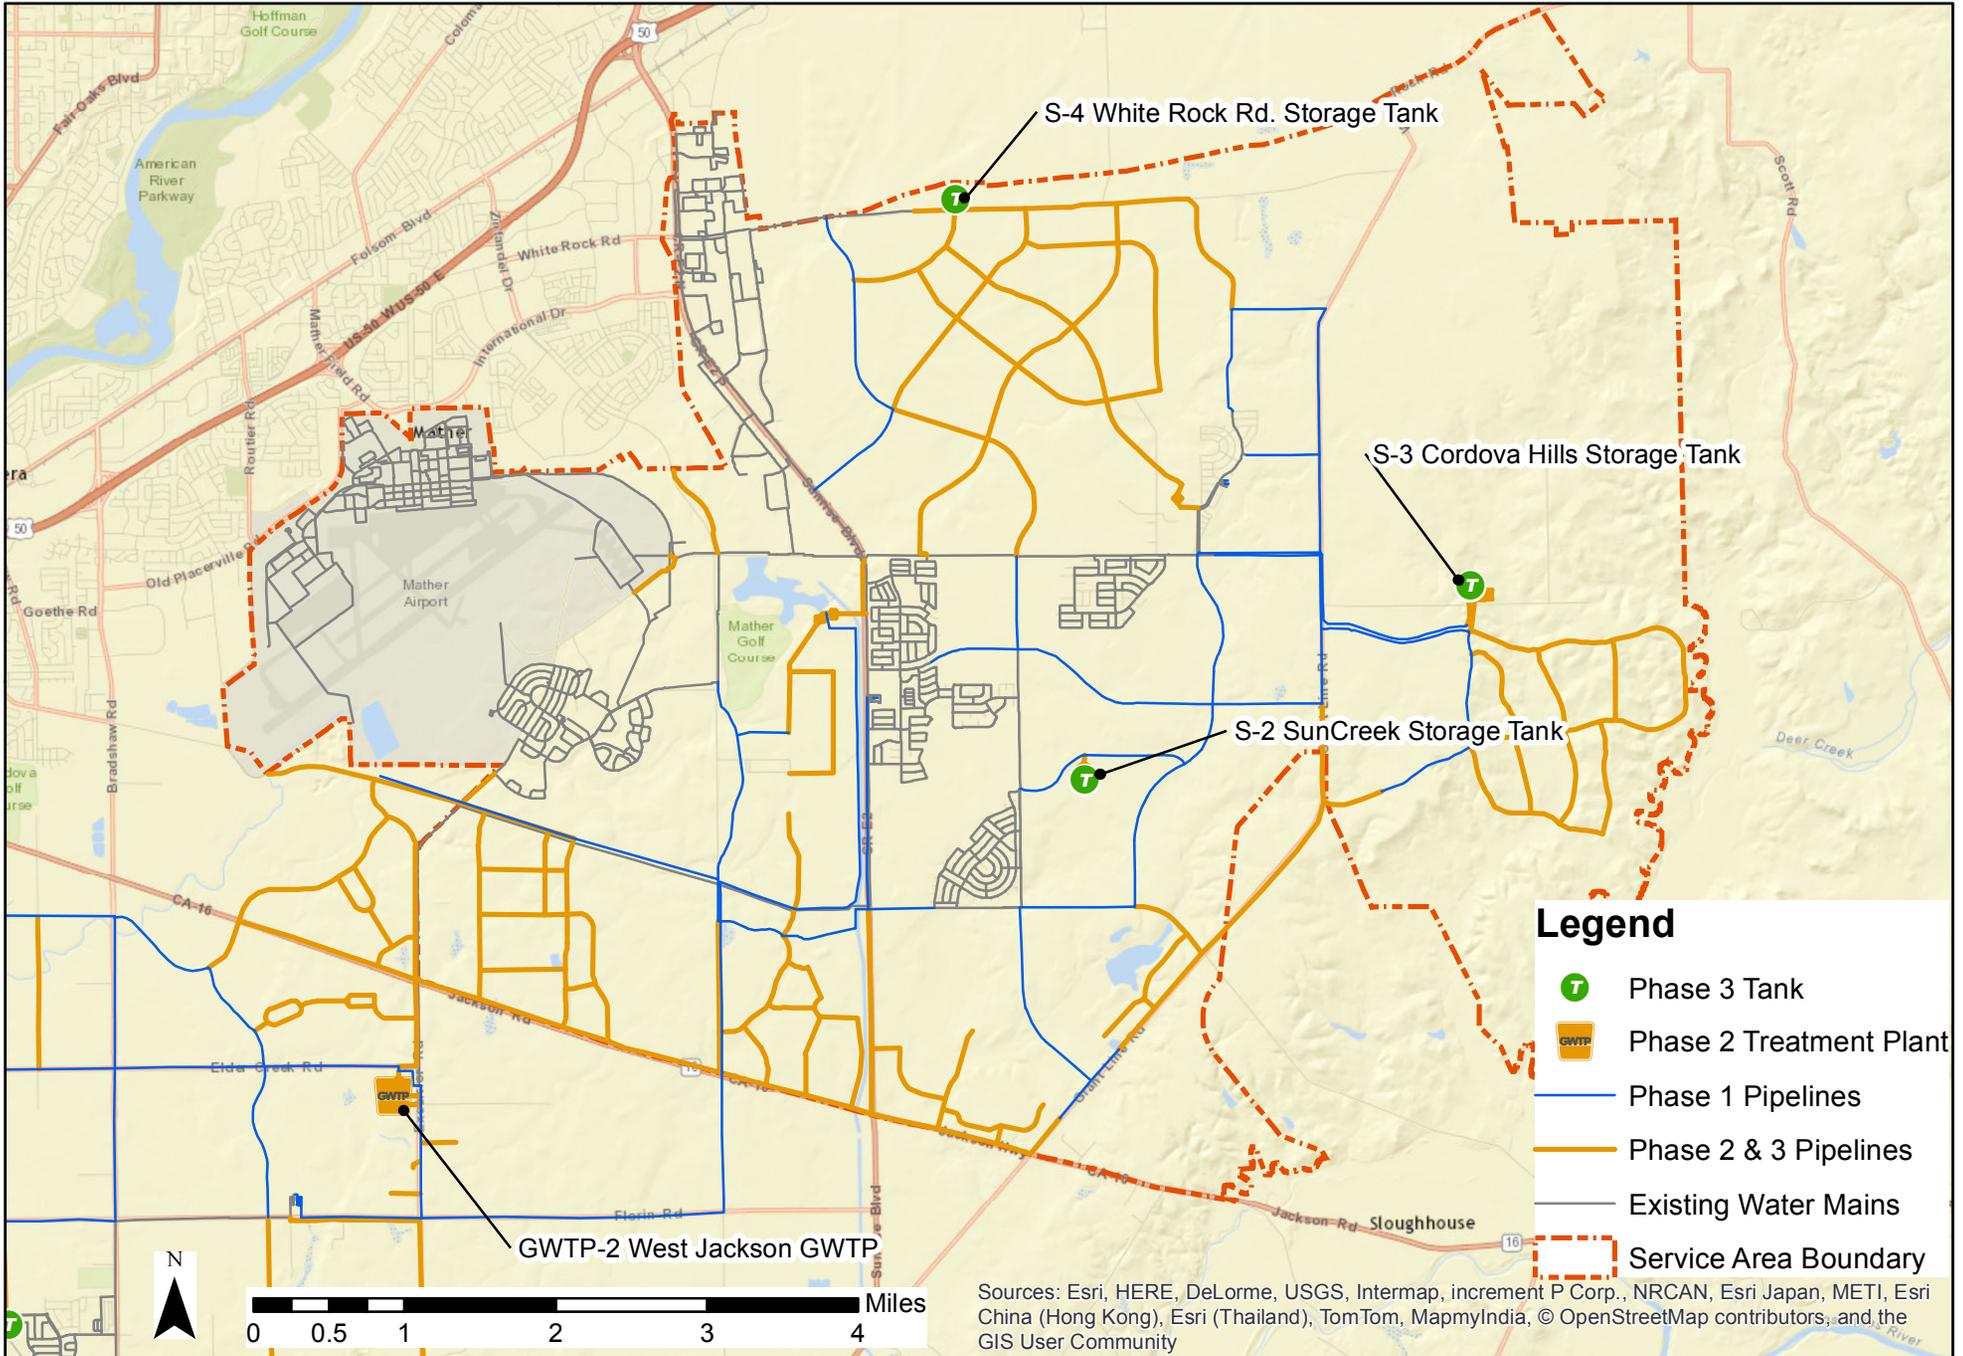

Sources: Esri, HERE, DeLorme, USGS, Intermap, increment P Corp., NRCAN, Esri Japan, METI, Esri China (Hong Kong), Esri (Thailand), TomTom, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

 DEPARTMENT OF WATER RESOURCES SACRAMENTO COUNTY WATER AGENCY	PROJECT 148130	SITE Zone 40 Water Supply Master Plan Amendment	Figure 9-11
	DATE 7/30/15	TITLE Phase 2 & 3 CIP Projects - NSA - Cumulative	

The future water system facilities are categorized as supply facilities, storage facilities, and pipelines. Table 9-20 presents the planned water supply facilities for all of Zone 40. Each GWTP project consists of wells, a groundwater treatment facility, a storage tank, and a pump station that pumps from the storage tank into the distribution system. Some of the GWTP projects already have wells that were previously drilled but not equipped and some would require the equipping and drilling of new wells. Table 9-20 presents the number of wells that would be equipped and/or drilled and equipped for the pertinent GWTP projects.

Table 9-21 presents the storage facility projects planned for Zone 40. Table 9-22 presents the pipeline projects that are 16 inches in diameter or larger planned for Phase 1 for all of Zone 40, and identifies the pipelines needed to serve the three new growth areas. Table 9-23 presents the pipelines that would be needed during Phases 2 and 3 for all of Zone 40.

Table 9-20. Additional Supply Facilities - Cumulative

	Supply facility	Treatment/ supply capacity, mgd	Wells		Storage, MG	Pumping station capacity, mgd	Area served	Phase added
			Wells to be drilled and equipped	Wells to be equipped only (already drilled)				
GWTP-1	Poppy Ridge GWTP expansion	6.5		3	3.5	17.0	SSA	Phase 1
GWTP-2	West Jackson GWTP	18.0	5		4.0	21.6	CSA	Phase 2
SW-1	Vineyard WTP expansion	50.0					NSA/CSA	Phase 3
GWTP-3	Bond GWTP	6.5	3		0.5	10.8	CSA	Phase 3
GWTP-4	East Elk Grove GWTP expansion	6.5	2	1		13.0	CSA	Phase 3
SW-2	City POU water supply facilities	19.1					CSA	Phase 3
GWTP-5	Franklin GWTP	7.0	1	3	2.0	21.6	SSA	Phase 3
GWTP-6	Whitelock GWTP	13.0	6		3.0	14.4	SSA	Phase 3
GWTP-7	Big Horn GWTP expansion	8.5	4			17.0	SSA	Phase 2
RW-1	Recycled water supply	4.0					SSA	Phase 3
	Total	139.1	21	7	13.0	115.4		

Table 9-21. Additional Storage Facilities - Cumulative

	Storage facility	Capacity, MG	Pumping station, mgd	Area served	Phase added
S-1	Phase B NSA Project	10.0	64.0	NSA	1
S-2	Suncreek	3.0	18.0	NSA	3
S-3	Cordova Hills	3.0	21.6	NSA	3
S-4	White Rock	3.0	14.4	NSA	3
S-5	North Vineyard Station	4.0	21.6	CSA	3
S-6	Calvine Meadows Pump Station Expansion		7.2	CSA	3
	Total	23.0	146.8		

Table 9-22. Phase 1 Pipelines - Cumulative

	Pipeline	Size, in	Length, ft	Area served	West Jackson (a)	Jackson Township (a)	NewBridge(e)
P-1	Sunrise Blvd. Pipeline	16	7,371	NSA		X	X
P-2	Rio del Oro Pipeline	24	11,593	NSA			
P-3	Kiefer Blvd. Pipeline	16-20	22,446	NSA		X	X
P-4	Eagles Nest Road Pipeline	20-30	7,239	NSA			
P-5	Ranch Pipeline	24	7,000	NSA			
P-6	Arboretum Pipe System	16	3,167	NSA			
P-7	South Jaeger Pipeline	16	5,238	NSA			
P-8	East NSA Pipeline System	16-30	61,389	NSA			
P-9	North Jaeger Pipeline	24	6,365	NSA			
P-10	Phase A NSA Project	42-66	44,662	NSA		X	X
P-11	Vineyard Road Pipeline	16	13,600	CSA	X		
P-12	Fruitridge Road Pipeline	16	7,982	CSA	X		
P-13	Elder Creek Pipeline	16-36	21,343	CSA	X		
P-14	Bradshaw Road Pipeline	16-24	10,599	CSA	X		
P-15	North Vineyard Station (Florin to Gerber) Pipeline	24-36	11,847	CSA			
P-16	South Watt Connect Pipeline	24	2,693	CSA			
P-17	CSA Backbone Pipeline	24-30	9,948	CSA			
P-18	Elk Grove Loop Connector Pipelines	16-24	11,322	CSA			
P-19	Power Inn Road Pipeline	24	1,273	CSA			
P-20	Big Horn to Kammerer Pipeline	20	7,832	SSA			
P-21	Bruceville Road Pipeline	18	1,267	SSA			
P-22	North Grant Line Road	20-24	17,000	NSA			

Table 9-22. Phase 1 Pipelines - Cumulative							
	Pipeline	Size, in	Length, ft	Area served	West Jackson ^(a)	Jackson Township ^(a)	NewBridge ^(a)
	Pipeline						
P-23	Florin-Watt Pipelines	20-24	10,000	CSA			
P-24	North Waterman Pipeline	16	3,000	CSA			
P-25	Sheldon-Waterman Pipelines	18-24	15,000	CSA			
P-26	South East Policy Area Pipelines	18-24	22,000	SSA			
	Total	--	343,176	--	--	--	--

^(a) Pipelines that are needed to serve the new growth area are identified with an "X".

Table 9-23. Phase 2 and 3 Pipelines - Cumulative	
Pipeline size, in	Length, ft
16	165,716
18	17,351
20	0
24	67,876
30	5,305
36	29,502
42	3,371
54	40,704
Total	326,825

9.3.2 Capital Improvement Plan

This section presents the CIP for Phases 1, 2, and 3.

9.3.2.1 Phase 1 CIP – 10 Year Plan (FY 2015-16 to 2024-25)

The Phase 1 CIP represents the projects that will be constructed over the near term time period and provides the basis for the development of the capacity charge. The development of the Phase 1 CIP requires consideration of the timing and duration of each project. The Phase 1 CIP consists of groundwater, storage, and pipeline projects. No surface water and stand alone storage projects are planned for Phase 1, other than the storage that is part of the GWTP project.

Table 9-24 presents the estimated costs of the Phase 1 water facilities for all of Zone 40. Included in the Phase 1 CIP is an item for non-specific project costs that cover the labor costs of SCWA’s planning, development, and development sections.

The timing of the Phase 1 projects presented in Table 9-24 are based on information SCWA has received from developers’ engineers regarding the timing of development projects and keeping a somewhat consistent rate of annual expenditure over the duration of Phase 1. The cost of each project would occur over a duration of several years. All of the projects would be completed by the time the end of Phase 1 is reached.

Table 9-24. Phase 1 CIP Cost Estimate - Cumulative

Projects		Service area	Capital cost	Project timing	
No.	Name			Start, FY	End, FY
Groundwater projects (SCWA projects)					
GWTP-1	Poppy Ridge GWTP Expansion	SSA	\$13,832,800	2016	2018
	Well site acquisitions	CSA/SSA	\$180,000	2018	2023
	subtotal		\$14,012,800		
Regional transmission and storage projects (SCWA projects)					
S-1	Phase B NSA Project ^(a)	NSA	\$84,586,140	2016	2023
P-10	Phase A NSA Project ^(a)	NSA	\$10,088,000	2016	2019
	Tank site acquisition	NSA	\$800,000	2017	2018
	subtotal		\$95,474,140		
Pipeline projects (Developer projects)					
P-1	Sunrise Blv. Pipeline ^(a)	NSA	\$2,527,900	2018	2020
P-2	Rio del Oro Pipeline	NSA	\$3,663,200	2016	2018
P-3	Kiefer Boulevard Pipeline ^(a)	NSA	\$7,282,700	2020	2022
P-4	Eagles Nest Road Pipeline	NSA	\$3,779,200	2019	2021
P-5	Ranch Pipeline	NSA	\$2,202,300	2023	2025
P-6	Arboretum Pipe System	NSA	\$1,104,300	2021	2023
P-7	South Jaeger Pipeline	NSA	\$1,145,500	2020	2022
P-8	East NSA Pipeline System	NSA	\$18,212,400	2016	2021
P-9	North Jaeger Pipeline	NSA	\$2,027,300	2017	2018
P-11	Vineyard Road Pipeline ^(a)	CSA	\$2,923,000	2021	2023
P-12	Fruitridge Road Pipeline ^(a)	CSA	\$2,716,100	2022	2024
P-13	Elder Creek Pipeline ^(a)	CSA	\$9,142,600	2021	2025
P-14	Bradshaw Road Pipeline ^(a)	CSA	\$4,515,400	2017	2019
P-15	North Vineyard Station (Florin to Gerber) Pipeline	CSA	\$5,025,600	2018	2020
P-16	South Watt Connect Pipeline	CSA	\$1,742,400	2019	2021
P-17	CSA Backbone Pipeline	CSA	\$5,008,300	2023	2025
P-18	Elk Grove Loop Connector Pipelines	CSA	\$4,715,500	2023	2025
P-19	Power Inn Road Pipeline	CSA	\$584,300	2024	2025
P-20	Big Horn to Kammerer Pipeline	SSA	\$2,494,500	2017	2019
P-21	Bruceville Road Pipeline	SSA	\$509,400	2024	2025
P-22	North Grant Line Road Pipeline	NSA	\$4,588,800	2022	2024
P-23	Florin-Watt Pipelines	CSA	\$4,150,400	2023	2025

Table 9-24. Phase 1 CIP Cost Estimate - Cumulative

Projects		Service area	Capital cost	Project timing	
No.	Name			Start, FY	End, FY
P-24	North Waterman Pipeline	CSA	\$568,900	2019	2020
P-25	Sheldon-Waterman Pipelines	CSA	\$5,685,700	2022	2025
P-26	South East Policy Area Pipelines	SSA	\$5,868,800	2021	2024
	subtotal		\$102,184,500		
Non-specific project costs			\$30,000,000	2016	2025
Studies					
	Recycled Water Master Plan		\$250,000	2016	2025
	Water Master Plan		\$400,000	2016	2025
	EIR		\$500,000	2016	2025
	subtotal		\$1,150,000		
Total			\$242,821,440		

^(a) Projects relevant to the three growth areas.

9.3.2.2 Phase 2 CIP – 10 Year Plan (2026 to 2035)

Phase 2 represents the 10 year period following the end of Phase 1. Since Phase 2 is further in the future, the timing of projects is more speculative and less precise. The level of precision provided in the Phase 1 CIP is not needed for Phase 2 since the capacity charges are developed using the Phase 1 CIP costs and not the CIP costs from the subsequent phases.

The new pipelines that are needed for Zone 40 during Phases 2 and 3 are defined. However, the timing of when each pipeline project is needed is dependent on the location and timing of development. Therefore, this document does not identify the specific pipe segments that would need to be constructed in either Phase 2 or 3. The approach used for the development of the CIP is to assume that approximately half the cost of the Phases 2 and 3 pipelines would occur in Phase 2 and half would occur in Phase 3. Table 9-25 presents the cost estimate for the Phases 2 and 3 pipelines for all of Zone 40.

Table 9-26 presents the cost estimate for the Phase 2 CIP projects for all of Zone 40. The Phase 2 CIP consists of groundwater and pipeline projects. No surface water projects are planned for Phase 2.

Table 9-25. Phases 2 and 3 Pipeline Cost Estimate - Cumulative		
Diameter, in	Length, ft	Capital Cost
16	165,716	\$68,859,035
18	14,351	\$6,751,465
20	-	\$ -
24	67,876	\$36,404,178
30	5,305	\$3,592,897
36	29,502	\$23,653,481
42	3,371	\$3,147,171
54	40,704	\$57,148,073
Total	326,825	\$199,556,300

Table 9-26. Phase 2 CIP - Cumulative			
Projects		Service Area	Capital Cost
No.	Name		
Groundwater projects			
GWTP-2	West Jackson GWTP	CSA	\$28,932,200
GWTP-7	Big Horn GWTP Expansion	SSA	\$14,744,100
Pipeline projects		NSA/CSA/SSA	\$99,778,150
Total			\$143,454,450

9.3.2.3 Phase 3 CIP – 17 Year Plan (2036 – Buildout)

The Phase 3 CIP consists of surface water, groundwater, recycled water, storage, and pipeline projects. Table 9-27 presents the cost estimate for the Phase 3 CIP projects for all of Zone 40. The cost estimate for the City POU supply connection (SW-2) is for the construction of the interconnection and the pipeline to convey the water into the CSA’s water transmission system. It does not include the City’s capacity buy-in cost that was estimated in 2005 to be \$32 million.

Table 9-27. Phase 3 CIP - Cumulative			
Projects		Service Area	Capital Cost
No.	Name		
Surface Water Projects			
SW-1	Vineyard WTP Expansion	NSA/CSA	\$200,000,000
SW-2	City POU Supply Connection ^(a)	CSA	\$2,034,400
	subtotal		\$202,034,400
Groundwater Projects			
GWTP-3	Bond GWTP	CSA	\$14,725,800
GWTP-4	East Elk Grove GWTP Expansion	CSA	\$13,687,000
GWTP-5	Franklin GWTP	SSA	\$18,544,000
GWTP-6	Whitelock GWTP	SSA	\$26,143,800
	subtotal		\$73,100,600
Recycled Water Projects			
RW-1	Recycled Water Project	SSA	\$20,000,000
Storage Projects			
S-2	Suncreek Storage	NSA	\$11,864,500
S-3	Cordova Hills Storage	NSA	\$12,848,700
S-4	White Rock Road Storage	NSA	\$10,880,400
S-5	North Vineyard Station Storage	CSA	\$5,467,500
S-6	Calvine Meadows Pump Station Expansion	CSA	\$5,084,800
	subtotal		\$46,145,900
Pipeline Projects		NSA/CSA/SSA	\$99,778,150
Total			\$441,059,050

^(a) Does not include the City's capacity buy-in cost

9.3.2.4 CIP Summary

Table 9-28 and Figure 9-13 summarize the Zone 40 CIP costs by project category and phase. The Phases A and B NSA projects in Phase 1 have been categorized as storage projects for the purposes of Table 9-28 and Figure 9-13.

Table 9-28. Zone 40 CIP Cost Summary - Cumulative				
Project Categories	Phase 1	Phase 2	Phase 3	Total
Surface Water Projects			\$202,034,400	\$202,034,400
Groundwater Projects	\$14,012,800	\$43,676,300	\$73,100,600	\$130,789,700
Recycled Water Projects			\$20,000,000	\$20,000,000
Storage Projects	\$95,474,140		\$46,145,900	\$141,620,040
Pipeline Projects	\$102,184,500	\$99,778,150	\$99,778,150	\$301,740,800
Non-Specific Project Costs	\$30,000,000			\$30,000,000
Studies	\$1,150,000			\$1,150,000
Total	\$242,821,440	\$143,454,50	\$441,059,050	\$827,334,940

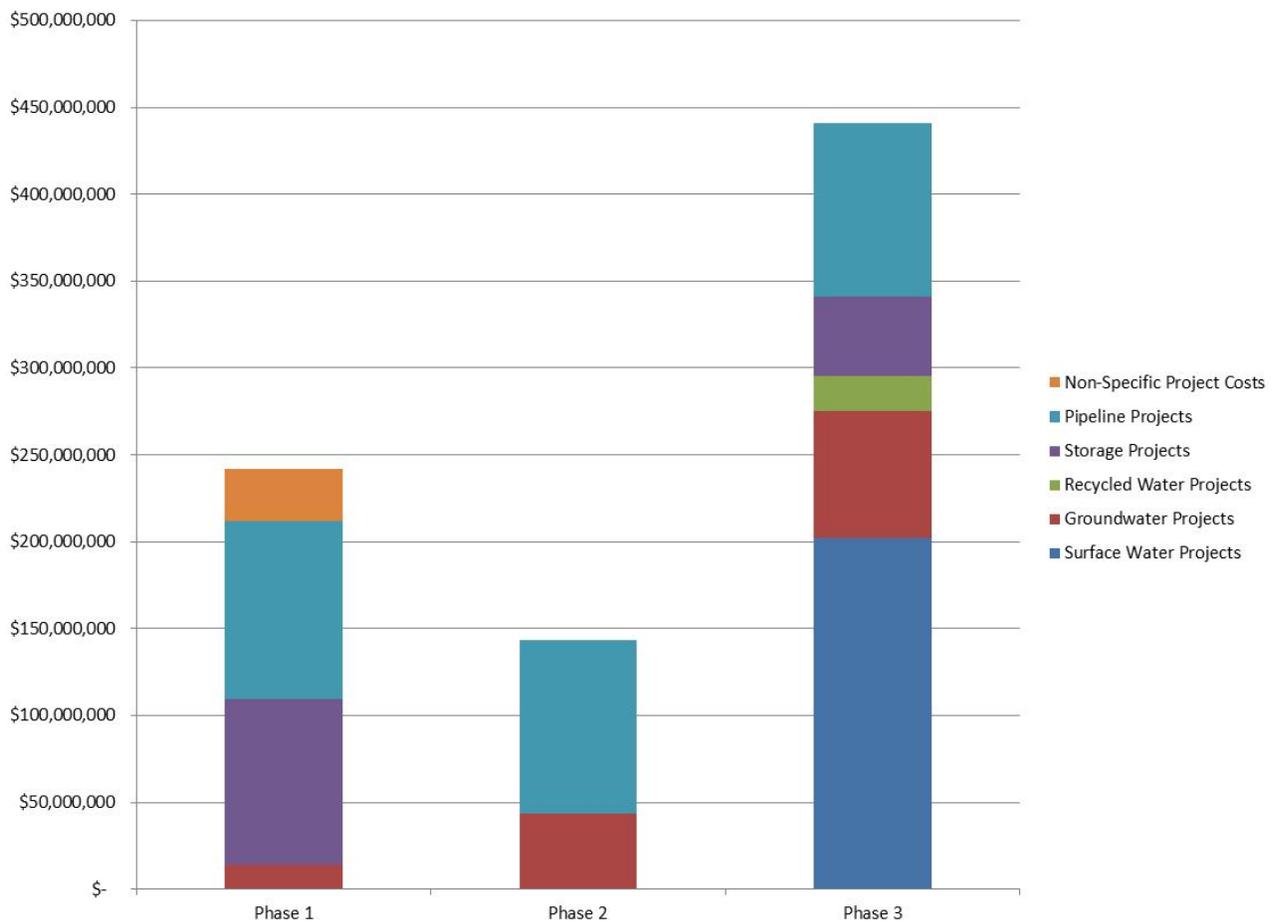


Figure 9-13. CIP Summary by Phase

Section 10

References

- Brown and Caldwell. 2010 Census Analysis. February 2012.
- Brown and Caldwell. 2010 SCWA Urban Water Management Plan. 2011.
- California Department of Water Resources. California's Groundwater. Bulletin 118. Update 2003. October.
- Davis Engineering. Sacramento Central Groundwater Authority 2011-2012 Agricultural Demand and Groundwater Pumping Estimates. May 2014.
- Freeport Regional Water Authority and US Department of the Interior, Bureau of Reclamation. Freeport Regional Water Project Draft Environmental Impact Report/Environmental Impact Statement. July 2003.
- Luhdorff and Scalmanini. Sutter Pointe Specific Plan Groundwater Supply Assessment. 2008.
- Sacramento Central Groundwater Authority. Basin Management Report 2009-2010.
- Sacramento County Water Agency and Water Forum. Central Sacramento County Groundwater Management Plan. February 2006.
- Sacramento County Water Agency. First Amended and Restated Master Water Agreement between Sacramento County Water Agency and Florin Resource Conservation District/Elk Grove Water Service, Successors-in-Interest to Elk Grove Water Works. June 2002.
- Sacramento County Water Agency. Zone 40 Water Supply Master Plan. February 2005.
- Sacramento County Water Agency. Zone 40 Water Supply Master Plan Amendment for the Cordova Hills Project. December 2011.
- Sacramento County Water Agency. Zone 40 Water System Infrastructure Plan. April 2006.
- Sacramento County Water Agency. Zone 40 Residential Unit Water Demand Factors. August 2013.
- Sacramento County Water Agency. Table 3. Annual Average Water Demand Estimate for NewBridge. October 2015.
- Sacramento Suburban Water District, Water System Master Plan. July 2009.
- Sutter Pointe Specific Plan Groundwater Supply Assessment, Table 5-2.
- US Department of the Interior, Bureau of Reclamation. Central Valley Project Municipal and Industrial Water Shortage Policy Scoping Report. July 2011.
- US Department of the Interior, Bureau of Reclamation. Draft Central Valley Project, M&I Water Shortage Policy. September 2001.
- US Department of the Interior, Bureau of Reclamation. Summary of Water Supply Allocations. 2013.
- US Department of the Interior, Bureau of Reclamation. Water Supply and Yield Study. March 2008.
- Water Forum Agreement. January 2000.

Appendix A: Zone 40 Residential Unit Water Demand Factors Technical Memorandum

SACRAMENTO COUNTY WATER AGENCY
INTER-OFFICE CORRESPONDENCE
Department Of Water Resources

TECHINICAL MEMORANDUM

TO: Kerry Schmitz, Principal Civil Engineer; Darrell Eck, Senior Civil Engineer

FROM: SCWA Staff

DATE: 08/30/2013

SUBJECT: Zone 40 Residential Unit Water Demand Factors

This memo documents an evaluation of current Zone 40 residential unit demand factors based on multiple years of historical water meter data.

BACKGROUND

Water demands based on land use data is the preferred approach in developing water demand projections for existing and new growth areas in Zone 40. Combining land use and historical water demand information links water use and land use to a specific geographic location. This linkage of geography and water demand data becomes more apparent when modeling the water distribution system.

During the Water Forum negotiations (1993 to 2000), Boyle Engineering provided stakeholders with a technical methodology for deriving unit water demand factors based on water use data and county land use data. As a result of this effort a set of unit water demand factors (UWDF) were developed for SCWA and other water purveyors that were based on the Sacramento County regional average water use as described in the “Estimate of Annual Water Demand within Sacramento-Wide Area”, (Boyle, May 1995). In this report water demand factors were determined based on 1990 land and water use data rather than actual retail customer data. The report goes on to state:

“To overcome the general incompleteness of the water use information, a methodology was developed wherein the ratio of water demand factors from the 1991 City (of Sacramento) Study was utilized as a basis for apportionment of water use to the specific land use categories in the urban water agencies...the water demand factors were then proportionately scaled up or down to balance the total 1990 water usage with the particular district.”

The Water Forum average annual UWDFs were used in determining the unit water demand factors identified in the 2005 Zone 40 Water Supply Master Plan (WSMP), as shown in Table 1. The left column (Land Use Category) identifies the broad land use categories used at the time of the development of the WSMP. The middle column represents the UWDFs for year 2000. The right-hand column represents the UWDFs for Water Forum Buildout – year 2030 which shows reduced unit water demands of 25.6 percent as a result of water conservation measures mandated in the WFA.

Table 1. Zone 40 Unit Water Demand Factors for Year 2000 and Year 2030 in Ac-Ft/Acre

Land UseCategory	2000	2030
Rural Estate	1.57	1.33
Single Family	3.4	2.89
Multi-Family - Low Density	4.36	3.7
Multi-Family - High Density	4.85	4.12
Commercial	3.24	2.75
Industrial	3.19	2.71
Industrial - Unutilized	0	0
Public	1.22	1.04
Public Recreation	4.08	3.46
Mixed Land Use	2.95	2.51
Right-of-Way	0.25	0.21
Vacant	0	0
Agriculture	0	0

Source: 2005 Zone 40 Water Supply Mater Plan, Tables 2-1 and Table 2-2.

HISTORICAL METER DATA

Since the late 90s and early 2000, meters have been installed increasingly on SCWA’s existing and new retail customers. Currently, approximately 90% of SCWA’s retail customers have active water meters. Meters for the balance of SCWA’s retail customers continue to be added/retrofitted, it is projected that nearly all customers will be metered by 2015. For those meters already in use, a large volume of water usage data has been collected for the purpose of billing (for older metered accounts a considerable amount of water usage data is available). For the purposes of this analysis historical meter data was obtained from the County Utilities Billing System (CUBS).

SCWA collects water usage data every two months. Accordingly, annual water use for each customer should be the total of the six readings recorded each year. In addition to water usage data, Assessor’s Parcel Number (APN), and the zoning (land use) information are also available as part of the meter data set.

The historical meter data set was then used to evaluate the Zone 40 UWDFs. Specifically,

- 1) to develop UWDFs based on the SCWA’s actual water usage data rather than the Sacramento regional average water usage developed more than a decade ago.
- 2) to validate the 2030 UWDFs that assume a 25.6 percent (relative to year 2000) reduction in water demand when implementing the water conservation practices recommended in the WFA.

The resulting UWDF’s from this analysis should provide SCWA staff with information relative to meeting the conservation targets set by the WFA and an ability to decide if changes should be made to the UWDFs represented in the water supply master plan.

METHODOLOGY

The meter data set was processed using Microsoft Access (Access). **Figure 1** shows a sample of the meter database. The first column is “ID”, containing the sequence number for each record. The second column is “APN” number associated with each customer. APN number is also a field used to filter out customers that are not inside Zone 40. The third column is “ReadingDate” that shows the reading date for each record. The fourth column is “Reading” that shows the actual meter reading for each record in hundred cubic feet (ccf). The fifth column is “Consumption” that shows the water usage in cubic feet. The last column contains the Zoning information for each customer’s property.

ID	APN	ReadingDate	Reading	Consumption	Zoning
668679	12108001590000	10/10/2011	1959	1200	RD 7
668680	12108001590000	10/11/2011	1959	0	RD 7
668681	12108001590000	11/21/2011	1987	2800	RD 7
668682	12108001590000	1/18/2012	2006	1900	RD 7
668683	12108001590000	3/19/2012	2016	1000	RD 7
668684	12108001590000	5/18/2012	2035	1900	RD 7
668685	12108001590000	7/19/2012	2074	3900	RD 7
668686	12108001590000	9/19/2012	2111	3700	RD 7
668687	12108001590000	11/20/2012	2138	2700	RD 7
668688	12108001600000	8/10/2004	1393	0	RD 7
668689	12108001600000	11/19/2004	1463	7000	RD 7
668690	12108001600000	1/21/2005	1478	1500	RD 7
668691	12108001600000	3/17/2005	1501	2300	RD 7
668692	12108001600000	5/17/2005	1534	3300	RD 7
668693	12108001600000	7/20/2005	1599	6500	RD 7
668694	12108001600000	9/15/2005	1650	5100	RD 7
668695	12108001600000	11/17/2005	1693	4300	RD 7
668696	12108001600000	1/19/2006	1717	2400	RD 7
668697	12108001600000	3/16/2006	1731	1400	RD 7
668698	12108001600000	5/19/2006	1760	2900	RD 7
668699	12108001600000	7/20/2006	1822	6200	RD 7
668700	12108001600000	9/19/2006	1880	5800	RD 7
668701	12108001600000	11/16/2006	1917	3700	RD 7
668702	12108001600000	1/16/2007	1937	2000	RD 7
668703	12108001600000	3/13/2007	1954	1700	RD 7
668704	12108001600000	5/19/2007	1985	3100	RD 7
668705	12108001600000	7/20/2007	2043	5800	RD 7
668706	12108001600000	9/24/2007	2115	7200	RD 7
668707	12108001600000	11/20/2007	2150	3500	RD 7

Figure 1. Sample of Meter Database

There are over 2 million records in the meter database. The meter data needs to be processed properly to assess the water usage of each land use category in a particular year. This was achieved by creating queries in Access. **Figure 2** shows an example of a query created for water usage for property zoned RD 7 in 2012. For each meter account the query results shows its APN number, lot size, zoning, and total water usage. Average water usage and lot size are then calculated for all the filtered records. The UWDF is then calculated by dividing the average water usage by the average lot size. Figure 3 provides a screenshot of the above referenced query.

Similarly, the UWDFs for each residential land use category were calculated for 2005 through 2012. The UWDFs for non-residential land use were not calculated for this TM.

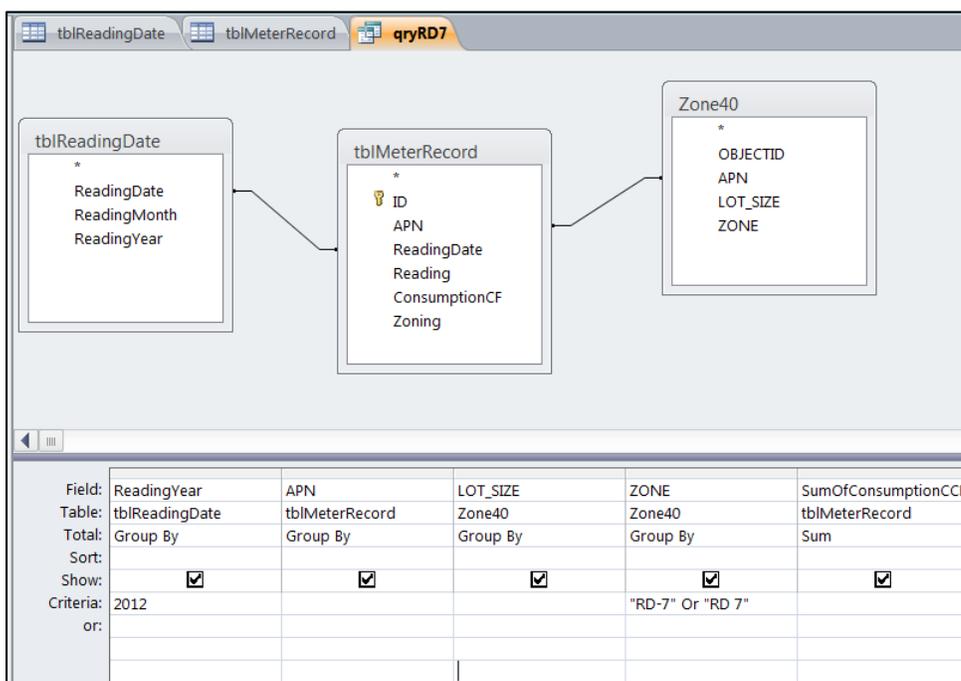


Figure 2. Example of Establishing A Query in the Meter Database

ReadingYear	APN	LOT_SIZE	ZONE	SumOfConsum		
2012	06705400110000	5227	RD 7	13000		
2012	06705400120000	9591	RD 7	17700		
2012	06705400130000	5326	RD 7	12700		
2012	06705400140000	5430	RD 7	11400		
2012	06705400150000	5430	RD 7	29100		
2012	06705400160000	5430	RD 7	25600		
2012	06705400170000	5430	RD 7	15000		
2012	06705400180000	4978	RD 7	11800		
2012	06705400190000	4804	RD 7	19400		
2012	06705400200000	6203	RD 7	29300		
2012	06705400210000	7787	RD 7	36300		
2012	06705400220000	5567	RD 7	4900		
2012	06705400230000	5334	RD 7	17900		
2012	06705400240000	6207	RD 7	21200		
2012	06705400250000	7439	RD 7	27500		
2012	06705400260000	6853	RD 7	25900		
2012	06705400270000	4675	RD 7	9000		
2012	06705400280000	4675	RD 7	66500		
2012	06705400290000	4675	RD 7	17900		
2012	06705400300000	4675	RD 7	28400		
2012	06705400310000	5652	RD 7	32900		
2012	06705400320000	4675	RD 7	18600		
2012	06705400330000	4675	RD 7	14000		
2012	06705400340000	4980	RD 7	23600		
2012	06705400350000	5537	RD 7	19400		
2012	06705400360000	5086	RD 7	11800		
2012	06705400370000	5996	RD 7	35800		
2012	06705400380000	6136	RD 7	26600		
Total				9507	5899.6	17541.8

Record: 19 of 9507 No Filter Search

Number of
Accounts

Average Lot
Size (ft²)

Average Water
Usage (ft³)

Figure 3. Sample Screenshot of the Query Result for RD 7 in 2012

UNIT WATER DEMAND FACTORS BASED ON METER DATA

The UWDF for each residential land use category for each year are shown in **Table 2** below. **Table 2** indicates that there is a significant variation in UWDFs which generally increase with dwelling density. For example, the UWDF is 1.31 Ac-Ft/Acre for RD 1, 2.66 Ac-Ft/Acre for RD 5, and 3.82 Ac-Ft/Acre for RD 20.

Another observation from **Table 2**, despite the variation certain dwelling density groups have UWDFs that are relatively close in value. Based on this “closeness” four residential categories were identified. They include:

- 1) Very low density residential (VLDR), for RD 1 and RD 2.
- 2) Low density residential (LDR), for RD 3 to RD 5.
- 3) Midium density residential (MDR), for RD 7 to RD 15, and
- 4) High density residential (HDR), for RD 20.

The UWDFs for these four categories are shown in **Figures 4 to 7**, respectively. **Figures 4 to 6** show that for lower density residential categories (MDR and below) the UWDFs increased from 2005 to

2008 and then trended down over the next four years. The trend generally coincides with impacts to the broad national and regional economy, but also could be attributed to the weather, rising water rates, as well as water conservation measures implemented by property owners. For higher density residential (see **Figure 7**) this trend is not repeated. In fact, the UWDF for higher density residential actually increased slightly over the past couple of years.

Table 2. Zone 40 Unit Water Demand Factors Based on Meter Data, Unit: Ac-Ft/Acre

Year	Very Low Density Residential (VLDR)		Low Density Residential (LDR)			Medium Density Residential (MDR)			High Density Residential (HDR)
	RD 1	RD 2	RD 3	RD 4	RD 5	RD 7	RD 10	RD 15	RD 20
2005	1.47	2.06	2.74	2.64	2.95	3.42	2.39	3.70	3.07
2006	1.62	2.10	2.69	3.01	3.22	3.76	3.43	3.66	3.77
2007	1.72	2.33	3.04	3.19	3.43	3.97	3.93	4.13	3.74
2008	1.72	2.35	2.97	3.14	3.34	3.86	3.83	3.11	4.07
2009	1.43	1.99	2.66	2.83	2.98	3.43	3.44	3.19	3.76
2010	1.35	1.86	2.45	2.57	2.73	3.13	3.22	3.20	3.60
2011	1.23	1.80	2.37	2.51	2.66	3.04	3.13	3.16	4.38
2012	1.31	1.99	2.55	2.54	2.66	2.97	2.93	2.96	3.82

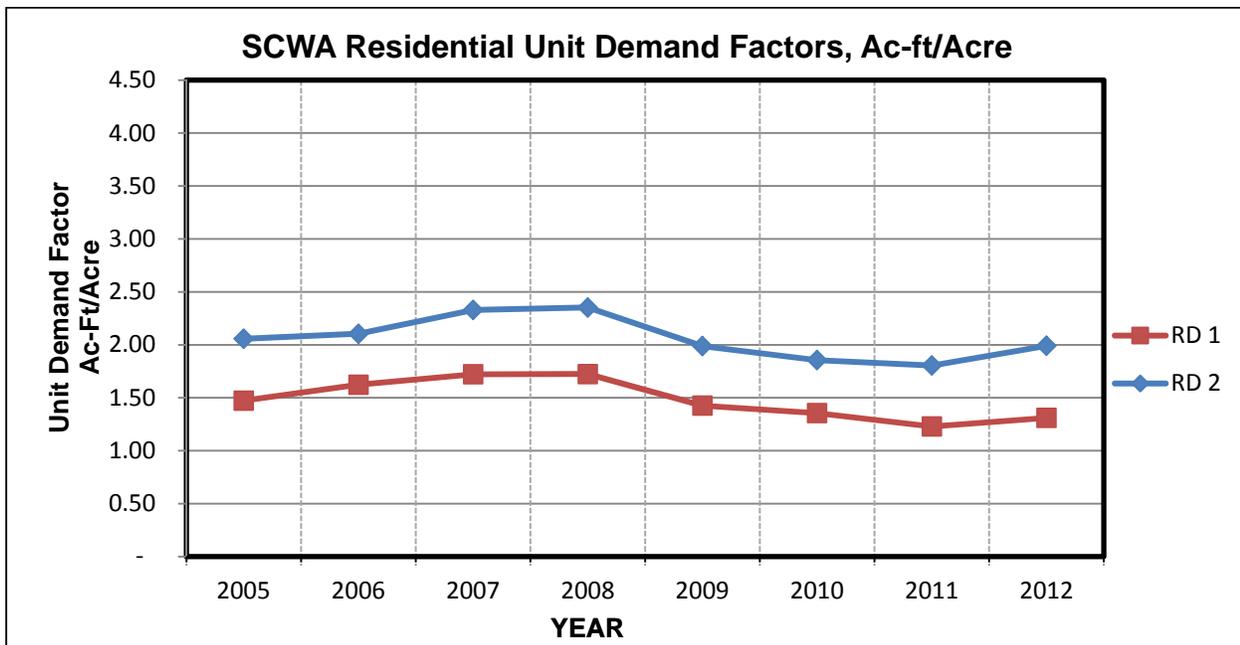


Figure 4. Unit Water Demand Factors for VLDR

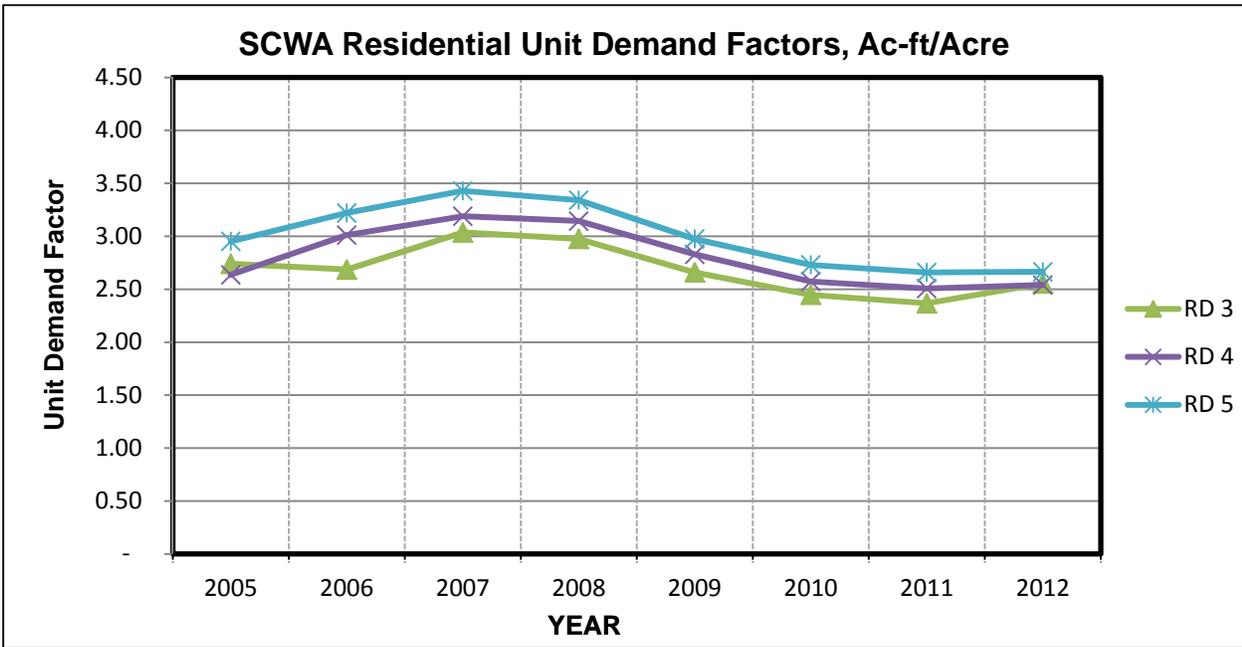


Figure 5. Unit Water Demand Factors for LDR

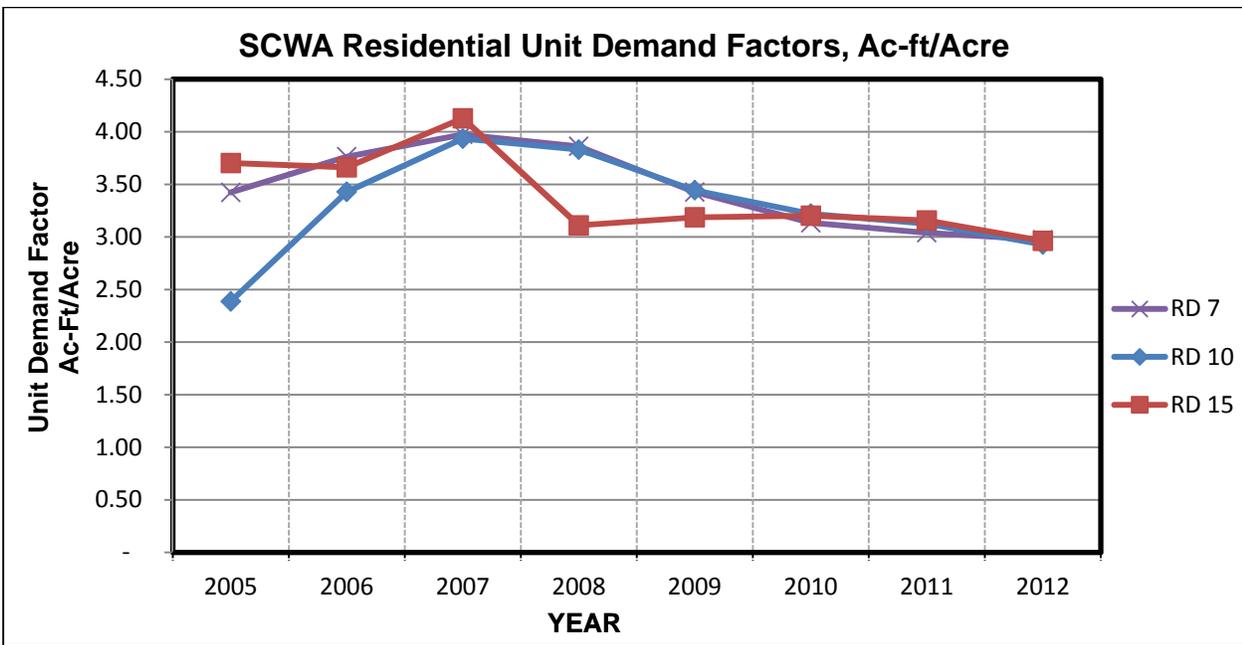


Figure 6. Unit Water Demand Factors for MDR

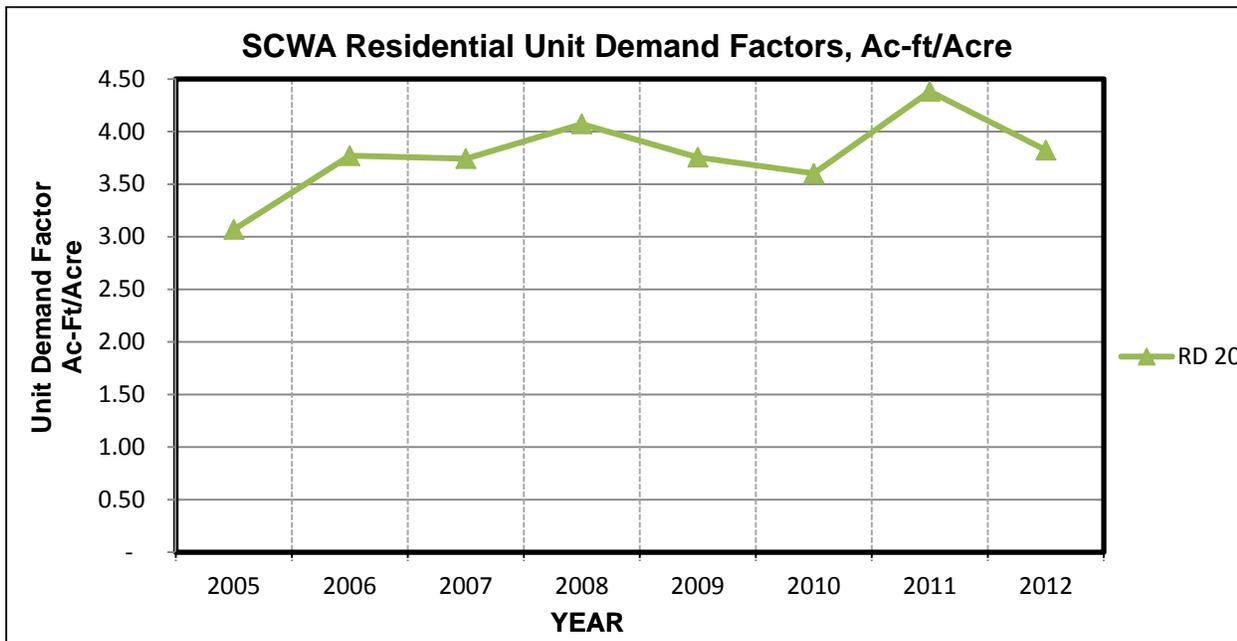


Figure 7. Unit Water Demand Factors for High Density Residential

Table 3 shows the total number of meter accounts for each zoning type from 2005 to 2012. The large majority of meter accounts are associated with RD 4, RD 5, and RD 7 zoning. In 2012, there were 32,930 meter accounts in Zone 40 that were used for this analysis. Of these accounts 0.5% were very low density residential, 64.4% were low density residential, 32.3% were medium density, and 2.7% were high density residential. **Table 4** shows the average lot size in square feet of each residential zoning type.

Table 3. Total Number of Residential Meter Accounts in Zone 40

Year	RD 1	RD 2	RD 3	RD 4	RD 5	RD 7	RD 10	RD 15	RD 20
2005	47	114	179	2,130	13,807	8,120	412	197	684
2006	48	116	200	2,441	15,385	8,853	773	228	737
2007	48	118	202	2,638	16,303	9,071	831	229	765
2008	48	118	209	2,782	16,808	9,302	875	235	868
2009	49	118	209	2,820	17,086	9,377	884	239	881
2010	48	118	209	2,894	17,421	9,423	893	239	887
2011	49	118	209	2,955	17,665	9,445	897	239	897
2012	49	118	209	3,024	17,983	9,507	899	239	902

Table 4. Average Residential Lot Size in Zone 40, 2005 – 2012 in Square Feet

Year	RD 1	RD 2	RD 3	RD 4	RD 5	RD 7	RD 10	RD 15	RD 20
2005	46,044	22,692	11,897	9,592	7,992	5,860	5,803	5,376	11,862
2006	46,292	22,685	11,750	9,720	7,952	5,846	5,267	5,281	11,653
2007	46,292	22,682	11,767	9,717	7,966	5,837	5,375	5,277	12,804
2008	46,292	22,682	11,888	9,738	7,956	5,841	5,380	6,681	11,814
2009	47,036	22,682	11,888	9,752	7,948	5,838	5,385	6,649	11,973
2010	46,292	22,682	11,888	9,777	7,928	5,898	5,372	6,649	11,913
2011	47,036	22,682	11,888	9,775	7,916	5,900	5,371	6,649	11,803
2012	47,036	22,682	11,888	9,770	7,897	5,900	5,373	6,649	12,453

In water supply planning, water demand estimates are typically performed by applying the UWDF to the acreage of a certain land use category. Most often, the density information (dwelling units per acre) are not specified in a land use map, particularly in the general plan process or early planning stages of a development project. Parcels planned for development are generally identified as “very low density residential”, “low density residential”, “medium density residential”, or “high density residential”. This necessitates the development of a composite UWDF to represent each category.

By using the information provided in **Tables 2 to 4**, a weighted average UWDF was developed for each category. Further, a three-year moving average was calculated for these composite UWDFs to take into account various hydrologic conditions and weather (see **Table 5**). An average of the previous three years (as opposed to a longer period) is preferred because it is more representative of the current water use pattern as well as reflective of water conservation measures taken. Therefore, the numbers shown in the last row (highlighted) of **Table 5** are recommended as the current UWDF for each residential category.

Table 5. Three-Year Moving Average Unit Water Demand Factors in Ac-Ft/Acre

Year	Very Low Density Residential (VLDR)	Low Density Residential (LDR)	Midium Density Residential (MDR)	High Density Residential (HDR)
2005				
2006				
2007	2.00	3.15	3.70	3.53
2008	2.10	3.29	3.85	3.86
2009	2.05	3.21	3.75	3.86
2010	1.90	2.98	3.47	3.81
2011	1.72	2.76	3.20	3.91
2012	1.71	2.66	3.05	3.94

NET ACREAGE AND GROSS ACREAGE BASED UNIT WATER DEMAND FACTORS

Net acreage is defined as the acreage of all residential lots in a subdivision excluding minor streets. Gross acreage is defined as the total acreage of a subdivision including all residential lots and minor streets. Typically, approximately 20% of the land is dedicated to minor streets in a subdivision.

To calculate projected water demand for a subdivision, the UWDF corresponding to the planned land use category is multiplied by the acreage of a subdivision. If net acreage is used, then a net acreage based UWDF should be applied. Similarly, if the gross acreage is used then a gross acreage based UWDF should be applied.

The UWDFs developed from meter data and shown in **Table 5** are net acreage based. To convert to gross net acreage based value, the net acreage based UWDF should be reduced by 20% to take into account acreage for minor streets. **Table 6** shows the net acreage and gross acreage based UWDFs.

Table 6. Net Acreage and Gross Acreage Based Water Demand Factors in Ac-Ft/Acre

Land Use Category	Net Acreage Based	Gross Acreage Based
Very Low Density Residential (VLDR)	1.71	1.37
Low Density Residential (LDR)	2.66	2.13
Midium Density Residential (MDR)	3.05	2.44
High Density Residential (HDR)	3.94	3.15

COMPARISION TO WSMP

As mentioned earlier, the UWDF in the WSMP for build-out was developed based on a combination of regional water and land use data and an assumption of a 25.6% demand reduction as a result of conservation measures mandated by the WFA. By using extensive historical meter data, the UWDFs developed in this TM should give staff a higher level of confidence when evaluating future water demands and water supply reliability. **Table 7** shows how UWDFs developed based on meter data in this TM compared to those in the current WSMP. It should be noted that the UWDFs in the WSMP are gross acreage based values.

As shown in **Table 7**, the UWDFs developed in this TM are lower than those in the WSMP, with the exception of the “very low density residential” category, which is only slightly higher. The UWDF of 2.89 Ac-Ft/Acre for “Single Family Residential” in the WSMP (corresponding ot “Low Density

Residential”) is now 2.13 Ac-Ft/Acre based on meter data. The value for “Multi-Family Low Density” (corresponding to “Medium Density Residential”) is 3.70 Ac-Ft/Acre in the WSMP as opposed to 2.44 Ac-Ft/Acre based on meter data. For “Multi-Family High Density” (corresponding to “High Density Residential”) the value is 4.12 Ac-Ft/Acre in the WSMP compared to 3.15 Ac-ft/Acre based on meter data.

Table 7. Comparison of Unit Water Demand Factors between WSMP and This TM, in Ac-Ft/Acre

Land Use Category in WSMP	Land Use Category in This TM	2030 Unit Water Demand Factor in WSMP	Unit Water Demand Factor Based on Meter Data (Gross Acreage Based)
Rural Estate	Very Low Density Residential (VLDR)	1.33	1.37
Single Family	Low Density Residential (LDR)	2.89	2.13
Multi-Family - Low Density	Midium Density Residential (MDR)	3.70	2.44
Multi-Family - High Density	High Density Residential (HDR)	4.12	3.15

RECOMMENDATIONS

SCWA’s meter database provides a extensive historical water use record of its customers. Using a sound statistical approach, along with the land use information in the meter database, a UWDF was developed for each residential density category. This process when compared to the approach taken in the 2005 WSMP has the following advantages:

- The meter data is unique to Zone 40
- The meter data covers a long period of time
- The UWDFs for buildout in the WSMP are projected or targeted numbers assuming a reduction of 25.6% of water use (relative to year 2000) due to improved conservation practices. The UWDFs based on meter data are not projected or targeted numbers instead, they represent the actual historical water use.

The resulting UWDFs indicate that those referenced in the WSMP were overestimated. It also indicates that SCWA has been moving in the right direction with regard to water conservation and demand management. It is recommended that the results documented in this TM should be considered for incorporation in future water supply master plan updates and other water planning documents.

For non-residential/commercial customers, the UWDFs have not been evaluated based on meter data in this TM, primarily due to low number of meter accounts and a greater variation in water use

because of significant differences in commercial activities. It is recommended that the UWDFs currently described in the WSMP continue to be used for non-residential/commercial applications until more data becomes available.

Appendix B: Baseline Supply and Demand Comparison Tables

Table B-1. Maximum Day Demand to Supply Comparison for NSA, mgd

NSA	2013	Phase 1			Phase 2		Phase 3				
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Demand											
Maximum day	7.4	9.5	13.3	18.5	24.1	32.3	41.4	51.0	56.1	56.1	
Existing supply capacity											
Mather Housing GWTP	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Anatolia GWTP	6.5	6.5									
total groundwater	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Vineyard SWTP											
Total	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Planned future supply capacity											
surface water, Vineyard SWTP			16.0	32.5	32.5	32.5	32.5	32.5	65.0	65.0	
Total supply capacity											
groundwater	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
surface water	0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	65.0	65.0	
Total	12.5	12.5	22.0	38.5	38.5	38.5	38.5	38.5	71.0	71.0	
Use of supply: average/wet years											
groundwater	7.4	9.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
surface water	0.0	0.0	13.3	18.5	24.1	32.3	41.4	51.0	56.1	56.1	
Total	7.4	9.5	13.3	18.5	24.1	32.3	41.4	51.0	56.1	56.1	
Use of supply: dry years											
groundwater	7.4	9.5	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	
surface water	0.0	0.0	11.3	16.5	22.1	30.3	39.4	49.0	54.1	54.1	
Total	7.4	9.5	13.3	18.5	24.1	32.3	41.4	51.0	56.1	56.1	

Table B-2. Maximum Day Demand to Supply Comparison for CSA, mgd

	2013	Phase 1			Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2051
Demand										
Maximum day	27.0	29.2	32.8	37.7	42.6	49.7	57.2	61.5	61.5	61.5
Existing supply capacity										
Calvine Meadows GWTP	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
East Elk Grove GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
East Park GWTP	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
Waterman GWTP	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6
Wildhawk GWTP	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5
CSA DirectFeed	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9
total groundwater	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4
Vineyard SWTP	50.0	50.0	34.0	17.5	17.5	17.5	17.5	17.5	17.5	17.5
Total	84.4	84.4	68.4	51.9	51.9	51.9	51.9	51.9	51.9	51.9
Planned future supply capacity										
West Jackson GWTP					9.0	18.0	18.0	18.0	18.0	18.0
Bond GWTP									6.5	6.5
East Elk Grove GWTP expansion									6.5	6.5
total groundwater					9.0	18.0	18.0	18.0	31.0	31.0
Vineyard SWTP expansion									17.5	17.5
City POU supply										19.1
total surface water									17.5	36.6
Total supply capacity										
groundwater	34.4	34.4	34.4	34.4	43.4	52.4	52.4	52.4	65.4	65.4
surface water	50.0	50.0	34.0	17.5	17.5	17.5	17.5	17.5	35.0	54.1
Total	84.4	84.4	68.4	51.9	60.9	69.9	69.9	69.9	100.4	119.5
Use of supply: average/wet years										
groundwater	0.0	0.0	0.0	20.2	25.1	32.2	39.7	44.0	26.5	7.4
surface water	27.0	29.2	32.8	17.5	17.5	17.5	17.5	17.5	35.0	54.1
Total	27.0	29.2	32.8	37.7	42.6	49.7	57.2	61.5	61.5	61.5
Use of supply: dry years										
groundwater	27.0	29.2	32.8	34.4	42.6	49.7	52.4	52.4	61.5	61.5
surface water	0.0	0.0	0.0	3.3	0.0	0.0	4.8	9.1	0.0	0.0
Total	27.0	29.2	32.8	37.7	42.6	49.7	57.2	61.5	61.5	61.5



SSA	2013	Phase 1				Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Demand											
Maximum day	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6	46.6
Existing supply capacity											
Big Horn GWTP	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5
Dwight Road GWTP	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
Lakeside GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
Poppy Ridge GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
SSA Direct Feed	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0
total groundwater	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6
Franklin Intertie to City	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
SSA Recycled Water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
Total	65.3										
Planned future supply capacity											
Poppy Ridge GWTP expansion				6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
Big Horn GWTP expansion						8.5	8.5	8.5	8.5	8.5	8.5
Franklin GWTP										7.0	7.0
Whitelock GWTP											13.0
total groundwater			0.0	6.5	6.5	15.0	15.0	15.0	15.0	22.0	35.0
recycled water										2.9	2.9
Total supply capacity											
groundwater	25.6	25.6	25.6	32.1	32.1	40.6	40.6	40.6	40.6	47.6	60.6
surface water	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	39.7	39.7	39.7	46.2	46.2	54.7	54.7	54.7	54.7	64.6	64.6
Use of supply: average/wet years											
groundwater	13.0	16.4	21.1	26.2	31.6	32.5	32.5	32.5	32.5	29.7	29.7
surface water	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6	46.6
Use of supply: dry years											
groundwater	24.1	25.6	25.6	32.1	32.1	40.6	40.6	40.6	40.6	40.8	40.8
surface water	0.0	1.9	6.6	5.2	10.6	3.0	3.0	3.0	3.0	0.0	0.0
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6	46.6

Table B-4. Maximum Day Demand to Supply Comparison for Zone 40, mgd

Zone 40		Phase 1				Phase 2		Phase 3			
		2013	2015	2020	2025	2030	2035	2040	2045	2050	2052
Maximum day demand											
Zone 40 total		61.5	69.1	81.3	96.5	112.5	128.6	145.2	159.1	164.1	164.1
Existing supply capacity											
groundwater		72.5	72.5	66.0	66.0	66.0	66.0	66.0	66.0	66.0	66.0
surface water		61.1	61.1	45.1	28.6	28.6	28.6	28.6	28.6	28.6	28.6
recycled water		3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
Total		136.6	136.6	114.1	97.6	97.6	97.6	97.6	97.6	97.6	97.6
Planned future supply capacity											
groundwater		0.0	0.0	0.0	6.5	15.5	33.0	33.0	33.0	53.0	66.0
surface water		0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	82.5	101.6
recycled water								0.0	0.0	2.9	2.9
Total supply capacity											
groundwater		72.5	72.5	66.0	72.5	81.5	99.0	99.0	99.0	119.0	132.0
surface water		61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	111.1	130.2
recycled water		3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total		136.6	136.6	130.1	136.6	145.6	163.1	163.1	163.1	236.0	268.1
Use of supply: average/wet years											
groundwater		20.4	25.8	21.1	46.4	56.8	64.7	72.2	76.5	56.1	37.0
surface water		38.1	40.3	57.2	47.1	52.7	60.9	70.0	79.6	102.2	121.3
recycled water		3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total		61.5	69.1	81.3	96.5	112.5	128.6	145.2	159.1	164.1	164.1
Use of supply: dry years											
groundwater		58.5	64.3	60.4	68.5	76.7	92.3	95.0	95.0	104.3	104.3
surface water		0.0	1.9	17.9	25.0	32.7	33.3	47.2	61.1	54.0	54.0
recycled water		3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total		61.5	69.1	81.3	96.5	112.5	128.6	145.2	159.1	164.1	164.1

Table B-5. Conjunctive Use Metrics

Parameter		Phase 1				Phase 2		Phase 3			
		2013	2015	2020	2025	2030	2035	2040	2045	2050	2052
Provided Capacity											
surface water, % of demand		99.3%	88.4%	75.2%	63.3%	54.3%	47.5%	42.1%	38.4%	67.7%	79.3%
groundwater, % of demand		117.8%	104.9%	81.2%	75.2%	72.5%	77.0%	68.2%	62.2%	72.5%	80.4%
Total		217.2%	193.3%	156.4%	138.5%	126.8%	124.5%	110.3%	100.6%	140.2%	159.8%
Use in wet/average years											
surface water, % of demand		62.0%	58.3%	70.3%	48.8%	46.8%	47.3%	48.2%	50.1%	62.2%	73.9%
groundwater, % of demand		33.1%	37.4%	26.0%	48.1%	50.5%	50.3%	49.7%	48.1%	34.2%	22.6%
surface water, % of surface water capacity		62.4%	65.9%	93.6%	77.0%	86.2%	99.7%	114.5%	130.4%	92.0%	93.1%
groundwater, % of groundwater capacity		28.1%	35.6%	32.0%	64.0%	69.7%	65.4%	73.0%	77.2%	47.2%	28.0%
Use in dry years											
surface water, % of demand		0.0%	2.7%	22.0%	25.9%	29.1%	25.9%	32.5%	38.4%	32.9%	32.9%
groundwater, % of demand		95.1%	93.0%	74.3%	71.0%	68.2%	71.8%	65.4%	59.7%	63.5%	63.5%
surface water, % of wet/average year use		0.0%	4.6%	31.3%	53.0%	62.1%	54.7%	67.5%	76.7%	52.9%	44.5%
groundwater, % of groundwater capacity		80.7%	88.6%	91.5%	94.5%	94.2%	93.3%	96.0%	96.0%	87.6%	79.0%

Note: Recycled water values not presented.



Table B-6. Annual Supply Capacity and Use - NSA

NSA		2013	Phase 1				Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	2048-Buildout	
Demand	Annual, ac-ft/yr	4,200	5,300	7,400	10,300	13,500	18,100	23,200	28,600	31,400	31,400	
Supply capacity, ac-ft/yr	groundwater	7,000	7,000	3,400	3,400	3,400	3,400	3,400	3,400	3,400	3,400	
	surface water	-	-	9,000	18,200	18,200	18,200	18,200	18,200	36,400	36,400	
	Total	7,000	7,000	12,300	21,600	21,600	21,600	21,600	21,600	39,800	39,800	
Use of supply: average/wet years	groundwater	4,100	5,300	-	-	-	-	-	-	-	-	
	surface water	-	-	7,400	10,300	13,500	18,100	23,200	28,600	31,400	31,400	
	Total	4,100	5,300	7,400	10,300	13,500	18,100	23,200	28,600	31,400	31,400	
Use of supply: dry years	groundwater	4,100	5,300	1,100	1,100	1,100	1,100	1,100	1,100	1,100	1,100	
	surface water	-	-	6,300	9,200	12,400	17,000	22,100	27,500	30,300	30,300	
	Total	4,100	5,300	7,400	10,300	13,500	18,100	23,200	28,600	31,400	31,400	

Table B-7. Annual Supply Capacity and Use - CSA

CSA		2013	Phase 1				Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	2048-Buildout	
Demand	Annual, ac-ft/yr	15,100	16,300	18,400	21,100	23,900	27,800	32,100	34,400	34,400	34,400	
Supply capacity, ac-ft/yr	groundwater	19,300	19,300	19,300	19,300	24,300	29,300	29,300	29,300	36,600	36,600	
	surface water	28,000	28,000	19,000	9,800	9,800	9,800	9,800	9,800	19,600	30,300	
	Total	47,300	47,300	38,300	29,100	34,100	39,100	39,100	39,100	56,200	66,900	
Use of supply: average/wet years	groundwater	-	-	-	11,300	14,100	18,000	22,200	24,600	14,800	4,100	
	surface water	15,100	16,300	18,400	9,800	9,800	9,800	9,800	9,800	19,600	30,300	
	Total	15,100	16,300	18,400	21,100	23,900	27,800	32,000	34,400	34,400	34,400	
Use of supply: dry years	groundwater	15,100	16,300	18,400	19,300	23,900	27,800	29,300	29,300	34,400	34,400	
	surface water	-	-	-	1,800	-	-	2,700	5,100	-	-	
	Total	15,100	16,300	18,400	21,100	23,900	27,800	32,000	34,400	34,400	34,400	

Table B-8. Annual Supply Capacity and Use - SSA

SSA		2013	Phase 1				Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	2048-Buildout	
Demand	Annual, ac-ft/yr	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100	
Supply capacity, ac-ft/yr	groundwater	14,300	14,300	14,300	18,000	18,000	22,700	22,700	22,700	26,700	33,900	
	surface water	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300	
	Total	22,200	22,200	22,200	25,900	25,900	30,600	30,600	30,600	36,200	43,400	
Use of supply: average/wet years	groundwater	7,300	9,200	11,800	14,700	17,700	18,200	18,200	18,200	16,600	16,600	
	surface water	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300	
	Total	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100	
Use of supply: dry years	groundwater	13,500	14,300	14,300	18,000	18,000	22,700	22,700	22,700	22,800	22,800	
	surface water	-	1,000	3,700	2,900	6,000	1,700	1,700	1,700	-	-	
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300	
	Total	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100	



Table B-9. Annual Supply Capacity and Use - Total

Total Zone 40		Phase 1				Phase 2		Phase 3			
		2013	2015	2020	2025	2030	2035	2040	2045	2050	2048-Buildout
Demand	Annual, ac-ft/yr	34,500	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Supply capacity, ac-ft/yr	groundwater	40,600	40,600	37,000	40,600	45,600	55,400	55,400	55,400	66,600	73,900
	surface water	34,200	34,200	34,200	34,200	34,200	34,200	34,200	34,200	62,200	72,900
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	76,500	76,500	72,900	76,500	81,500	91,300	91,300	91,300	132,100	150,100
Use of supply: average/wet years	groundwater	11,400	14,500	11,800	26,000	31,800	36,300	40,500	42,800	31,400	20,700
	surface water	21,400	22,600	32,000	26,400	29,500	34,100	39,200	44,600	57,200	67,900
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	34,500	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Use of supply: dry years	groundwater	32,800	36,000	33,800	38,400	43,000	51,700	53,200	53,200	58,400	58,400
	surface water	-	1,000	10,000	14,000	18,300	18,600	26,400	34,200	30,300	30,300
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	34,500	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900

Table B-10. Supply and Demand Comparison-Normal Year, ac-ft/yr

Supply and Demand Comparison-Normal Year, ac-ft/yr										
	2015	2020	2025	2030	2035	2040	2045	2050	2052	
Supplies, no facility constraints										
US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
Appropriative water	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	185,500	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900	
Difference	146,800	140,000	131,500	122,500	113,500	104,200	96,400	95,200	95,200	

Table B-11. Use of Supply Normal Year, ac-ft/yr

Use of Supply-Normal Year, ac-ft/yr									
	2015	2020	2025	2030	2035	2040	2045	2050	2052
Use of supplies									
Surface water	22,600	32,000	26,400	29,500	34,100	39,200	44,600	57,200	67,900
Remediated groundwater									
Groundwater	14,500	11,800	26,000	31,800	36,300	40,500	42,800	31,400	20,700
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Total	38,800	45,500	54,100	63,000	72,100	81,400	89,100	91,900	91,900
Surface water use breakdown									
US Bureau of Reclamation-CVP supply	22,600	32,000	26,400	29,500	34,100	39,200	44,600	45,000	45,000
Appropriative water	-	-	-	-	-	-	-	12,200	22,900
City of Sacramento American River POU water rights									
Other surface water supplies									
Surface water plus remediated groundwater	22,600	32,000	26,400	29,500	34,100	39,200	44,600	57,200	67,900

Table B-12. Supply and Demand Comparison - Single Dry Year, ac-ft/yr

Supply and Demand Comparison-Single Dry Year, ac-ft/yr									
	2015	2020	2025	2030	2035	2040	2045	2050	2052
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply allocation	11,300	16,000	13,200	14,800	17,100	19,600	22,300	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	101,500	106,200	103,400	105,000	107,300	109,800	112,500	114,300	114,300
Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	62,800	60,700	49,400	42,000	35,300	28,500	23,400	22,400	22,400

Table B-13. Use of Supply - Single Dry Year, ac-ft/yr

Use of Supply-Single Dry Year, ac-ft/yr									
	2015	2020	2025	2030	2035	2040	2045	2050	2052
Use of supplies									
Surface water	1,000	1,100	5,100	9,400	9,700	17,500	25,300	21,400	21,400
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Groundwater	27,100	33,800	38,400	43,000	51,700	53,200	53,200	58,400	58,400
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Total	38,700	45,500	54,100	63,000	72,000	81,300	89,100	92,000	92,000
Surface water use breakdown									
US Bureau of Reclamation-CVP supply	1,000	1,100	5,100	9,400	9,700	17,500	25,300	21,400	21,400
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	-	-	-	-	-	-	-	-	-
Surface water plus remediated groundwater	1,000	10,000	14,000	18,300	18,600	26,400	34,200	30,300	30,300

Table B-14. Supply and Demand Comparison – Multiple Dry Years

Year		2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2048)
First year	Supplies									
	US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
	Appropriative water	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
	City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
	Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	146,800	140,000	131,500	122,500	113,500	104,200	96,400	95,200	95,200	
Second year	Supplies									
	US Bureau of Reclamation-CVP supply	17,000	24,000	19,800	22,100	25,600	29,400	33,500	33,800	33,800
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	107,200	114,200	110,000	112,300	115,800	119,600	123,700	125,600	125,600
	Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	68,500	68,700	56,000	49,300	43,800	38,300	34,600	33,700	33,700	
Third year	Supplies									
	US Bureau of Reclamation-CVP supply	11,300	16,000	13,200	14,800	17,100	19,600	22,300	22,500	22,500
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	101,500	106,200	103,400	105,000	107,300	109,800	112,500	114,300	114,300
	Demand	38,700	45,500	54,000	63,000	72,000	81,300	89,100	91,900	91,900
Difference	62,800	60,700	49,400	42,000	35,300	28,500	23,400	22,400	22,400	

Table B-15. NSA Upper Zone Storage Capacity Evaluation					
	2013	Phase 1 (2015-2025)	Phase 2 (2026-2035)	Phase 3 (2036-2052)	Notes
Maximum day demand, mgd	0.0	2.5	5.0	7.9	Cordova Hills (4,451 ac-ft/yr)
Peak hour demand, mgd	0.0	5.0	10.0	15.8	
Provided storage volume, MG					
Existing					
North Douglas	3.0	3.0	3.0	3.0	
Future					
Cordova Hills				3.0	
Total	3.0	3.0	3.0	6.0	
Required storage volume, MG					
Equalization	0.0	0.5	1.0	1.6	Assume 20% MDD.
Fire	0.5	0.5	0.5	0.5	Assume volume for one fire at 3,000 gpm for 3 hours.
Emergency	0.0	0.4	0.8	1.3	Assume 1/3 average day.
Total	0.5	1.4	2.3	3.4	
Difference (provided minus required)	2.5	1.6	0.7	2.6	Could downsize Cordova Hills tank.

Table B-16. NSA Upper Zone Pump Station Capacity Evaluation					
	2013	Phase 1 (2015-2025)	Phase 2 (2026-2035)	Phase 3 (2036-2052)	Notes
Provided pumping capacity, mgd					
Existing					
North Douglas	19.4	19.4	19.4	19.4	Very large capacity for such a small demand.
Upper zone max day supply	0.0	2.5	5.0	7.9	
from storage	19.4	16.9	14.4	11.5	
Future					
Cordova Hills				21.6	
Total from storage	19.4	16.9	14.4	33.1	
Required peak hour capacity from storage, mgd	0.0	2.5	5.0	7.9	Capacity increment above maximum day demand capacity.
Required fire flow from storage, mgd	4.3	4.3	4.3	4.3	4.3 mgd for one fire, max day supply accounted for above.
Required capacity from storage	4.3	4.3	5.0	7.9	Greater of pk hr or fire.
Difference (provided minus required)	15.1	12.6	9.4	25.2	Substantial surplus capacity.
Summary					
Total provided pump station capacity, mgd	38.8	36.3	33.8	52.5	
Total required pump station capacity					
from storage, mgd	4.3	4.3	5.0	7.9	
for max day supply capacity, mgd	0.0	2.5	5.0	7.9	
Total	4.3	6.8	10.0	15.8	

Table B-17. NSA Main Zone Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Maximum day demand, mgd	7.4	14.1	24.4	42.3	NSA 56.1 mgd minus Cordova Hills (7.9 mgd) and half of Rio del Oro (5.9 mgd).
Peak hour demand, mgd	14.8	28.2	48.8	84.6	
Provided storage volume, MG					
Existing					
Mather Housing GWTP	0.5	0.5	0.5	0.5	
Anatolia GWTP	4.0	4.0	4.0	4.0	
Mather 1 Main Base	1.0	1.0	1.0	1.0	
Mather 2	0.3	0.3	0.3	0.3	
subtotal	5.8	5.8	5.8	5.8	
Future					
Phase B NSA Project		10.0	10.0	10.0	
White Rock				3.0	
Suncreek				3.0	
subtotal	0.0	10.0	10.0	16.0	
Total	5.8	15.8	15.8	21.8	
Required storage volume, MG					
Equalization	1.5	2.8	4.9	8.5	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	1.2	2.4	4.1	7.1	Assume 1/3 average day.
Total	3.8	6.3	10.0	16.6	Could phase in the Phase B NSA Project storage.
Difference (provided minus required)	2.0	9.5	5.8	5.2	

Table B-18. NSA Main Zone Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Provided pumping capacity, mgd					
Existing					
Mather Housing GWTP	5.2	5.2	5.2	5.2	
GWTP	3.0	3.0	3.0	3.0	Assume half of GWTP supplies pump station.
from storage	2.2	2.2	2.2	2.2	
Anatolia GWTP/Storage (a)	11.2	22.5	22.5	22.5	
GWTP/part of MD supply from Vineyard SWTP	6.5	4.7	8.1	14.1	Assume 2/3 of main zone MD demand through NSA terminal and 1/3 through Anatolia tanks.
from storage	4.7	17.8	14.4	8.4	
Mather 1 Main Base	5.2	5.2	5.2	5.2	
Mather 2	2.0	2.0	2.0	2.0	Elevated tank, assumed flow.
subtotal from storage	14.1	27.2	23.8	17.8	
Future					
White Rock				14.4	
Suncreek				18.0	
Phase B NSA-total capacity (b)		64.0	64.0	64.0	Total pump station capacity.
max day supply for Cal Am Rio del Oro		1.0	3.0	5.9	Max day supply for Cal Am tank. Not from storage.
max day supply for upper zone		2.5	5.0	7.9	Supply to North Douglas and Cordova Hills tanks. Not from storage.
part of max day supply from Vineyard SWTP for main zone		9.4	16.3	28.2	Assume 2/3 through NSA terminal and 1/3 through Anatolia tanks.
subtotal, pumping not from Phase B NSA storage		12.9	24.3	42.0	
subtotal, capacity available to pump from Phase B NSA Project storage		51.1	39.7	22.0	
subtotal from storage		51.1	39.7	54.4	
Total from storage	14.1	78.3	63.5	72.2	
Required peak hour capacity from storage, mgd	7.4	14.1	24.4	42.3	
Difference (provided minus required)	6.7	64.2	39.1	29.9	Could phase in the NSA terminal storage pump station capacity.
Summary					
Total provided pump station capacity, mgd	23.6	98.9	98.9	131.3	
Total required pump station capacity					
from storage, mgd	7.4	14.1	24.4	42.3	
for max day supply capacity, mgd	9.5	20.6	35.4	59.1	
Total	16.9	34.7	59.8	101.4	
(a) When Phase A NSA is completed, Anatolia will pump through supply from Vineyard SWTP.					
(b) Calculation of Phase B NSA pump station capacity available to supply from storage the main zone's pk hr increment.					

Table B-19. CSA Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Maximum day demand, mgd	27.0	37.9	50.2	61.5	
Peak hour demand, mgd	54.0	75.8	100.4	123.0	
Provided storage volume, MG					
Existing					
Calvine Meadows GWTP	0.35	0.35	0.35	0.35	
East Elk Grove GWTP	3.5	3.5	3.5	3.5	
East Park GWTP	0.5	0.5	0.5	0.5	
Waterman GWTP	7.0	7.0	7.0	7.0	
Wildhawk GWTP	3.0	3.0	3.0	3.0	
Vineyard SWTP clearwell	6.0	6.0	6.0	6.0	Assumed equalization storage available from 20 mgd clearwell.
subtotal	20.4	20.4	20.4	20.4	
Future					
West Jackson GWTP			4.0	4.0	
East Elk Grove GWTP expansion				0.0	
Bond GWTP				0.5	
North Vineyard Station				4.0	
Calvine Meadows GWTP expansion				0.0	
subtotal			4.0	8.5	
Total	20.4	20.4	24.4	28.9	Planned storage volume.
Required storage volume, MG					
Equalization	5.4	7.6	10.0	12.3	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	4.5	6.3	8.4	10.3	Assume 1/3 average day.
Total	11.0	15.0	19.5	23.7	
Difference (provided minus required)	9.4	5.4	4.8	5.2	

Table B-20. CSA Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Provided pumping capacity, mgd					
Existing					
Calvine Meadows GWTP, total	8.8	8.8	8.8	8.8	
GWTP	5.0	5.0	5.0	5.0	
from storage	3.8	3.8	3.8	3.8	
East Elk Grove GWTP, total	13.0	13.0	13.0	13.0	
GWTP	6.5	6.5	6.5	6.5	
from storage	6.5	6.5	6.5	6.5	
East Park GWTP, total	3.5	3.5	3.5	3.5	
GWTP	2.9	2.9	2.9	2.9	
from storage	0.6	0.6	0.6	0.6	
Wateman GWTP, total	25.9	25.9	25.9	25.9	
GWTP	8.6	8.6	8.6	8.6	
from storage	17.3	17.3	17.3	17.3	
Wildhawk GWTP, total	19.0	19.0	19.0	19.0	
GWTP	7.5	7.5	7.5	7.5	
from storage	11.5	11.5	11.5	11.5	
Vineyard SWTP pump station	13.0	13.0	13.0	13.0	Assume capacity provided from clear well.
subtotal from storage	52.7	52.7	52.7	52.7	
Future					
West Jackson GWTP			21.6	21.6	
GWTP			18.0	18.0	
from storage			3.6	3.6	
East Elk Grove GWTP expansion, total				13.0	
GWTP				6.5	
from storage				6.5	
Bond GWTP, total				10.8	
GWTP				6.5	
from storage				4.3	
North Vineyard Station, total				21.6	Pumps through City POU supply.
City POU supply				19.1	
from storage				2.5	
Calvine Meadows GWTP expansion				7.2	Pump all from storage.
Vineyard SWTP pump station expansion				10.0	Assume future capacity from clear well.
subtotal from storage			3.6	34.1	
Total from storage	52.7	52.7	56.3	86.8	
Required peak hour capacity from storage, mgd	27.0	37.9	50.2	61.5	
Difference (provided minus required) (a)	25.7	14.8	6.1	25.3	Pumping capacity could be reduced in Phase 3.
Summary					
Total provided pump station capacity, mgd	83.2	83.2	104.8	167.4	
Total required pump station capacity					
from storage, mgd	27.0	37.9	50.2	61.5	
for max days supply capacity, mgd	30.5	30.5	48.5	61.5	
Total	57.5	68.4	98.7	123.0	
(a) Peak hour pumping surplus used to supply the SSA.					



Table B-21. SSA Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Maximum day demand, mgd	27.1	40.3	46.6	46.6	
Peak hour demand, mgd	54.2	80.6	93.2	93.2	
Provided storage volume, MG					
Existing					
Big Hom GWTP	2.0	2.0	2.0	2.0	
Dwight Road GWTP	7.0	7.0	7.0	7.0	
Lakeside GWTP	0.5	0.5	0.5	0.5	
Poppy Ridge GWTP	3.5	3.5	3.5	3.5	
subtotal	13.0	13.0	13.0	13.0	
Future					
Poppy Ridge GWTP expansion		3.5	3.5	3.5	
Big Hom GWTP expansion					
Franklin GWTP				2.0	
Whitelock GWTP				3.0	
subtotal	0.0	3.5	3.5	8.5	
Total	13.0	16.5	16.5	21.5	Planned storage volume.
Required storage volume, MG					
Equalization	5.4	8.1	9.3	9.3	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	4.5	6.7	7.8	7.8	Assume 1/3 average day.
Total	11.0	15.9	18.2	18.2	
Difference (provided minus required)	2.0	0.6	-1.7	3.3	Phase 2 deficit supplied by CSA storage surplus.

Table B-22. SSA Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2050)	Notes
Provided pumping capacity, mgd					
Existing					
Big Hom GWTP, total	8.6	8.6	8.6	8.6	
GWTP	4.5	4.5	4.5	4.5	
from storage	4.1	4.1	4.1	4.1	
Dwight Road GWTP, total	25.9	25.9	25.9	25.9	
GWTP and Franklin Intertie	13.2	13.2	13.2	13.2	
from storage	12.7	12.7	12.7	12.7	
Lakeside GWTP, total	7.2	7.2	7.2	7.2	
GWTP	6.5	6.5	6.5	6.5	
from storage	0.7	0.7	0.7	0.7	
Poppy Ridge GWTP, total	10.4	10.4	10.4	10.4	
GWTP	6.5	6.5	6.5	6.5	
from storage	3.9	3.9	3.9	3.9	
subtotal from storage	21.4	21.4	21.4	21.4	
Future					
Poppy Ridge GWTP expansion, total		17.0	17.0	17.0	
GWTP		6.5	6.5	6.5	
from storage		10.5	10.5	10.5	
Big Hom GWTP expansion, total			17.0	17.0	
GWTP			8.5	8.5	
from storage			8.5	8.5	
Franklin GWTP, total				21.6	
GWTP				7.0	
from storage				14.6	
Whitelock GWTP, total				14.4	
GWTP				13.0	
from storage				1.4	
subtotal from storage	0.0	10.5	19.0	35.0	
Total from storage	21.4	31.9	40.4	56.4	
Required peak hour capacity from storage, mgd	27.1	40.3	46.6	46.6	
Difference (provided minus required) (a)	-5.7	-8.4	-6.2	9.8	Phase 1 and 2 deficit supplied by CSA.
Summary					
Total provided pump station capacity, mgd	52.1	69.1	86.1	122.1	
Total required pump station capacity					
from storage, mgd	27.1	40.3	46.6	46.6	
for max day supply capacity, mgd	30.7	37.2	45.7	65.7	
Total	57.8	77.5	92.3	112.3	
(a) Peak hour pumping deficit to be supplied by surplus in CSA.					

Table B-23. Zone 40 Storage Capacity Evaluation Summary					
	2013	Phase 1 (2015-2025)	Phase 2 (2026-2035)	Phase 3 (2036-2051)	
Provided storage volume, MG					
Existing	42.2	42.2	42.2	42.2	
Future	0.0	13.5	17.5	36.0	
Total	42.2	55.7	59.7	78.2	
Required storage volume, MG					
Equalization	12.3	19.0	25.2	31.7	
Fire	3.8	3.8	3.8	3.8	
Emergency	10.3	15.8	21.0	26.4	
Total	26.4	38.6	50.1	61.8	
Difference (provided minus required)	15.8	17.1	9.6	16.3	

Table B-24. Zone 40 Pump Station Capacity Evaluation Summary					
	2013	Phase 1 (2015-2025)	Phase 2 (2026-2035)	Phase 3 (2036-2050)	
Provided pump station capacity from storage, mgd					
Existing	107.6	118.2	112.3	103.4	
Future	0.0	20.5	32.6	88.1	
Total	107.6	138.7	144.9	191.5	
Required pump station capacity from storage, mgd					
	65.8	96.6	126.2	158.3	
Difference (provided minus required)	41.8	42.1	18.7	33.2	

Appendix C: NewBridge Supply and Demand Comparison Tables

Table C-1. Maximum Day Demand to Supply Comparison for NSA, mgd

NSA	2013	Phase 1				Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Demand											
Maximum day	7.4	9.5	13.2	18.3	23.7	31.7	40.5	49.8	58.3	58.3	
Existing supply capacity											
Mather Housing GWTP	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Anatolia GWTP	6.5	6.5									
total groundwater	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Vineyard SWTP											
Total	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Planned future supply capacity											
surface water, Vineyard SWTP			16.0	32.5	32.5	32.5	32.5	32.5	65.0	65.0	
Total supply capacity											
groundwater	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
surface water	0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	65.0	65.0	
Total	12.5	12.5	22.0	38.5	38.5	38.5	38.5	38.5	71.0	71.0	
Use of supply: average/wet years											
groundwater	7.4	9.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
surface water	0.0	0.0	13.2	18.3	23.7	31.7	40.5	49.8	58.3	58.3	
Total	7.4	9.5	13.2	18.3	23.7	31.7	40.5	49.8	58.3	58.3	
Use of supply: dry years											
groundwater	7.4	9.5	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	
surface water	0.0	0.0	11.2	16.3	21.7	29.7	38.5	47.8	56.3	56.3	
Total	7.4	9.5	13.2	18.3	23.7	31.7	40.5	49.8	58.3	58.3	

Table C-2. Maximum Day Demand to Supply Comparison for CSA, mgd

CSA	2013	Phase 1				Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Demand											
Maximum day	27.0	29.2	32.8	37.7	42.6	49.7	57.2	61.5	61.5	61.5	
Existing supply capacity											
Calvine Meadows GWTP	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
East Elk Grove GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	
East Park GWTP	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	
Waterman GWTP	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	
Wildhawk GWTP	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	
CSA DirectFeed	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	
total groundwater	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	
Vineyard SWTP	50.0	50.0	34.0	17.5	17.5	17.5	17.5	17.5	17.5	17.5	
Total	84.4	84.4	68.4	51.9	51.9	51.9	51.9	51.9	51.9	51.9	
Planned future supply capacity											
West Jackson GWTP					9.0	18.0	18.0	18.0	18.0	18.0	
Bond GWTP									6.5	6.5	
East Elk Grove GWTP expansion									6.5	6.5	
total groundwater					9.0	18.0	18.0	18.0	31.0	31.0	
Vineyard SWTP expansion									17.5	17.5	
City POU supply										19.1	
total surface water									17.5	36.6	
Total supply capacity											
groundwater	34.4	34.4	34.4	34.4	43.4	52.4	52.4	52.4	65.4	65.4	
surface water	50.0	50.0	34.0	17.5	17.5	17.5	17.5	17.5	35.0	54.1	
Total	84.4	84.4	68.4	51.9	60.9	69.9	69.9	69.9	100.4	119.5	
Use of supply: average/wet years											
groundwater	0.0	0.0	0.0	20.2	25.1	32.2	39.7	44.0	26.5	7.4	
surface water	27.0	29.2	32.8	17.5	17.5	17.5	17.5	17.5	35.0	54.1	
Total	27.0	29.2	32.8	37.7	42.6	49.7	57.2	61.5	61.5	61.5	
Use of supply: dry years											
groundwater	27.0	29.2	32.8	34.4	42.6	49.7	57.2	61.5	61.5	61.5	
surface water	0.0	0.0	0.0	3.3	0.0	0.0	0.0	0.0	0.0	0.0	
Total	27.0	29.2	32.8	37.7	42.6	49.7	57.2	61.5	61.5	61.5	



Table C-3. Maximum Day Demand to Supply Comparison for SSA, mgd

SSA	2013	Phase 1				Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Demand											
Maximum day	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6	46.6
Existing supply capacity											
Big Horn GWTP	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5
Dwight Road GWTP	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
Lakeside GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
Poppy Ridge GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
SSA Direct Feed	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0
total groundwater	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6
Franklin Intertie to City	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
SSA Recycled Water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
Total	65.3										
Planned future supply capacity											
Poppy Ridge GWTP expansion				6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
Big Horn GWTP expansion						8.5	8.5	8.5	8.5	8.5	8.5
Franklin GWTP										7.0	7.0
Whitelock GWTP											13.0
total groundwater			0.0	6.5	6.5	15.0	15.0	15.0	15.0	22.0	35.0
recycled water										2.9	2.9
Total supply capacity											
groundwater	25.6	25.6	25.6	32.1	32.1	40.6	40.6	40.6	40.6	47.6	60.6
surface water	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	39.7	39.7	39.7	46.2	46.2	54.7	54.7	54.7	54.7	64.6	64.6
Use of supply: average/wet years											
groundwater	13.0	16.4	21.1	26.2	31.6	32.5	32.5	32.5	32.5	29.7	29.7
surface water	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6	46.6
Use of supply: dry years											
groundwater	24.1	25.6	25.6	32.1	32.1	40.6	40.6	40.6	40.6	40.8	40.8
surface water	0.0	1.9	6.6	5.2	10.6	3.0	3.0	3.0	3.0	0.0	0.0
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
Total	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6	46.6

Table C-4. Maximum Day Demand to Supply Comparison for Zone 40, mgd

Zone 40	2013	Phase 1				Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Maximum day demand											
Zone 40 total	61.5	69.1	81.2	96.2	112.1	128.0	144.3	157.9	166.4	166.4	
Existing supply capacity											
groundwater	72.5	72.5	66.0	66.0	66.0	66.0	66.0	66.0	66.0	66.0	
surface water	61.1	61.1	45.1	28.6	28.6	28.6	28.6	28.6	28.6	28.6	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	
Total	136.6	136.6	114.1	97.6	97.6	97.6	97.6	97.6	97.6	97.6	
Planned future supply capacity											
groundwater	0.0	0.0	0.0	6.5	15.5	33.0	33.0	33.0	53.0	66.0	
surface water	0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	82.5	101.6	
recycled water									2.9	2.9	
Total supply capacity											
groundwater	72.5	72.5	66.0	72.5	81.5	99.0	99.0	99.0	119.0	132.0	
surface water	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	111.1	130.2	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9	
Total	136.6	136.6	130.1	136.6	145.6	163.1	163.1	163.1	236.0	268.1	
Use of supply: average/wet years											
groundwater	20.4	25.8	21.1	46.4	56.8	64.7	72.2	76.5	56.1	37.0	
surface water	38.1	40.3	57.1	46.9	52.3	60.3	69.1	78.4	104.4	123.5	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9	
Total	61.5	69.1	81.2	96.2	112.1	128.0	144.3	157.9	166.4	166.4	
Use of supply: dry years											
groundwater	58.5	64.3	60.4	68.5	76.7	92.3	99.8	104.1	104.3	104.3	
surface water	0.0	1.9	17.8	24.7	32.3	32.7	41.5	50.9	56.3	56.3	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9	
Total	61.5	69.1	81.2	96.2	112.1	128.0	144.3	157.9	166.4	166.4	

Table C-5. Conjunctive Use Metrics

Parameter	2013	Phase 1			Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052
Provided Capacity										
surface water, % of demand	99.3%	88.4%	75.3%	63.5%	54.5%	47.7%	42.3%	38.7%	66.8%	78.2%
groundwater, % of demand	117.8%	104.9%	81.3%	75.3%	72.7%	77.3%	68.6%	62.7%	71.5%	79.3%
Total	217.2%	193.3%	156.6%	138.8%	127.2%	125.0%	110.9%	101.4%	138.3%	157.6%
Use in wet/average years										
surface water, % of demand	62.0%	58.3%	70.3%	48.7%	46.7%	47.1%	47.9%	49.7%	62.8%	74.2%
groundwater, % of demand	33.1%	37.4%	26.0%	48.2%	50.6%	50.6%	50.0%	48.4%	33.7%	22.2%
surface water, % of surface water capacity	62.4%	65.9%	93.4%	76.7%	85.6%	98.7%	113.1%	128.4%	94.0%	94.9%
groundwater, % of groundwater capacity	28.1%	35.6%	32.0%	64.0%	69.7%	65.4%	73.0%	77.2%	47.2%	28.0%
Use in dry years										
surface water, % of demand	0.0%	2.7%	21.9%	25.7%	28.9%	25.6%	28.8%	32.2%	33.8%	33.8%
groundwater, % of demand	95.1%	93.0%	74.4%	71.2%	68.5%	72.1%	69.2%	65.9%	62.7%	62.7%
surface water, % of wet/average year use	0.0%	4.6%	31.1%	52.8%	61.8%	54.3%	60.1%	64.8%	53.9%	45.6%
groundwater, % of groundwater capacity	80.7%	88.6%	91.5%	94.5%	94.2%	93.3%	100.8%	105.1%	87.6%	79.0%

Note: Recycled water values not presented.



Table C-6. Annual Supply Capacity and Use - NSA

NSA		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
Demand	Annual, ac-ft/yr	4,200	5,300	7,400	10,200	13,300	17,800	22,700	27,900	32,700	32,700
Supply capacity, ac-ft/yr											
	groundwater	7,000	7,000	3,400	3,400	3,400	3,400	3,400	3,400	3,400	3,400
	surface water	-	-	9,000	18,200	18,200	18,200	18,200	18,200	36,400	36,400
	Total	7,000	7,000	12,300	21,600	21,600	21,600	21,600	21,600	39,800	39,800
Use of supply: average/wet years											
	groundwater	4,100	5,300	-	-	-	-	-	-	-	-
	surface water	-	-	7,400	10,200	13,300	17,800	22,700	27,900	32,700	32,700
	Total	4,100	5,300	7,400	10,200	13,300	17,800	22,700	27,900	32,700	32,700
Use of supply: dry years											
	groundwater	4,100	5,300	1,100	1,100	1,100	1,100	1,100	1,100	1,100	1,100
	surface water	-	-	6,200	9,100	12,200	16,600	21,600	26,800	31,500	31,500
	Total	4,100	5,300	7,400	10,200	13,300	17,800	22,700	27,900	32,700	32,700

Table C-7. Annual Supply Capacity and Use - CSA

CSA		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
Demand	Annual, ac-ft/yr	15,100	16,300	18,400	21,100	23,900	27,800	32,100	34,400	34,400	34,400
Supply capacity, ac-ft/yr											
	groundwater	19,300	19,300	19,300	19,300	24,300	29,300	29,300	29,300	36,600	36,600
	surface water	28,000	28,000	19,000	9,800	9,800	9,800	9,800	9,800	19,600	30,300
	Total	47,300	47,300	38,300	29,100	34,100	39,100	39,100	39,100	56,200	66,900
Use of supply: average/wet years											
	groundwater	-	-	-	11,300	14,100	18,000	22,200	24,600	14,800	4,100
	surface water	15,100	16,300	18,400	9,800	9,800	9,800	9,800	9,800	19,600	30,300
	Total	15,100	16,300	18,400	21,100	23,900	27,800	32,000	34,400	34,400	34,400
Use of supply: dry years											
	groundwater	15,100	16,300	18,400	19,300	23,900	27,800	32,000	34,400	34,400	34,400
	surface water	-	-	-	1,800	-	-	-	-	-	-
	Total	15,100	16,300	18,400	21,100	23,900	27,800	32,000	34,400	34,400	34,400

Table C-8. Annual Supply Capacity and Use - SSA

SSA		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
Demand	Annual, ac-ft/yr	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100
Supply capacity, ac-ft/yr											
	groundwater	14,300	14,300	14,300	18,000	18,000	22,700	22,700	22,700	26,700	33,900
	surface water	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	22,200	22,200	22,200	25,900	25,900	30,600	30,600	30,600	36,200	43,400
Use of supply: average/wet years											
	groundwater	7,300	9,200	11,800	14,700	17,700	18,200	18,200	18,200	16,600	16,600
	surface water	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100
Use of supply: dry years											
	groundwater	13,500	14,300	14,300	18,000	18,000	22,700	22,700	22,700	22,800	22,800
	surface water	-	1,000	3,700	2,900	6,000	1,700	1,700	1,700	-	-
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100

Table C-9. Annual Supply Capacity and Use - Total

Total Zone 40		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
Demand	Annual, ac-ft/yr	34,500	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
Supply capacity, ac-ft/yr											
	groundwater	40,600	40,600	37,000	40,600	45,600	55,400	55,400	55,400	66,600	73,900
	surface water	34,200	34,200	34,200	34,200	34,200	34,200	34,200	34,200	62,200	72,900
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	76,500	76,500	72,900	76,500	81,600	91,400	91,400	91,400	132,200	150,100
Use of supply: average/wet years											
	groundwater	11,400	14,500	11,800	26,000	31,800	36,300	40,500	42,800	31,400	20,700
	surface water	21,400	22,600	32,000	26,200	29,300	33,800	38,700	43,900	58,500	69,200
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	34,500	38,700	45,500	53,900	62,800	71,700	80,800	88,400	93,200	93,200
Use of supply: dry years											
	groundwater	32,800	36,000	33,800	38,400	43,000	51,700	55,900	58,300	58,400	58,400
	surface water	-	1,000	9,900	13,900	18,100	18,300	23,300	28,500	31,500	31,500
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	34,500	38,700	45,500	53,900	62,800	71,700	80,800	88,400	93,200	93,200

Table C-10. Supply and Demand Comparison-Normal Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
Appropriative water	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
Difference	146,800	140,000	131,600	122,700	113,800	104,600	97,100	93,900	93,900



Table C-11. Use of Supply-Normal Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Use of supplies									
Surface water	22,600	32,000	26,200	29,300	33,800	38,700	43,900	58,500	69,200
Remediated groundwater									
Groundwater	14,500	11,800	26,000	31,800	36,300	40,500	42,800	31,400	20,700
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Total	38,800	45,500	53,900	62,800	71,800	80,900	88,400	93,200	93,200
Surface water use breakdown									
US Bureau of Reclamation-CVP supply	22,600	32,000	26,200	29,300	33,800	38,700	43,900	45,000	45,000
Appropriative water	-	-	-	-	-	-	-	13,500	24,200
City of Sacramento American River POU water rights									
Other surface water supplies									
Surface water plus remediated groundwater	22,600	32,000	26,200	29,300	33,800	38,700	43,900	58,500	69,200

Table C-12. Supply and Demand Comparison-Single Dry Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply allocation	11,300	16,000	13,100	14,700	16,900	19,400	22,000	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	101,500	106,200	103,300	104,900	107,100	109,600	112,200	114,300	114,300
Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
Difference	62,800	60,700	49,400	42,100	35,400	28,700	23,800	21,100	21,100

Table C-13. Use of Supply-Single Dry Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Use of supplies									
Surface water	1,000	1,000	5,000	9,200	9,400	14,400	19,600	22,600	22,600
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Groundwater	27,100	33,800	38,400	43,000	51,700	55,900	58,300	58,400	58,400
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Total	38,700	45,400	54,000	62,800	71,700	80,900	88,500	93,200	93,200
Surface water use breakdown									
US Bureau of Reclamation-CVP supply	1,000	1,000	5,000	9,200	9,400	14,400	19,600	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	-	-	-	-	-	-	-	100	100
Surface water plus remediated groundwater	1,000	9,900	13,900	18,100	18,300	23,300	28,500	31,500	31,500

Table C-14. Supply and Demand Comparison-Multiple Dry Years

Year		2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2050)
First year	Supplies									
	US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
	Appropriative water	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
	City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
	Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
	Difference	146,800	140,000	131,600	122,700	113,800	104,600	97,100	93,900	93,900
Second year	Supplies									
	US Bureau of Reclamation-CVP supply	17,000	24,000	19,700	22,000	25,400	29,000	32,900	33,800	33,800
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	107,200	114,200	109,900	112,200	115,600	119,200	123,100	125,600	125,600
	Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
	Difference	68,500	68,700	56,000	49,400	43,900	38,300	34,700	32,400	32,400
Third year	Supplies									
	US Bureau of Reclamation-CVP supply	11,300	16,000	13,100	14,700	16,900	19,400	22,000	22,500	22,500
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	101,500	106,200	103,300	104,900	107,100	109,600	112,200	114,300	114,300
	Demand	38,700	45,500	53,900	62,800	71,700	80,900	88,400	93,200	93,200
	Difference	62,800	60,700	49,400	42,100	35,400	28,700	23,800	21,100	21,100



Table C-15. NSA Upper Zone Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Maximum day demand, mgd	0.0	2.5	5.0	7.9	Cordova Hills (4,451 ac-ft/yr)
Peak hour demand, mgd	0.0	5.0	10.0	15.8	
Provided storage volume, MG					
Existing					
North Douglas	3.0	3.0	3.0	3.0	
Future					
Cordova Hills				3.0	
Total	3.0	3.0	3.0	6.0	
Required storage volume, MG					
Equalization	0.0	0.5	1.0	1.6	Assume 20% MDD.
Fire	0.5	0.5	0.5	0.5	Assume volume for one fire at 3,000 gpm for 3 hours.
Emergency	0.0	0.4	0.8	1.3	Assume 1/3 average day.
Total	0.5	1.4	2.3	3.4	
Difference (provided minus required)	2.5	1.6	0.7	2.6	Could downsize Cordova Hills tank.

Table C-16. NSA Upper Zone Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Provided pumping capacity, mgd					
Existing					
North Douglas	19.4	19.4	19.4	19.4	Very large capacity for such a small demand.
Upper zone max day supply from storage	0.0	2.5	5.0	7.9	
from storage	19.4	16.9	14.4	11.5	
Future					
Cordova Hills				21.6	
Total from storage	19.4	16.9	14.4	33.1	
Required peak hour capacity from storage, mgd	0.0	2.5	5.0	7.9	Capacity increment above maximum day demand capacity.
Required fire flow from storage, mgd	4.3	4.3	4.3	4.3	4.3 mgd for one fire, max day supply accounted for above.
Required capacity from storage	4.3	4.3	5.0	7.9	Greater of pk hr or fire.
Difference (provided minus required)	15.1	12.6	9.4	25.2	Substantial surplus capacity.
Summary					
Total provided pump station capacity, mgd	38.8	36.3	33.8	52.5	
Total required pump station capacity					
from storage, mgd	4.3	4.3	5.0	7.9	
for max day supply capacity, mgd	0.0	2.5	5.0	7.9	
Total	4.3	6.8	10.0	15.8	

Table C-17. NSA Main Zone Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Maximum day demand, mgd	7.4	14.1	24.4	44.5	NSA 58.3 mgd minus Cordova Hills (7.9 mgd) and half of Rio del Oro (5.9 mgd).
Peak hour demand, mgd	14.8	28.2	48.8	89.0	
Provided storage volume, MG					
Existing					
Mather Housing GWTP	0.5	0.5	0.5	0.5	
Anatolia GWTP	4.0	4.0	4.0	4.0	
Mather 1 Main Base	1.0	1.0	1.0	1.0	
Mather 2	0.3	0.3	0.3	0.3	
subtotal	5.8	5.8	5.8	5.8	
Future					
Phase B NSA Project		10.0	10.0	10.0	
White Rock				3.0	
Suncreek				3.0	
subtotal	0.0	10.0	10.0	16.0	
Total	5.8	15.8	15.8	21.8	
Required storage volume, MG					
Equalization	1.5	2.8	4.9	8.9	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	1.2	2.4	4.1	7.4	Assume 1/3 average day.
Total	3.8	6.3	10.0	17.4	Could phase in the Phase B NSA Project storage.
Difference (provided minus required)	2.0	9.5	5.8	4.4	

Table C-18. NSA Main Zone Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Provided pumping capacity, mgd					
Existing					
Mather Housing GWTP	5.2	5.2	5.2	5.2	
GWTP	3.0	3.0	3.0	3.0	Assume half of GWTP supplies pump station.
from storage	2.2	2.2	2.2	2.2	
Anatolia GWTP/Storage (a)	11.2	22.5	22.5	22.5	
GWTP/part of MD supply from Vineyard SWTP	6.5	4.7	8.1	14.8	Assume 2/3 of main zone MD demand through NSA terminal and 1/3 through Anatolia tanks.
from storage	4.7	17.8	14.4	7.7	
Mather 1 Main Base	5.2	5.2	5.2	5.2	
Mather 2	2.0	2.0	2.0	2.0	Elevated tank, assumed flow.
subtotal from storage	14.1	27.2	23.8	17.1	
Future					
White Rock				14.4	
Suncreek				18.0	
Phase B NSA-total capacity (b)		64.0	64.0	64.0	Total pump station capacity.
max day supply for Cal Am Rio del Oro		1.0	3.0	5.9	Max day supply for Cal Am tank. Not from storage.
max day supply for upper zone		2.5	5.0	7.9	Supply to North Douglas and Cordova Hills tanks. Not from storage.
part of max day supply from Vineyard SWTP for main zone		9.4	16.3	29.7	Assume 2/3 through NSA terminal and 1/3 through Anatolia tanks.
subtotal, pumping not from Phase B NSA storage		12.9	24.3	43.5	
subtotal, capacity available to pump from Phase B NSA Project storage		51.1	39.7	20.5	
subtotal from storage		51.1	39.7	52.9	
Total from storage	14.1	78.3	63.5	70.0	
Required peak hour capacity from storage, mgd	7.4	14.1	24.4	44.5	
Difference (provided minus required)	6.7	64.2	39.1	25.5	Could phase in the NSA terminal storage pump station capacity.
Summary					
Total provided pump station capacity, mgd	23.6	98.9	98.9	131.3	
Total required pump station capacity					
from storage, mgd	7.4	14.1	24.4	44.5	
for max day supply capacity, mgd	9.5	20.6	35.4	61.3	
Total	16.9	34.7	59.8	105.8	
(a) When Phase A NSA is completed, Anatolia will pump through supply from Vineyard SWTP.					
(b) Calculation of Phase B NSA pump station capacity available to supply from storage the main zone's pk hr increment.					



Table C-19. CSA Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Maximum day demand, mgd	27.0	37.9	50.2	61.6	
Peak hour demand, mgd	54.0	75.8	100.4	123.2	
Provided storage volume, MG					
Existing					
Calvine Meadows GWTP	0.35	0.35	0.35	0.35	
East Elk Grove GWTP	3.5	3.5	3.5	3.5	
East Park GWTP	0.5	0.5	0.5	0.5	
Waterman GWTP	7.0	7.0	7.0	7.0	
Wildhawk GWTP	3.0	3.0	3.0	3.0	
Vineyard SWTP clearwell	6.0	6.0	6.0	6.0	Assumed equalization storage available from 20 mgd clearwell.
subtotal	20.4	20.4	20.4	20.4	
Future					
West Jackson GWTP			4.0	4.0	
East Elk Grove GWTP expansion				0.0	
Bond GWTP				0.5	
North Vineyard Station				4.0	
Calvine Meadows GWTP expansion				0.0	
subtotal			4.0	8.5	
Total	20.4	20.4	24.4	28.9	Planned storage volume.
Required storage volume, MG					
Equalization	5.4	7.6	10.0	12.3	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	4.5	6.3	8.4	10.3	Assume 1/3 average day.
Total	11.0	15.0	19.5	23.7	
Difference (provided minus required)	9.4	5.4	4.8	5.2	

Table C-20. CSA Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Provided pumping capacity, mgd					
Existing					
Calvine Meadows GWTP, total	8.8	8.8	8.8	8.8	
GWTP	5.0	5.0	5.0	5.0	
from storage	3.8	3.8	3.8	3.8	
East Elk Grove GWTP, total	13.0	13.0	13.0	13.0	
GWTP	6.5	6.5	6.5	6.5	
from storage	6.5	6.5	6.5	6.5	
East Park GWTP, total	3.5	3.5	3.5	3.5	
GWTP	2.9	2.9	2.9	2.9	
from storage	0.6	0.6	0.6	0.6	
Waterman GWTP, total	25.9	25.9	25.9	25.9	
GWTP	8.6	8.6	8.6	8.6	
from storage	17.3	17.3	17.3	17.3	
Wildhawk GWTP, total	19.0	19.0	19.0	19.0	
GWTP	7.5	7.5	7.5	7.5	
from storage	11.5	11.5	11.5	11.5	
Vineyard SWTP pump station	13.0	13.0	13.0	13.0	Assume capacity provided from clear well.
subtotal from storage	52.7	52.7	52.7	52.7	
Future					
West Jackson GWTP			21.6	21.6	
GWTP			18.0	18.0	
from storage			3.6	3.6	
East Elk Grove GWTP expansion, total				13.0	
GWTP				6.5	
from storage				6.5	
Bond GWTP, total				10.8	
GWTP				6.5	
from storage				4.3	
North Vineyard Station, total				21.6	Pumps through City POU supply.
City POU supply				19.1	
from storage				2.5	
Calvine Meadows GWTP expansion				7.2	Pump all from storage.
Vineyard SWTP pump station expansion				10.0	Assume future capacity from clear well.
subtotal from storage			3.6	34.1	
Total from storage	52.7	52.7	56.3	86.8	
Required peak hour capacity from storage, mgd	27.0	37.9	50.2	61.6	
Difference (provided minus required) (a)	25.7	14.8	6.1	25.2	Pumping capacity could be reduced in Phase 3.
Summary					
Total provided pump station capacity, mgd	83.2	83.2	104.8	167.4	
Total required pump station capacity					
from storage, mgd	27.0	37.9	50.2	61.6	
for max day supply capacity, mgd	30.5	30.5	48.5	61.5	
Total	57.5	68.4	98.7	123.1	
(a) Peak hour pumping surplus used to supply the SSA.					



Table C-21. SSA Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Maximum day demand, mgd	27.1	40.3	46.6	46.6	
Peak hour demand, mgd	54.2	80.6	93.2	93.2	
Provided storage volume, MG					
Existing					
Big Horn GWTP	2.0	2.0	2.0	2.0	
Dwight Road GWTP	7.0	7.0	7.0	7.0	
Lakeside GWTP	0.5	0.5	0.5	0.5	
Poppy Ridge GWTP	3.5	3.5	3.5	3.5	
subtotal	13.0	13.0	13.0	13.0	
Future					
Poppy Ridge GWTP expansion		3.5	3.5	3.5	
Big Horn GWTP expansion					
Franklin GWTP				2.0	
Whitelock GWTP				3.0	
subtotal	0.0	3.5	3.5	8.5	
Total	13.0	16.5	16.5	21.5	Planned storage volume.
Required storage volume, MG					
Equalization	5.4	8.1	9.3	9.3	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	4.5	6.7	7.8	7.8	Assume 1/3 average day.
Total	11.0	15.9	18.2	18.2	
Difference (provided minus required)	2.0	0.6	-1.7	3.3	Phase 2 deficit supplied by CSA storage surplus.

Table C-22. SSA Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2050)	Notes
Provided pumping capacity, mgd					
Existing					
Big Horn GWTP, total	8.6	8.6	8.6	8.6	
GWTP	4.5	4.5	4.5	4.5	
from storage	4.1	4.1	4.1	4.1	
Dwight Road GWTP, total	25.9	25.9	25.9	25.9	
GWTP and Franklin Intertie	13.2	13.2	13.2	13.2	
from storage	12.7	12.7	12.7	12.7	
Lakeside GWTP, total	7.2	7.2	7.2	7.2	
GWTP	6.5	6.5	6.5	6.5	
from storage	0.7	0.7	0.7	0.7	
Poppy Ridge GWTP, total	10.4	10.4	10.4	10.4	
GWTP	6.5	6.5	6.5	6.5	
from storage	3.9	3.9	3.9	3.9	
subtotal from storage	21.4	21.4	21.4	21.4	
Future					
Poppy Ridge GWTP expansion, total		17.0	17.0	17.0	
GWTP		6.5	6.5	6.5	
from storage		10.5	10.5	10.5	
Big Horn GWTP expansion, total			17.0	17.0	
GWTP			8.5	8.5	
from storage			8.5	8.5	
Franklin GWTP, total				21.6	
GWTP				7.0	
from storage				14.6	
Whitelock GWTP, total				14.4	
GWTP				13.0	
from storage				1.4	
subtotal from storage	0.0	10.5	19.0	35.0	
Total from storage	21.4	31.9	40.4	56.4	
Required peak hour capacity from storage, mgd	27.1	40.3	46.6	46.6	
Difference (provided minus required) (a)	-5.7	-8.4	-6.2	9.8	Phase 1 and 2 deficit supplied by CSA.
Summary					
Total provided pump station capacity, mgd	52.1	69.1	86.1	122.1	
Total required pump station capacity					
from storage, mgd	27.1	40.3	46.6	46.6	
for max day supply capacity, mgd	30.7	37.2	45.7	65.7	
Total	57.8	77.5	92.3	112.3	
(a) Peak hour pumping deficit to be supplied by surplus in CSA.					

Table C-23. Zone 40 Storage Capacity Evaluation Summary					
	2013	Phase 1 (2015-2025)	Phase 2 (2026-2035)	Phase 3 (2036-2051)	
Provided storage volume, MG					
Existing	42.2	42.2	42.2	42.2	
Future	0.0	13.5	17.5	36.0	
Total	42.2	55.7	59.7	78.2	
Required storage volume, MG					
Equalization	12.3	19.0	25.2	32.1	
Fire	3.8	3.8	3.8	3.8	
Emergency	10.3	15.8	21.0	26.8	
Total	26.4	38.6	50.1	62.7	
Difference (provided minus required)	15.8	17.1	9.6	15.5	

Table C-24. Zone 40 Pump Station Capacity Evaluation Summary					
	2013	Phase 1 (2015-2025)	Phase 2 (2026-2035)	Phase 3 (2036-2050)	
Provided pump station capacity from storage, mgd					
Existing	107.6	118.2	112.3	102.7	
Future	0.0	20.5	32.6	88.1	
Total	107.6	138.7	144.9	190.8	
Required pump station capacity from storage, mgd					
	65.8	96.6	126.2	160.6	
Difference (provided minus required)	41.8	42.1	18.7	30.2	

Appendix D: Cumulative Supply and Demand Comparison Tables

Table D-1. Maximum Day Demand to Supply Comparison for NSA, mgd

NSA	2013	Phase 1			Phase 2		Phase 3				
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Demand											
Maximum day	7.4	9.5	13.1	18.1	23.5	31.3	39.9	49.0	58.6	62.4	
Existing supply capacity											
Mather Housing GWTP	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Anatolia GWTP	6.5	6.5									
total groundwater	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Vineyard SWTP											
Total	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
Planned future supply capacity											
surface water, Vineyard SWTP			16.0	32.5	32.5	32.5	32.5	32.5	65.0	65.0	
Total supply capacity											
groundwater	12.5	12.5	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
surface water	0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	65.0	65.0	
Total	12.5	12.5	22.0	38.5	38.5	38.5	38.5	38.5	71.0	71.0	
Use of supply: average/wet years											
groundwater	7.4	9.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
surface water	0.0	0.0	13.1	18.1	23.5	31.3	39.9	49.0	58.6	62.4	
Total	7.4	9.5	13.1	18.1	23.5	31.3	39.9	49.0	58.6	62.4	
Use of supply: dry years											
groundwater	7.4	9.5	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	
surface water	0.0	0.0	11.1	16.1	21.5	29.3	37.9	47.0	56.6	60.4	
Total	7.4	9.5	13.1	18.1	23.5	31.3	39.9	49.0	58.6	62.4	

Table D-2. Maximum Day Demand to Supply Comparison for CSA, mgd

CSA	2013	Phase 1			Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052
Demand										
Maximum day	27.0	29.2	32.9	37.9	43.0	50.2	57.9	65.7	73.8	74.0
Existing supply capacity										
Calvine Meadows GWTP	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
East Elk Grove GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
East Park GWTP	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
Waterman GWTP	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6
Wildhawk GWTP	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5
CSA DirectFeed	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9
total groundwater	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4
Vineyard SWTP	50.0	50.0	34.0	17.5	17.5	17.5	17.5	17.5	17.5	17.5
Total	84.4	84.4	68.4	51.9	51.9	51.9	51.9	51.9	51.9	51.9
Planned future supply capacity										
West Jackson GWTP					9.0	18.0	18.0	18.0	18.0	18.0
Bond GWTP									6.5	6.5
East Elk Grove GWTP expansion									6.5	6.5
total groundwater					9.0	18.0	18.0	18.0	31.0	31.0
Vineyard SWTP expansion									17.5	17.5
City POU supply										19.1
total surface water									17.5	36.6
Total supply capacity										
groundwater	34.4	34.4	34.4	34.4	43.4	52.4	52.4	52.4	65.4	65.4
surface water	50.0	50.0	34.0	17.5	17.5	17.5	17.5	17.5	35.0	54.1
Total	84.4	84.4	68.4	51.9	60.9	69.9	69.9	69.9	100.4	119.5
Use of supply: average/wet years										
groundwater	0.0	0.0	0.0	20.4	25.5	32.7	40.4	48.2	38.8	19.9
surface water	27.0	29.2	32.9	17.5	17.5	17.5	17.5	17.5	35.0	54.1
Total	27.0	29.2	32.9	37.9	43.0	50.2	57.9	65.7	73.8	74.0
Use of supply: dry years										
groundwater	27.0	29.2	32.9	34.4	43.0	50.2	57.9	65.7	65.4	65.4
surface water	0.0	0.0	0.0	3.5	0.0	0.0	0.0	0.0	8.4	8.6
Total	27.0	29.2	32.9	37.9	43.0	50.2	57.9	65.7	73.8	74.0



Table D-3. Maximum Day Demand to Supply Comparison for SSA, mgd

SSA		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	2052
Demand	Maximum day	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6
Existing supply capacity	Big Horn GWTP	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5
	Dwight Road GWTP	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
	Lakeside GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
	Poppy Ridge GWTP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
	SSA Direct Feed	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0
	total groundwater	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6	25.6
	Franklin Intertie to City	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
	SSA Recycled Water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
	Total	65.3	65.3	65.3	65.3	65.3	65.3	65.3	65.3	65.3	65.3
Planned future supply capacity	Poppy Ridge GWTP expansion				6.5	6.5	6.5	6.5	6.5	6.5	6.5
	Big Horn GWTP expansion						8.5	8.5	8.5	8.5	8.5
	Franklin GWTP									7.0	7.0
	Whitelock GWTP										13.0
	total groundwater			0.0	6.5	6.5	15.0	15.0	15.0	22.0	35.0
	recycled water									2.9	2.9
Total supply capacity	groundwater	25.6	25.6	25.6	32.1	32.1	40.6	40.6	40.6	47.6	60.6
	surface water	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
	recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
	Total	39.7	39.7	39.7	46.2	46.2	54.7	54.7	54.7	64.6	64.6
Use of supply: average/wet years	groundwater	13.0	16.4	21.1	26.2	31.6	32.5	32.5	32.5	29.7	29.7
	surface water	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
	recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
	Total	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6
Use of supply: dry years	groundwater	24.1	25.6	25.6	32.1	32.1	40.6	40.6	40.6	40.8	40.8
	surface water	0.0	1.9	6.6	5.2	10.6	3.0	3.0	3.0	0.0	0.0
	recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9
	Total	27.1	30.5	35.2	40.3	45.7	46.6	46.6	46.6	46.6	46.6

Table D-4. Maximum Day Demand to Supply Comparison for Zone 40, mgd

Zone 40	2013	Phase 1				Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052	
Maximum day demand											
Zone 40 total	61.5	69.2	81.2	96.3	112.2	128.1	144.4	161.4	179.0	183.0	
Existing supply capacity											
groundwater	72.5	72.5	66.0	66.0	66.0	66.0	66.0	66.0	66.0	66.0	
surface water	61.1	61.1	45.1	28.6	28.6	28.6	28.6	28.6	28.6	28.6	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	
Total	136.6	136.6	114.1	97.6	97.6	97.6	97.6	97.6	97.6	97.6	
Planned future supply capacity											
groundwater	0.0	0.0	0.0	6.5	15.5	33.0	33.0	33.0	53.0	66.0	
surface water	0.0	0.0	16.0	32.5	32.5	32.5	32.5	32.5	82.5	101.6	
recycled water									2.9	2.9	
Total supply capacity											
groundwater	72.5	72.5	66.0	72.5	81.5	99.0	99.0	99.0	119.0	132.0	
surface water	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	111.1	130.2	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9	
Total	136.6	136.6	130.1	136.6	145.6	163.1	163.1	163.1	236.0	268.1	
Use of supply: average/wet years											
groundwater	20.4	25.8	21.1	46.6	57.1	65.2	72.9	80.7	68.4	49.5	
surface water	38.1	40.3	57.1	46.7	52.1	59.9	68.5	77.6	104.7	127.6	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9	
Total	61.5	69.2	81.2	96.3	112.2	128.1	144.4	161.4	179.0	183.0	
Use of supply: dry years											
groundwater	58.5	64.3	60.5	68.5	77.1	92.8	100.5	108.3	108.2	108.2	
surface water	0.0	1.9	17.7	24.8	32.1	32.3	40.9	50.0	65.0	69.0	
recycled water	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	5.9	5.9	
Total	61.5	69.2	81.2	96.3	112.2	128.1	144.4	161.4	179.0	183.0	

Table D-5. Conjunctive Use Metrics

Parameter	2013	Phase 1			Phase 2		Phase 3			
		2015	2020	2025	2030	2035	2040	2045	2050	2052
Provided Capacity										
surface water, % of demand	99.3%	88.3%	75.2%	63.4%	54.5%	47.7%			62.1%	71.2%
groundwater, % of demand	117.8%	104.8%	81.3%	75.3%	72.7%	77.3%			66.5%	72.1%
Total	217.2%	193.1%	156.5%	138.7%	127.1%	125.0%			128.6%	143.3%
Use in wet/average years										
surface water, % of demand	62.0%	58.3%	70.3%	48.5%	46.4%	46.8%			58.5%	69.7%
groundwater, % of demand	33.1%	37.3%	26.0%	48.4%	50.9%	50.9%			38.2%	27.1%
surface water, % of surface water capacity	62.4%	66.0%	93.5%	76.4%	85.2%	98.0%			94.3%	98.0%
groundwater, % of groundwater capacity	28.1%	35.6%	32.0%	64.3%	70.1%	65.9%			57.5%	37.5%
Use in dry years										
surface water, % of demand	0.0%	2.7%	21.8%	25.8%	28.6%	25.2%			36.3%	37.7%
groundwater, % of demand	95.1%	93.0%	74.5%	71.1%	68.7%	72.4%			60.4%	59.1%
surface water, % of wet/average year use	0.0%	4.6%	31.0%	53.1%	61.6%	53.9%			62.0%	54.0%
groundwater, % of groundwater capacity	80.7%	88.7%	91.7%	94.5%	94.6%	93.7%			90.9%	81.9%

Note: Recycled water values not presented.



Table D-6. Annual Supply Capacity and Use - NSA

NSA		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
Demand	Annual, ac-ft/yr	4,200	5,300	7,300	10,100	13,100	17,500	22,400	27,500	32,800	35,000
Supply capacity, ac-ft/yr											
	groundwater	7,000	7,000	3,400	3,400	3,400	3,400	3,400	3,400	3,400	3,400
	surface water	-	-	9,000	18,200	18,200	18,200	18,200	18,200	36,400	36,400
	Total	7,000	7,000	12,300	21,600	21,600	21,600	21,600	21,600	39,800	39,800
Use of supply: average/wet years											
	groundwater	4,100	5,300	-	-	-	-	-	-	-	-
	surface water	-	-	7,300	10,100	13,100	17,500	22,300	27,400	32,800	34,900
	Total	4,100	5,300	7,300	10,100	13,100	17,500	22,300	27,400	32,800	34,900
Use of supply: dry years											
	groundwater	4,100	5,300	1,100	1,100	1,100	1,100	1,100	1,100	1,100	1,100
	surface water	-	-	6,200	9,000	12,000	16,400	21,200	26,300	31,700	33,800
	Total	4,100	5,300	7,300	10,100	13,100	17,500	22,300	27,400	32,800	34,900

Table D-7. Annual Supply Capacity and Use - CSA

CSA		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
Demand	Annual, ac-ft/yr	15,100	16,400	18,400	21,200	24,100	28,100	32,400	36,800	41,300	41,400
Supply capacity, ac-ft/yr											
	groundwater	19,300	19,300	19,300	19,300	24,300	29,300	29,300	29,300	36,600	36,600
	surface water	28,000	28,000	19,000	9,800	9,800	9,800	9,800	9,800	19,600	30,300
	Total	47,300	47,300	38,300	29,100	34,100	39,100	39,100	39,100	56,200	66,900
Use of supply: average/wet years											
	groundwater	-	-	-	11,400	14,300	18,300	22,600	27,000	21,700	11,100
	surface water	15,100	16,400	18,400	9,800	9,800	9,800	9,800	9,800	19,600	30,300
	Total	15,100	16,400	18,400	21,200	24,100	28,100	32,400	36,800	41,300	41,400
Use of supply: dry years											
	groundwater	15,100	16,400	18,400	19,300	24,100	28,100	32,400	36,800	36,600	36,600
	surface water	-	-	-	2,000	-	-	-	-	4,700	4,800
	Total	15,100	16,400	18,400	21,200	24,100	28,100	32,400	36,800	41,300	41,400

Table D-8. Annual Supply Capacity and Use - SSA

SSA		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
Demand	Annual, ac-ft/yr	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100
Supply capacity, ac-ft/yr											
	groundwater	14,300	14,300	14,300	18,000	18,000	22,700	22,700	22,700	26,700	33,900
	surface water	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	22,200	22,200	22,200	25,900	25,900	30,600	30,600	30,600	36,200	43,400
Use of supply: average/wet years											
	groundwater	7,300	9,200	11,800	14,700	17,700	18,200	18,200	18,200	16,600	16,600
	surface water	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200	6,200
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100
Use of supply: dry years											
	groundwater	13,500	14,300	14,300	18,000	18,000	22,700	22,700	22,700	22,800	22,800
	surface water	-	1,000	3,700	2,900	6,000	1,700	1,700	1,700	-	-
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	15,200	17,100	19,700	22,600	25,600	26,100	26,100	26,100	26,100	26,100



Table D-9. Annual Supply Capacity and Use - Total

Total Zone 40		2013	Phase 1			Phase 2		Phase 3			
			2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
Demand	Annual, ac-ft/yr	34,500	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
Supply capacity, ac-ft/yr											
	groundwater	40,600	40,600	37,000	40,600	45,600	55,400	55,400	55,400	66,600	73,900
	surface water	34,200	34,200	34,200	34,200	34,200	34,200	34,200	34,200	62,200	72,900
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	76,500	76,500	72,900	76,500	81,600	91,400	91,400	91,400	132,200	150,100
Use of supply: average/wet years											
	groundwater	11,400	14,500	11,800	26,100	32,000	36,500	40,800	45,200	38,300	27,700
	surface water	21,400	22,600	32,000	26,200	29,200	33,500	38,400	43,500	58,600	71,500
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	34,500	38,700	45,500	53,900	62,800	71,700	80,900	90,400	100,200	102,500
Use of supply: dry years											
	groundwater	32,800	36,000	33,900	38,400	43,200	52,000	56,300	60,700	60,600	60,600
	surface water	-	1,000	9,900	13,900	18,000	18,100	22,900	28,000	36,400	38,600
	recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Total	34,500	38,700	45,500	53,900	62,800	71,700	80,900	90,400	100,200	102,500

Table D-10. Supply and Demand Comparison-Normal Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
Appropriative water	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
Difference	146,800	140,000	131,600	122,700	113,700	104,600	95,100	86,800	84,600

Table D-11. Use of Supply-Normal Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Use of supplies									
Surface water	22,600	32,000	26,200	29,200	33,500	38,400	43,500	58,600	71,500
Remediated groundwater									
Groundwater	14,500	11,800	26,100	32,000	36,500	40,800	45,200	38,300	27,700
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Total	38,800	45,500	54,000	62,900	71,700	80,900	90,400	100,200	102,500
Surface water use breakdown									
US Bureau of Reclamation-CVP supply	22,600	32,000	26,200	29,200	33,500	38,400	43,500	45,000	45,000
Appropriative water	-	-	-	-	-	-	-	13,600	26,500
City of Sacramento American River POU water rights									
Other surface water supplies									
Surface water plus remediated groundwater	22,600	32,000	26,200	29,200	33,500	38,400	43,500	58,600	71,500

Table D-12. Supply and Demand Comparison-Single Dry Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Supplies, no facility constraints									
US Bureau of Reclamation-CVP supply allocation	11,300	16,000	13,100	14,600	16,800	19,200	21,800	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Supply total	101,500	106,200	103,300	104,800	107,000	109,400	112,000	114,300	114,300
Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
Difference	62,800	60,700	49,400	42,000	35,200	28,500	21,600	14,000	11,800

Table D-13. Use of Supply-Single Dry Year, ac-ft/yr

	2015	2020	2025	2030	2035	2040	2045	2050	2052
Use of supplies									
Surface water	1,000	1,000	5,000	9,100	9,200	14,000	19,100	27,500	29,700
Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
Groundwater	27,100	33,900	38,400	43,200	52,000	56,300	60,700	60,600	60,600
Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
Total	38,700	45,500	54,000	62,900	71,800	80,900	90,400	100,300	102,500
Surface water use breakdown									
US Bureau of Reclamation-CVP supply	1,000	1,000	5,000	9,100	9,200	14,000	19,100	22,500	22,500
Appropriative water									
City of Sacramento American River POU water rights									
Other surface water supplies	-	-	-	-	-	-	-	5,000	7,200
Surface water plus remediated groundwater	1,000	9,900	13,900	18,000	18,100	22,900	28,000	36,400	38,600

Table D-14. Supply and Demand Comparison-Multiple Dry Years

Year		2015	2020	2025	2030	2035	2040	2045	2050	Buildout (2052)
First year	Supplies									
	US Bureau of Reclamation-CVP supply	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000	45,000
	Appropriative water	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000	71,000
	City of Sacramento American River POU water rights	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300	9,300
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000	40,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	185,500	185,500	185,500	185,500	185,500	185,500	185,500	187,100	187,100
	Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
	Difference	146,800	140,000	131,600	122,700	113,700	104,600	95,100	86,800	84,600
Second year	Supplies									
	US Bureau of Reclamation-CVP supply	17,000	24,000	19,700	21,900	25,100	28,800	32,600	33,800	33,800
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	107,200	114,200	109,900	112,100	115,300	119,000	122,800	125,600	125,600
	Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
	Difference	68,500	68,700	56,000	49,300	43,500	38,100	32,400	25,300	23,100
Third year	Supplies									
	US Bureau of Reclamation-CVP supply	11,300	16,000	13,100	14,600	16,800	19,200	21,800	22,500	22,500
	Appropriative water	-	-	-	-	-	-	-	-	-
	City of Sacramento American River POU water rights	-	-	-	-	-	-	-	-	-
	Other surface water supplies	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600	9,600
	Groundwater	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000	70,000
	Remediated groundwater	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900	8,900
	Recycled water	1,700	1,700	1,700	1,700	1,700	1,700	1,700	3,300	3,300
	Supply totals	101,500	106,200	103,300	104,800	107,000	109,400	112,000	114,300	114,300
	Demand	38,700	45,500	53,900	62,800	71,800	80,900	90,400	100,300	102,500
	Difference	62,800	60,700	49,400	42,000	35,200	28,500	21,600	14,000	11,800

Table D-15. NSA Upper Zone Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Maximum day demand, mgd	0.0	2.5	5.0	7.9	Cordova Hills (4,451 ac-ft/yr)
Peak hour demand, mgd	0.0	5.0	10.0	15.8	
Provided storage volume, MG					
Existing					
North Douglas	3.0	3.0	3.0	3.0	
Future					
Cordova Hills				3.0	
Total	3.0	3.0	3.0	6.0	
Required storage volume, MG					
Equalization	0.0	0.5	1.0	1.6	Assume 20% MDD.
Fire	0.5	0.5	0.5	0.5	Assume volume for one fire at 3,000 gpm for 3 hours.
Emergency	0.0	0.4	0.8	1.3	Assume 1/3 average day.
Total	0.5	1.4	2.3	3.4	
Difference (provided minus required)	2.5	1.6	0.7	2.6	Could downsize Cordova Hills tank.

Table D-16. NSA Upper Zone Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Provided pumping capacity, mgd					
Existing					
North Douglas	19.4	19.4	19.4	19.4	Very large capacity for such a small demand.
Upper zone max day supply	0.0	2.5	5.0	7.9	
from storage	19.4	16.9	14.4	11.5	
Future					
Cordova Hills				21.6	
Total from storage	19.4	16.9	14.4	33.1	
Required peak hour capacity from storage, mgd	0.0	2.5	5.0	7.9	Capacity increment above maximum day demand capacity.
Required fire flow from storage, mgd	4.3	4.3	4.3	4.3	4.3 mgd for one fire, max day supply accounted for above.
Required capacity from storage	4.3	4.3	5.0	7.9	Greater of pk hr or fire.
Difference (provided minus required)	15.1	12.6	9.4	25.2	Substantial surplus capacity.
Summary					
Total provided pump station capacity, mgd	38.8	36.3	33.8	52.5	
Total required pump station capacity					
from storage, mgd	4.3	4.3	5.0	7.9	
for max day supply capacity, mgd	0.0	2.5	5.0	7.9	
Total	4.3	6.8	10.0	15.8	

Table D-17. NSA Main Zone Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Maximum day demand, mgd	7.4	14.1	24.4	48.6	NSA 62.4 mgd minus Cordova Hills (7.9 mgd) and half of Rio del Oro (5.9 mgd).
Peak hour demand, mgd	14.8	28.2	48.8	97.2	
Provided storage volume, MG					
Existing					
Mather Housing GWTP	0.5	0.5	0.5	0.5	
Anatolia GWTP	4.0	4.0	4.0	4.0	
Mather 1 Main Base	1.0	1.0	1.0	1.0	
Mather 2	0.3	0.3	0.3	0.3	
subtotal	5.8	5.8	5.8	5.8	
Future					
Phase B NSA Project		10.0	10.0	10.0	
White Rock				3.0	
Suncreek				3.0	
subtotal	0.0	10.0	10.0	16.0	
Total	5.8	15.8	15.8	21.8	
Required storage volume, MG					
Equalization	1.5	2.8	4.9	9.7	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	1.2	2.4	4.1	8.1	Assume 1/3 average day.
Total	3.8	6.3	10.0	18.9	Could phase in the Phase B NSA Project storage.
Difference (provided minus required)	2.0	9.5	5.8	2.9	

Table D-18. NSA Main Zone Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2052)	Notes
Provided pumping capacity, mgd					
Existing					
Mather Housing GWTP	5.2	5.2	5.2	5.2	
GWTP	3.0	3.0	3.0	3.0	Assume half of GWTP supplies pump station.
from storage	2.2	2.2	2.2	2.2	
Anatolia GWTP/Storage (a)	11.2	22.5	22.5	22.5	
GWTP/part of MD supply from Vineyard SWTP	6.5	4.7	8.1	16.2	Assume 2/3 of main zone MD demand through NSA terminal and 1/3 through Anatolia tanks.
from storage	4.7	17.8	14.4	6.3	
Mather 1 Main Base	5.2	5.2	5.2	5.2	
Mather 2	2.0	2.0	2.0	2.0	Elevated tank, assumed flow.
subtotal from storage	14.1	27.2	23.8	15.7	
Future					
White Rock				14.4	
Suncreek				18.0	
Phase B NSA-total capacity (b)		64.0	64.0	64.0	Total pump station capacity.
max day supply for Cal Am Rio del Oro		1.0	3.0	5.9	Max day supply for Cal Am tank. Not from storage.
max day supply for upper zone		2.5	5.0	7.9	Supply to North Douglas and Cordova Hills tanks. Not from storage.
part of max days supply from Vineyard SWTP for main zone		9.4	16.3	32.4	Assume 2/3 through NSA terminal and 1/3 through Anatolia tanks.
subtotal, pumping not from Phase B NSA storage		12.9	24.3	46.2	
subtotal, capacity available to pump from Phase B NSA Project storage		51.1	39.7	17.8	
subtotal from storage		51.1	39.7	50.2	
Total from storage	14.1	78.3	63.5	65.9	
Required peak hour capacity from storage, mgd	7.4	14.1	24.4	48.6	
Difference (provided minus required)	6.7	64.2	39.1	17.3	Could phase in the NSA terminal storage pump station capacity.
Summary					
Total provided pump station capacity, mgd	23.6	98.9	98.9	131.3	
Total required pump station capacity					
from storage, mgd	7.4	14.1	24.4	48.6	
for max day supply capacity, mgd	9.5	20.6	35.4	65.4	
Total	16.9	34.7	59.8	114.0	
(a) When Phase A NSA is completed, Anatolia will pump through supply from Vineyard SWTP.					
(b) Calculation of Phase B NSA pump station capacity available to supply from storage the main zone's pk hr increment.					

Table D-19. CSA Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Maximum day demand, mgd	27.0	37.9	50.2	61.5	
Peak hour demand, mgd	54.0	75.8	100.4	123.0	
Provided storage volume, MG					
Existing					
Calvine Meadows GWTP	0.35	0.35	0.35	0.35	
East Elk Grove GWTP	3.5	3.5	3.5	3.5	
East Park GWTP	0.5	0.5	0.5	0.5	
Waterman GWTP	7.0	7.0	7.0	7.0	
Wildhawk GWTP	3.0	3.0	3.0	3.0	
Vineyard SWTP clearwell	6.0	6.0	6.0	6.0	Assumed equalization storage available from 20 mgd clearwell.
subtotal	20.4	20.4	20.4	20.4	
Future					
West Jackson GWTP			4.0	4.0	
East Elk Grove GWTP expansion				0.0	
Bond GWTP				0.5	
North Vineyard Station				4.0	
Calvine Meadows GWTP expansion				0.0	
subtotal			4.0	8.5	
Total	20.4	20.4	24.4	28.9	Planned storage volume.
Required storage volume, MG					
Equalization	5.4	7.6	10.0	12.3	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	4.5	6.3	8.4	10.3	Assume 1/3 average day.
Total	11.0	15.0	19.5	23.7	
Difference (provided minus required)	9.4	5.4	4.8	5.2	

Table D-20. CSA Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Provided pumping capacity, mgd					
Existing					
Calvine Meadows GWTP, total	8.8	8.8	8.8	8.8	
GWTP	5.0	5.0	5.0	5.0	
from storage	3.8	3.8	3.8	3.8	
East Elk Grove GWTP, total	13.0	13.0	13.0	13.0	
GWTP	6.5	6.5	6.5	6.5	
from storage	6.5	6.5	6.5	6.5	
East Park GWTP, total	3.5	3.5	3.5	3.5	
GWTP	2.9	2.9	2.9	2.9	
from storage	0.6	0.6	0.6	0.6	
Waterman GWTP, total	25.9	25.9	25.9	25.9	
GWTP	8.6	8.6	8.6	8.6	
from storage	17.3	17.3	17.3	17.3	
Wildhawk GWTP, total	19.0	19.0	19.0	19.0	
GWTP	7.5	7.5	7.5	7.5	
from storage	11.5	11.5	11.5	11.5	
Vineyard SWTP pump station	13.0	13.0	13.0	13.0	Assume capacity provided from clear well.
subtotal from storage	52.7	52.7	52.7	52.7	
Future					
West Jackson GWTP			21.6	21.6	
GWTP			18.0	18.0	
from storage			3.6	3.6	
East Elk Grove GWTP expansion, total				13.0	
GWTP				6.5	
from storage				6.5	
Bond GWTP, total				10.8	
GWTP				6.5	
from storage				4.3	
North Vineyard Station, total				21.6	Pumps through City POU supply.
City POU supply				19.1	
from storage				2.5	
Calvine Meadows GWTP expansion				7.2	Pump all from storage.
Vineyard SWTP pump station expansion				10.0	Assume future capacity from clear well.
subtotal from storage			3.6	34.1	
Total from storage	52.7	52.7	56.3	86.8	
Required peak hour capacity from storage, mgd	27.0	37.9	50.2	61.5	
Difference (provided minus required) (a)	25.7	14.8	6.1	25.3	Pumping capacity could be reduced in Phase 3.
Summary					
Total provided pump station capacity, mgd	83.2	83.2	104.8	167.4	
Total required pump station capacity					
from storage, mgd	27.0	37.9	50.2	61.5	
for max day supply capacity, mgd	30.5	30.5	48.5	61.5	
Total	57.5	68.4	98.7	123.0	
(a) Peak hour pumping surplus used to supply the SSA.					

Table D-21. SSA Storage Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	Notes
Maximum day demand, mgd	27.1	40.3	46.6	46.6	
Peak hour demand, mgd	54.2	80.6	93.2	93.2	
Provided storage volume, MG					
Existing					
Big Horn GWTP	2.0	2.0	2.0	2.0	
Dwight Road GWTP	7.0	7.0	7.0	7.0	
Lakeside GWTP	0.5	0.5	0.5	0.5	
Poppy Ridge GWTP	3.5	3.5	3.5	3.5	
subtotal	13.0	13.0	13.0	13.0	
Future					
Poppy Ridge GWTP expansion		3.5	3.5	3.5	
Big Horn GWTP expansion					
Franklin GWTP				2.0	
Whitelock GWTP				3.0	
subtotal	0.0	3.5	3.5	8.5	
Total	13.0	16.5	16.5	21.5	Planned storage volume.
Required storage volume, MG					
Equalization	5.4	8.1	9.3	9.3	Assume 20% MDD.
Fire	1.1	1.1	1.1	1.1	Assume volume for two fires at 3,000 gpm for 3 hours.
Emergency	4.5	6.7	7.8	7.8	Assume 1/3 average day.
Total	11.0	15.9	18.2	18.2	
Difference (provided minus required)	2.0	0.6	-1.7	3.3	Phase 2 deficit supplied by CSA storage surplus.

Table D-22. SSA Pump Station Capacity Evaluation					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2050)	Notes
Provided pumping capacity, mgd					
Existing					
Big Horn GWTP, total	8.6	8.6	8.6	8.6	
GWTP	4.5	4.5	4.5	4.5	
from storage	4.1	4.1	4.1	4.1	
Dwight Road GWTP, total	25.9	25.9	25.9	25.9	
GWTP and Franklin Intertie	13.2	13.2	13.2	13.2	
from storage	12.7	12.7	12.7	12.7	
Lakeside GWTP, total	7.2	7.2	7.2	7.2	
GWTP	6.5	6.5	6.5	6.5	
from storage	0.7	0.7	0.7	0.7	
Poppy Ridge GWTP, total	10.4	10.4	10.4	10.4	
GWTP	6.5	6.5	6.5	6.5	
from storage	3.9	3.9	3.9	3.9	
subtotal from storage	21.4	21.4	21.4	21.4	
Future					
Poppy Ridge GWTP expansion, total		17.0	17.0	17.0	
GWTP		6.5	6.5	6.5	
from storage		10.5	10.5	10.5	
Big Horn GWTP expansion, total			17.0	17.0	
GWTP			8.5	8.5	
from storage			8.5	8.5	
Franklin GWTP, total				21.6	
GWTP				7.0	
from storage				14.6	
Whitelock GWTP, total				14.4	
GWTP				13.0	
from storage				1.4	
subtotal from storage	0.0	10.5	19.0	35.0	
Total from storage	21.4	31.9	40.4	56.4	
Required peak hour capacity from storage, mgd	27.1	40.3	46.6	46.6	
Difference (provided minus required) (a)	-5.7	-8.4	-6.2	9.8	Phase 1 and 2 deficit supplied by CSA.
Summary					
Total provided pump station capacity, mgd	52.1	69.1	86.1	122.1	
Total required pump station capacity					
from storage, mgd	27.1	40.3	46.6	46.6	
for max day supply capacity, mgd	30.7	37.2	45.7	65.7	
Total	57.8	77.5	92.3	112.3	
(a) Peak hour pumping deficit to be supplied by surplus in CSA.					

Table D-23. Zone 40 Storage Capacity Evaluation Summary					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2051)	
Provided storage volume, MG					
Existing	42.2	42.2	42.2	42.2	
Future	0.0	13.5	17.5	36.0	
Total	42.2	55.7	59.7	78.2	
Required storage volume, MG					
Equalization	12.3	19.0	25.2	32.9	
Fire	3.8	3.8	3.8	3.8	
Emergency	10.3	15.8	21.0	27.4	
Total	26.4	38.6	50.1	64.2	
Difference (provided minus required)	15.8	17.1	9.6	14.0	

Table D-24. Zone 40 Pump Station Capacity Evaluation Summary					
	2013	Phase 1 (2015- 2025)	Phase 2 (2026- 2035)	Phase 3 (2036- 2050)	
Provided pump station capacity from storage, mgd					
Existing	107.6	118.2	112.3	101.3	
Future	0.0	20.5	32.6	88.1	
Total	107.6	138.7	144.9	189.4	
Required pump station capacity from storage, mgd					
	65.8	96.6	126.2	164.6	
Difference (provided minus required)	41.8	42.1	18.7	24.8	

Appendix E: Cost Estimates for CIP Projects

Sacramento County Water Agency

GWTP-1

Poppy Ridge GWTP Expansion

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 607,200
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Well Drilling and Casing	0	EA	\$ 550,000	\$ -
Well Pumping Equipment	3	EA	\$ 100,000	\$ 300,000
Well Piping and Valving	3	EA	\$ 150,000	\$ 450,000
Well Electrical and Instrumentation	3	EA	\$ 200,000	\$ 600,000
Groundwater Treatment Plant, FE & Mn Pressure Filters	6.5	MGD	\$ 150,000	\$ 975,000
Backwash Tank	1	EA	\$ 300,000	\$ 300,000
Backwash Pump	1	EA	\$ 75,000	\$ 75,000
Chemical Feed Equipment and Enclosure	1	LS	\$ 50,000	\$ 50,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Water Storage Tank	3.5	MG	\$ 700,000	\$ 2,450,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	17.0	MGD	\$ 40,000	\$ 680,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 8,197,200
Contingencies	1	LS	25%	\$ 2,049,300
Engineering, Admin, and Legal	1	LS	25%	\$ 2,561,625
Environmental & Permitting	1	LS	10%	\$ 1,024,650
TOTAL				\$ 13,832,800

Sacramento County Water Agency

P-1

NSA- Sunrise Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch	7,371		\$ 227	\$ 1,673,300	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch		LF	\$ 293	\$ -	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	
Butterfly Valves					
16 -inch	8	EA	\$ 5,721	\$ 45,800	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	8	EA	\$ 17,965	\$ 143,720	
SUBTOTAL				\$ 1,862,820	
Contingencies	1	LS	15%	\$ 279,423	
Engineering	1	LS	8%	\$ 171,379	
CMID	1	LS	10%	\$ 214,224	
TOTAL				\$ 2,527,900	

Sacramento County Water Agency

P-1A

NSA- Sunrise and Keifer Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch	9,676		\$ 227	\$ 2,196,500	Keifer East
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch		LF	\$ 293	\$ -	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	
Butterfly Valves					
16 -inch	10	EA	\$ 5,721	\$ 57,300	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$10,871	\$ -	
30 -inch	0	EA	\$20,711	\$ -	
36 -inch	0	EA	\$25,061	\$ -	
42 -inch	0	EA	\$34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	10	EA	\$17,965	\$ 179,650	
SUBTOTAL				\$ 2,433,450	
Contingencies	1	LS	15%	\$ 365,018	
Engineering	1	LS	8%	\$ 223,877	
CMID	1	LS	10%	\$ 279,847	
TOTAL				\$ 3,302,200	

Sacramento County Water Agency

P-2

NSA- Rio Del Oro Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch				\$ -	
18 -inch		LF	\$ 153	\$ -	
20 -inch		LF	\$ 166	\$ -	
24 -inch	11,593	LF	\$ 203	\$ 2,353,386	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	12	EA	\$ 10,871	\$ 130,452	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	12	EA	\$ 17,965	\$ 215,580	
SUBTOTAL				\$ 2,699,418	
Contingencies	1	LS	15%	\$ 404,913	
Engineering	1	LS	8%	\$ 248,346	
CMID	1	LS	10%	\$ 310,433	
TOTAL				\$ 3,663,200	

Sacramento County Water Agency

P-3

NSA- Kiefer Blvd Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch	11,078		\$ 134	\$ 1,484,400	
18 -inch	6,124	LF	\$ 153	\$ 936,937	
20 -inch	6,669	LF	\$ 166	\$ 1,107,100	
24 -inch	2,306	LF	\$ 203	\$ 468,100	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	12	EA	\$ 5,721	\$ 68,700	
18 -inch	7	EA	\$ 6,866	\$ 48,062	
20 -inch	7	EA	\$ 7,896	\$ 55,272	
24 -inch	3	EA	\$ 10,871	\$ 32,613	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	500	LF	\$ 1,361	\$ 680,500	Folsom Canal crossing 18" pipe
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	27	EA	\$ 17,965	\$ 485,055	
SUBTOTAL				\$ 5,366,739	
Contingencies	1	LS	15%	\$ 805,011	
Engineering	1	LS	8%	\$ 493,740	
CMID	1	LS	10%	\$ 617,175	
TOTAL				\$ 7,282,700	

Sacramento County Water Agency

P-3A

NSA- Shortened Kiefer Blvd Pipeline

Project Element		Quantity	Unit	Unit Cost	Total	Remarks
Pipelines						Assume not paved
16 -inch		-		\$ 134	\$ -	
18 -inch		6,200	LF	\$ 153	\$ 948,600	
20 -inch		1,450	LF	\$ 166	\$ 240,700	
24 -inch		2,306	LF	\$ 203	\$ 468,100	
30 -inch			LF	\$ 279	\$ -	
36 -inch			LF	\$ 342	\$ -	
42 -inch			LF	\$ 406	\$ -	
Butterfly Valves						
16 -inch		0	EA	\$ 5,721	\$ -	
18 -inch		7	EA	\$ 6,866	\$ 48,062	
20 -inch		2	EA	\$ 7,896	\$ 15,792	
24 -inch		3	EA	\$10,871	\$ 32,613	
30 -inch		0	EA	\$20,711	\$ -	
36 -inch		0	EA	\$25,061	\$ -	
42 -inch		0	EA	\$34,444	\$ -	
Horizontal Drilling						
30 -inch Casing		500	LF	\$ 1,361	\$ 680,500	Folsom Canal crossing 18" pipe
36 -inch Casing		0	LF	\$ 1,361	\$ -	
42 -inch Casing		0	LF	\$ 1,902	\$ -	
Blow-Off Assembly		10	EA	\$17,965	\$ 179,650	
SUBTOTAL					\$ 2,614,017	
Contingencies		1	LS	15%	\$ 392,103	
Engineering		1	LS	8%	\$ 240,490	
CMID		1	LS	10%	\$ 300,612	
TOTAL					\$ 3,547,300	

Zone 40 Water System Master Plan
Sacramento County Water Agency

P-3B

NSA- Shortened Kiefer Pipeline for Jackson Township

Project Element		Quantity	Unit	Unit Cost	Total	Remarks
Pipelines						Assume not paved
	16 -inch	3,045	LF	\$ 134	\$ 408,100	
	18 -inch	7,571	LF	\$ 153	\$ 1,158,363	
	20 -inch	5,220	LF	\$ 166	\$ 866,600	
	24 -inch	2,306	LF	\$ 203	\$ 468,118	
	30 -inch		LF	\$ 279	\$ -	
	36 -inch		LF	\$ 342	\$ -	
	42 -inch		LF	\$ 406	\$ -	
Butterfly Valves						
	16 -inch	4	EA	\$ 5,721	\$ 22,900	
	18 -inch	8	EA	\$ 6,866	\$ 54,928	
	20 -inch	6	EA	\$ 7,896	\$ 47,376	
	24 -inch	3	EA	\$ 10,871	\$ 32,613	
	30 -inch	0	EA	\$ 20,711	\$ -	
	36 -inch	0	EA	\$ 25,061	\$ -	
	42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling						
	30 -inch Casing	500	LF	\$ 1,361	\$ 680,500	Folsom Canal crossing 18" pipe
	36 -inch Casing	0	LF	\$ 1,361	\$ -	
	42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly		19	EA	\$ 17,965	\$ 341,335	
SUBTOTAL					\$ 4,080,833	
Contingencies		1	LS	15%	\$ 612,125	
Engineering		1	LS	8%	\$ 375,437	
CMID		1	LS	10%	\$ 469,296	
TOTAL					\$ 5,537,700	

Sacramento County Water Agency

P-4

NSA- Eagles Nest Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch				\$ -	
18 -inch		LF	\$ 153	\$ -	
20 -inch	2,043	LF	\$ 166	\$ 339,200	
24 -inch		LF	\$ 203	\$ -	
30 -inch	5,196	LF	\$ 279	\$ 1,449,900	
36 -inch	1,807	LF	\$ 342	\$ 618,000	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	3	EA	\$ 7,896	\$ 23,688	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	6	EA	\$ 20,711	\$ 124,266	
36 -inch	2	EA	\$ 25,061	\$ 50,200	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	10	EA	\$ 17,965	\$ 179,650	
SUBTOTAL				\$ 2,784,904	
Contingencies	1	LS	15%	\$ 417,736	
Engineering	1	LS	8%	\$ 256,211	
CMID	1	LS	10%	\$ 320,264	
TOTAL				\$ 3,779,200	

Sacramento County Water Agency

P-5

NSA-Ranch Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines		2020			Assume not paved
16 -inch			\$ 134	\$ -	
18 -inch		LF	\$ 153	\$ -	
20 -inch		LF	\$ 166	\$ -	
24 -inch	7,000	LF	\$ 203	\$ 1,421,000	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	7	EA	\$ 10,871	\$ 76,097	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	7	EA	\$ 17,965	\$ 125,755	
SUBTOTAL				\$ 1,622,852	
Contingencies	1	LS	15%	\$ 243,428	
Engineering	1	LS	8%	\$ 149,302	
CMID	1	LS	10%	\$ 186,628	
TOTAL				\$ 2,202,300	

Sacramento County Water Agency

P-6

NSA- Arboretum Pipe System

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch	3,167		\$ 227	\$ 719,000	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch		LF	\$ 293	\$ -	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	
Butterfly Valves					
16 -inch	4	EA	\$ 5,721	\$ 22,900	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	4	EA	\$ 17,965	\$ 71,860	
SUBTOTAL				\$ 813,760	
Contingencies	1	LS	15%	\$ 122,064	
Engineering	1	LS	8%	\$ 74,866	
CMID	1	LS	10%	\$ 93,582	
TOTAL				\$ 1,104,300	

Sacramento County Water Agency

P-7

NSA- South Jaeger Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch	5,238		\$ 134	\$ 701,900	
18 -inch		LF	\$ 153	\$ -	
20 -inch		LF	\$ 166	\$ -	
24 -inch		LF	\$ 203	\$ -	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	6	EA	\$ 5,721	\$ 34,400	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	6	EA	\$ 17,965	\$ 107,790	
SUBTOTAL				\$ 844,090	
Contingencies	1	LS	15%	\$ 126,614	
Engineering	1	LS	8%	\$ 77,656	
CMID	1	LS	10%	\$ 97,070	
TOTAL				\$ 1,145,500	

Sacramento County Water Agency

P-8

NSA- East NSA Pipe System

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch	27,571	LF	\$ 134	\$ 3,694,600	
18 -inch	3,489	LF	\$ 153	\$ 533,817	
20 -inch		LF	\$ 166	\$ -	
24 -inch	14,288	LF	\$ 203	\$ 2,900,464	
30 -inch	16,041	LF	\$ 279	\$ 4,475,500	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	28	EA	\$ 5,721	\$ 160,200	
18 -inch	4	EA	\$ 6,866	\$ 27,464	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	15	EA	\$ 10,871	\$ 163,065	
30 -inch	17	EA	\$ 20,711	\$ 352,087	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	62	EA	\$ 17,965	\$ 1,113,830	
SUBTOTAL				\$13,421,027	
Contingencies	1	LS	15%	\$ 2,013,154	
Engineering	1	LS	8%	\$ 1,234,734	
CMID	1	LS	10%	\$ 1,543,418	
TOTAL				\$18,212,400	

Sacramento County Water Agency

P-9

NSA- North Jaeger Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch				\$ -	
18 -inch		LF	\$ 153	\$ -	
20 -inch		LF	\$ 166	\$ -	
24 -inch	6,365	LF	\$ 203	\$ 1,292,095	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	7	EA	\$ 10,871	\$ 76,097	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	7	EA	\$ 17,965	\$ 125,755	
SUBTOTAL				\$ 1,493,947	
Contingencies	1	LS	15%	\$ 224,092	
Engineering	1	LS	8%	\$ 137,443	
CMID	1	LS	10%	\$ 171,804	
TOTAL				\$ 2,027,300	

Sacramento County Water Agency

P-11

CSA- Vineyard Road Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch	13,600	LF	\$ 134	\$ 1,822,400	
18 -inch		LF	\$ 153	\$ -	
20 -inch		LF	\$ 166	\$ -	
24 -inch		LF	\$ 203	\$ -	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves				\$ -	
16 -inch	14	EA	\$ 5,721	\$ 80,100	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	14	EA	\$ 17,965	\$ 251,510	
SUBTOTAL				\$ 2,154,010	
Contingencies	1	LS	15%	\$ 323,102	
Engineering	1	LS	8%	\$ 198,169	
CMID	1	LS	10%	\$ 247,711	
TOTAL				\$ 2,923,000	

Sacramento County Water Agency

P-12

CSA- Fruitridge Road Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch	7,982	LF	\$ 227	\$ 1,812,000	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch		LF	\$ 293	\$ -	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - Fruitridge Road
Butterfly Valves				\$ -	
16 -inch	8	EA	\$ 5,721	\$ 45,800	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	8	EA	\$ 17,965	\$ 143,720	
SUBTOTAL				\$ 2,001,520	
Contingencies	1	LS	15%	\$ 300,228	
Engineering	1	LS	8%	\$ 184,140	
CMID	1	LS	10%	\$ 230,175	
TOTAL				\$ 2,716,100	

Sacramento County Water Agency

P-13

CSA- Elder Creek Road Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch	10,070	LF	\$ 227	\$ 2,285,900	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch	5,245	LF	\$ 293	\$ 1,536,785	
30 -inch	5,861	LF	\$ 370	\$ 2,168,600	
36 -inch	167	LF	\$ 438	\$ 73,200	
42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - Elder Creek Road
Butterfly Valves				\$ -	
16 -inch	11	EA	\$ 5,721	\$ 63,000	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	6	EA	\$ 10,871	\$ 65,226	
30 -inch	6	EA	\$ 20,711	\$ 124,266	
36 -inch	1	EA	\$ 25,061	\$ 25,100	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	22	EA	\$ 17,965	\$ 395,230	
SUBTOTAL				\$ 6,737,307	
Contingencies	1	LS	15%	\$ 1,010,596	
Engineering	1	LS	8%	\$ 619,832	
CMID	1	LS	10%	\$ 774,790	
TOTAL				\$ 9,142,600	

Sacramento County Water Agency

P-14

CSA- Bradshaw Road Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch	5,267	LF	\$ 227	\$ 1,195,700	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch	5,332	LF	\$ 293	\$ 1,562,276	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - Bradshaw Blvd.
Butterfly Valves				\$ -	
16 -inch	6	EA	\$ 5,721	\$ 34,400	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	6	EA	\$ 10,871	\$ 65,226	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	200	LF	\$ 1,361	\$ 272,200	16" crossing under creek
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	11	EA	\$ 17,965	\$ 197,615	
SUBTOTAL				\$ 3,327,417	
Contingencies	1	LS	15%	\$ 499,113	
Engineering	1	LS	8%	\$ 306,122	
CMID	1	LS	10%	\$ 382,653	
TOTAL				\$ 4,515,400	

Zone 40 Water System Master Plan P-14A CSA- Bradshaw Road Pipeline
Sacramento County Water Agency

Project Element		Quantity	Unit	Unit Cost	Total	Remarks
Pipelines						Assume paved
	16 -inch		LF	\$ 227	\$ -	
	18 -inch		LF	\$ 257	\$ -	
	20 -inch		LF	\$ 264	\$ -	
	24 -inch	5,332	LF	\$ 293	\$ 1,562,276	
	30 -inch		LF	\$ 370	\$ -	
	36 -inch		LF	\$ 438	\$ -	
	42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - Bradshaw Blvd.
Butterfly Valves					\$ -	
	16 -inch	0	EA	\$ 5,721	\$ -	
	18 -inch	0	EA	\$ 6,866	\$ -	
	20 -inch	0	EA	\$ 7,896	\$ -	
	24 -inch	6	EA	\$ 10,871	\$ 65,226	
	30 -inch	0	EA	\$ 20,711	\$ -	
	36 -inch	0	EA	\$ 25,061	\$ -	
	42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling						
	30 -inch Casing	200	LF	\$ 1,361	\$ 272,200	16" crossing under creek
	36 -inch Casing	0	LF	\$ 1,361	\$ -	
	42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly		6	EA	\$ 17,965	\$ 107,790	
SUBTOTAL					\$ 2,007,492	
Contingencies		1	LS	15%	\$ 301,124	
Engineering		1	LS	8%	\$ 184,689	
CMID		1	LS	10%	\$ 230,862	
TOTAL					\$ 2,724,200	

Sacramento County Water Agency

P-15

CSA- North Vineyard Station (Florin to Gerber) Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch				\$ -	
18 -inch		LF	\$ 153	\$ -	
20 -inch		LF	\$ 166	\$ -	
24 -inch	7,853	LF	\$ 203	\$ 1,594,159	
30 -inch	1,337	LF	\$ 279	\$ 373,100	
36 -inch	2,657	LF	\$ 342	\$ 908,700	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	8	EA	\$ 10,871	\$ 86,968	
30 -inch	2	EA	\$ 20,711	\$ 41,422	
36 -inch	3	EA	\$ 25,061	\$ 75,200	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	300	LF	\$ 1,361	\$ 408,300	24" pipe across RR
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	12	EA	\$ 17,965	\$ 215,580	
SUBTOTAL				\$ 3,703,429	
Contingencies	1	LS	15%	\$ 555,514	
Engineering	1	LS	8%	\$ 340,715	
CMID	1	LS	10%	\$ 425,894	
TOTAL				\$ 5,025,600	

Sacramento County Water Agency

P-16

CSA- South Watt Connector Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch				\$ -	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch	2,693	LF	\$ 293	\$ 789,184	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - South Watt
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	3	EA	\$ 10,871	\$ 32,613	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	300	LF	\$ 1,361	\$ 408,300	24" pipe across RR
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	3	EA	\$ 17,965	\$ 53,895	
SUBTOTAL				\$ 1,283,992	
Contingencies	1	LS	15%	\$ 192,599	
Engineering	1	LS	8%	\$ 118,127	
CMID	1	LS	10%	\$ 147,659	
TOTAL				\$ 1,742,400	

Sacramento County Water Agency

P-17

CSA- CSA Backbone Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch				\$ -	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch	4,525	LF	\$ 293	\$ 1,325,825	
30 -inch	5,423	LF	\$ 370	\$ 2,006,600	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - Bradshaw
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	5	EA	\$ 10,871	\$ 54,355	
30 -inch	6	EA	\$ 20,711	\$ 124,266	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	10	EA	\$ 17,965	\$ 179,650	
SUBTOTAL				\$ 3,690,696	
Contingencies	1	LS	15%	\$ 553,604	
Engineering	1	LS	8%	\$ 339,544	
CMID	1	LS	10%	\$ 424,430	
TOTAL				\$ 5,008,300	

Sacramento County Water Agency

P-18

CSA- Elk Grove Connector Pipelines

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch	8,340	LF	\$ 227	\$ 1,893,180	Add 1,700 ft per Carlos' TM figure. Bob's map shows 12 in.
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch	2,982	LF	\$ 293	\$ 873,726	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - Bradshaw and Grantline
Butterfly Valves					
16 -inch	9	EA	\$ 5,721	\$ 51,500	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	3	EA	\$ 10,871	\$ 32,613	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	300	LF	\$ 1,361	\$ 408,300	24" under railroad
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	12	EA	\$ 17,965	\$ 215,580	
SUBTOTAL				\$ 3,474,899	
Contingencies	1	LS	15%	\$ 521,235	
Engineering	1	LS	8%	\$ 319,691	
CMID	1	LS	10%	\$ 399,613	
TOTAL				\$ 4,715,500	

Sacramento County Water Agency

P-19

CSA- Power Inn Road Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch				\$ -	
18 -inch		LF	\$ 257	\$ -	
20 -inch		LF	\$ 264	\$ -	
24 -inch	1,273	LF	\$ 293	\$ 372,905	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	2	EA	\$ 10,871	\$ 21,742	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	2	EA	\$ 17,965	\$ 35,930	
SUBTOTAL				\$ 430,577	
Contingencies	1	LS	15%	\$ 64,587	
Engineering	1	LS	8%	\$ 39,613	
CMID	1	LS	10%	\$ 49,516	
TOTAL				\$ 584,300	

Sacramento County Water Agency

P-20

SSA- Big Horn / Kammerer Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch				\$ -	
18 -inch		LF	\$ 153	\$ -	
20 -inch	7,832	LF	\$ 166	\$ 1,300,200	
24 -inch	1,347	LF	\$ 203	\$ 273,441	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	8	EA	\$ 7,896	\$ 63,168	
24 -inch	2	EA	\$ 10,871	\$ 21,742	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	10	EA	\$ 17,965	\$ 179,650	
SUBTOTAL				\$ 1,838,201	
Contingencies	1	LS	15%	\$ 275,730	
Engineering	1	LS	8%	\$ 169,114	
CMID	1	LS	10%	\$ 211,393	
TOTAL				\$ 2,494,500	

Sacramento County Water Agency

P-21

SSA- Bruceville Road Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch				\$ -	
18 -inch	1,267	LF	\$ 257	\$ 325,681	
20 -inch		LF	\$ 264	\$ -	
24 -inch		LF	\$ 293	\$ -	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	Installation in Major Arterials - Bruceville Road
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	2	EA	\$ 6,866	\$ 13,732	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	2	EA	\$ 17,965	\$ 35,930	
SUBTOTAL				\$ 375,343	
Contingencies	1	LS	15%	\$ 56,301	
Engineering	1	LS	8%	\$ 34,532	
CMID	1	LS	10%	\$ 43,164	
TOTAL				\$ 509,400	

Sacramento County Water Agency

P-22

NSA- North Grant Line Road Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch				\$ -	
18 -inch		LF	\$ 153	\$ -	
20 -inch	14,000	LF	\$ 166	\$ 2,324,000	
24 -inch	3,000	LF	\$ 203	\$ 609,000	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	14	EA	\$ 7,896	\$ 110,544	
24 -inch	3	EA	\$ 10,871	\$ 32,613	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	17	EA	\$ 17,965	\$ 305,405	
SUBTOTAL				\$ 3,381,562	
Contingencies	1	LS	15%	\$ 507,234	
Engineering	1	LS	8%	\$ 311,104	
CMID	1	LS	10%	\$ 388,880	
TOTAL				\$ 4,588,800	

Sacramento County Water Agency

P-23

CSA- Florin-Watt Pipelines

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch				\$ -	
18 -inch		LF	\$ 257	\$ -	
20 -inch	5,000	LF	\$ 264	\$ 1,320,000	
24 -inch	5,000	LF	\$ 293	\$ 1,465,000	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	5	EA	\$ 7,896	\$ 39,480	
24 -inch	5	EA	\$ 10,871	\$ 54,355	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	10	EA	\$ 17,965	\$ 179,650	
SUBTOTAL				\$ 3,058,485	
Contingencies	1	LS	15%	\$ 458,773	
Engineering	1	LS	8%	\$ 281,381	
CMID	1	LS	10%	\$ 351,726	
TOTAL				\$ 4,150,400	

Sacramento County Water Agency

P-24

CSA- North Waterman Pipeline

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch	3,000	LF	\$ 134	\$ 402,000	
18 -inch		LF	\$ 153	\$ -	
20 -inch		LF	\$ 166	\$ -	
24 -inch		LF	\$ 203	\$ -	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	3	EA	\$ 5,721	\$ 17,200	
18 -inch	0	EA	\$ 6,866	\$ -	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	0	EA	\$ 10,871	\$ -	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	0	EA	\$ 17,965	\$ -	
SUBTOTAL				\$ 419,200	
Contingencies	1	LS	15%	\$ 62,880	
Engineering	1	LS	8%	\$ 38,566	
CMID	1	LS	10%	\$ 48,208	
TOTAL				\$ 568,900	

Sacramento County Water Agency

P-25

CSA- Sheldon-Waterman Pipelines

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume paved
16 -inch				\$ -	
18 -inch	11,000	LF	\$ 257	\$ 2,827,000	
20 -inch		LF	\$ 264	\$ -	
24 -inch	4,000	LF	\$ 293	\$ 1,172,000	
30 -inch		LF	\$ 370	\$ -	
36 -inch		LF	\$ 438	\$ -	
42 -inch		LF	\$ 510	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	11	EA	\$ 6,866	\$ 75,526	
20 -inch	0	EA	\$ 7,896	\$ -	
24 -inch	4	EA	\$ 10,871	\$ 43,484	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	4	EA	\$ 17,965	\$ 71,860	
SUBTOTAL				\$ 4,189,870	
Contingencies	1	LS	15%	\$ 628,481	
Engineering	1	LS	8%	\$ 385,468	
CMID	1	LS	10%	\$ 481,835	
TOTAL				\$ 5,685,700	

Sacramento County Water Agency

P-26

SSA- South East Policy Area Pipelines

Project Element	Quantity	Unit	Unit Cost	Total	Remarks
Pipelines					Assume not paved
16 -inch				\$ -	
18 -inch	3,000	LF	\$ 153	\$ 459,000	
20 -inch	14,000	LF	\$ 166	\$ 2,324,000	
24 -inch	5,000	LF	\$ 203	\$ 1,015,000	
30 -inch		LF	\$ 279	\$ -	
36 -inch		LF	\$ 342	\$ -	
42 -inch		LF	\$ 406	\$ -	
Butterfly Valves					
16 -inch	0	EA	\$ 5,721	\$ -	
18 -inch	3	EA	\$ 6,866	\$ 20,598	
20 -inch	14	EA	\$ 7,896	\$ 110,544	
24 -inch	5	EA	\$ 10,871	\$ 54,355	
30 -inch	0	EA	\$ 20,711	\$ -	
36 -inch	0	EA	\$ 25,061	\$ -	
42 -inch	0	EA	\$ 34,444	\$ -	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Blow-Off Assembly	19	EA	\$ 17,965	\$ 341,335	
SUBTOTAL				\$ 4,324,832	
Contingencies	1	LS	15%	\$ 648,725	
Engineering	1	LS	8%	\$ 397,885	
CMID	1	LS	10%	\$ 497,356	
TOTAL				\$ 5,868,800	

Sacramento County Water Agency

GWTP-2

West Jackson GWTP

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 1,270,000
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Well Drilling and Casing	5	EA	\$ 550,000	\$ 2,750,000
Well Pumping Equipment	5	EA	\$ 100,000	\$ 500,000
Well Piping and Valving	5	EA	\$ 150,000	\$ 750,000
Well Electrical and Instrumentation	5	EA	\$ 200,000	\$ 1,000,000
Groundwater Treatment Plant, FE&Mn Pressure Filters	18	MGD	\$ 150,000	\$ 2,700,000
Backwash Tank	1	EA	\$ 300,000	\$ 300,000
Backwash Pump	1	EA	\$ 75,000	\$ 75,000
Chemical Feed Equipment and Enclosure	1	LS	\$ 50,000	\$ 50,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Water Storage Tank	4	MG	\$ 700,000	\$ 2,800,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	21.6	MGD	\$ 150,000	\$ 3,240,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 17,145,000
Contingencies	1	LS	25%	\$ 4,286,250
Engineering, Admin, and Legal	1	LS	25%	\$ 5,357,813
Environmental & Permitting	1	LS	10%	\$ 2,143,125
TOTAL				\$ 28,932,200

Sacramento County Water Agency

GWTP-3 Bond GWTP

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 646,400
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Well Drilling and Casing	3	EA	\$ 550,000	\$ 1,650,000
Well Pumping Equipment	3	EA	\$ 100,000	\$ 300,000
Well Piping and Valving	3	EA	\$ 150,000	\$ 450,000
Well Electrical and Instrumentation	3	EA	\$ 200,000	\$ 600,000
Groundwater Treatment Plant, FE&Mn Pressure Filters	6.5	MGD	\$ 150,000	\$ 975,000
Backwash Tank	1	EA	\$ 300,000	\$ 300,000
Backwash Pump	1	EA	\$ 75,000	\$ 75,000
Chemical Feed Equipment and Enclosure	1	LS	\$ 50,000	\$ 50,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Water Storage Tank	0.5	MG	\$ 700,000	\$ 350,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	10.8	MGD	\$ 150,000	\$ 1,620,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 8,726,400
Contingencies	1	LS	25%	\$ 2,181,600
Engineering, Admin, and Legal	1	LS	25%	\$ 2,727,000
Environmental & Permitting	1	LS	10%	\$ 1,090,800
TOTAL				\$ 14,725,800

Sacramento County Water Agency

GWTP-4 East Elk Grove GWTP Expansion

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 600,800
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Well Drilling and Casing	2	EA	\$ 550,000	\$ 1,100,000
Well Pumping Equipment	3	EA	\$ 100,000	\$ 300,000
Well Piping and Valving	3	EA	\$ 150,000	\$ 450,000
Well Electrical and Instrumentation	3	EA	\$ 200,000	\$ 600,000
Groundwater Treatment Plant, FE&Mn Pressure Filters	6.5	MGD	\$ 150,000	\$ 975,000
Backwash Tank	1	EA	\$ 300,000	\$ 300,000
Backwash Pump	1	EA	\$ 75,000	\$ 75,000
Chemical Feed Equipment and Enclosure	1	LS	\$ 50,000	\$ 50,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Water Storage Tank	0	MG	\$ 700,000	\$ -
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	13	MGD	\$ 150,000	\$ 1,950,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 8,110,800
Contingencies	1	LS	25%	\$ 2,027,700
Engineering, Admin, and Legal	1	LS	25%	\$ 2,534,625
Environmental & Permitting	1	LS	10%	\$ 1,013,850
TOTAL				\$ 13,687,000

Sacramento County Water Agency

GWTP-5

Franklin GWTP
Expansion

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 814,000
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Well Drilling and Casing	1	EA	\$ 550,000	\$ 550,000
Well Pumping Equipment	4	EA	\$ 100,000	\$ 400,000
Well Piping and Valving	4	EA	\$ 150,000	\$ 600,000
Well Electrical and Instrumentation	4	EA	\$ 200,000	\$ 800,000
Groundwater Treatment Plant, FE&Mn Pressure Filters	7	MGD	\$ 150,000	\$ 1,050,000
Backwash Tank	1	EA	\$ 300,000	\$ 300,000
Backwash Pump	1	EA	\$ 75,000	\$ 75,000
Chemical Feed Equipment and Enclosure	1	LS	\$ 50,000	\$ 50,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Water Storage Tank	2.0	MG	\$ 700,000	\$ 1,400,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	21.6	MGD	\$ 150,000	\$ 3,240,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 10,989,000
Contingencies	1	LS	25%	\$ 2,747,250
Engineering, Admin, and Legal	1	LS	25%	\$ 3,434,063
Environmental & Permitting	1	LS	10%	\$ 1,373,625
TOTAL				\$ 18,544,000

Sacramento County Water Agency

GWTP-6 Whitelock GWTP

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 1,147,600
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Well Drilling and Casing	6	EA	\$ 550,000	\$ 3,300,000
Well Pumping Equipment	6	EA	\$ 100,000	\$ 600,000
Well Piping and Valving	6	EA	\$ 150,000	\$ 900,000
Well Electrical and Instrumentation	6	EA	\$ 200,000	\$ 1,200,000
Groundwater Treatment Plant, FE&Mn Pressure Filters	13.0	MGD	\$ 150,000	\$ 1,950,000
Backwash Tank	1	EA	\$ 300,000	\$ 300,000
Backwash Pump	1	EA	\$ 75,000	\$ 75,000
Chemical Feed Equipment and Enclosure	1	LS	\$ 50,000	\$ 50,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Water Storage Tank	3.0	MG	\$ 700,000	\$ 2,100,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	14.4	MGD	\$ 150,000	\$ 2,160,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 15,492,600
Contingencies	1	LS	25%	\$ 3,873,150
Engineering, Admin, and Legal	1	LS	25%	\$ 4,841,438
Environmental & Permitting	1	LS	10%	\$ 1,936,575
TOTAL				\$ 26,143,800

Sacramento County Water Agency

GWTP-7

Big Horn GWTP Expansion

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	\$ 1	LS	8.00%	\$ 647,200
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Well Drilling and Casing	4	EA	\$ 550,000	\$ 2,200,000
Well Pumping Equipment	4	EA	\$ 100,000	\$ 400,000
Well Piping and Valving	4	EA	\$ 150,000	\$ 600,000
Well Electrical and Instrumentation	4	EA	\$ 200,000	\$ 800,000
Groundwater Treatment Plant, FE&Mn Pressure Filters	8.5	MGD	\$ 150,000	\$ 1,275,000
Backwash Tank	1	EA	\$ 300,000	\$ 300,000
Backwash Pump	1	EA	\$ 75,000	\$ 75,000
Chemical Feed Equipment and Enclosure	1	LS	\$ 50,000	\$ 50,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Water Storage Tank		MG	\$ 700,000	\$ -
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	17.0	MGD	\$ 40,000	\$ 680,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 8,737,200
Contingencies	1	LS	25%	\$ 2,184,300
Engineering, Admin, and Legal	1	LS	25%	\$ 2,730,375
Environmental & Permitting	1	LS	10%	\$ 1,092,150
TOTAL				\$ 14,744,100

Sacramento County Water Agency

SW-2

City POU Water Supply Connection

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 85,072
Pipelines				
16 -inch		LF		\$ -
18 -inch		LF		\$ -
20 -inch		LF		\$ -
24 -inch		LF		\$ -
30 -inch		LF		\$ -
36 -inch	13,000	LF		\$ -
42 -inch		LF	\$ 438	\$ -
Installation in Major Arterials	1	EA	10.00%	\$ -
Butterfly Valves				
16 -inch	0	EA		\$ -
18 -inch	0	EA		\$ -
20 -inch	0	EA		\$ -
24 -inch	13	EA	\$ 25,061	\$ 325,793
30 -inch	0	EA		\$ -
36 -inch	13	EA		\$ -
42 -inch	0	EA		\$ -
Horizontal Drilling				
30 -inch Casing	0	LF	\$ -	\$ -
36 -inch Casing	0	LF	\$ -	\$ -
42 -inch Casing	300	LF	\$ 1,902	\$ 570,600
Trench Restoration				
Paved	58,500	SF	\$ 2	\$ 117,000
Blow-Off Assembly	0	EA		\$ -
Fire Hydrants	0	EA		\$ -
Connection to (E) System	1	EA	\$ 50,000	\$ 50,000
Abandonment Exist Pipe	0	EA		\$ -
Property Acquisition	0	ACRE		\$ -
Railroad Crossing Permitting	1	EA	10%	\$ 57,060
Canal Crossing Permitting	0	EA	10%	\$ -
Highway Crossing Permitting	0	EA	10%	\$ -
SUBTOTAL				\$1,205,525
Contingencies	1	LS	25%	\$ 301,381
Engineering, Admin, and Legal	1	LS	25%	\$ 376,727
Environmental & Permitting	1	LS	10%	\$ 150,691
TOTAL				\$2,034,400

Sacramento County Water Agency

S-2

Suncreek Storage Tank

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 520,800
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Water Storage Tank	3	MG	\$ 700,000	\$ 2,100,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	18.0	MGD	\$ 150,000	\$ 2,700,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 7,030,800
Contingencies	1	LS	25%	\$ 1,757,700
Engineering, Admin, and Legal	1	LS	25%	\$ 2,197,125
Environmental & Permitting	1	LS	10%	\$ 878,850
TOTAL				\$ 11,864,500

Sacramento County Water Agency

S-3

Cordova Hills Storage Tank

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 564,000
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Water Storage Tank	3	MG	\$ 700,000	\$ 2,100,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	21.6	MGD	\$ 150,000	\$ 3,240,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 7,614,000
Contingencies	1	LS	25%	\$ 1,903,500
Engineering, Admin, and Legal	1	LS	25%	\$ 2,379,375
Environmental & Permitting	1	LS	10%	\$ 951,750
TOTAL				\$12,848,700

Sacramento County Water Agency

S-4

White Rock Road Storage Tank

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 477,600
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Water Storage Tank	3.0	MG	\$ 700,000	\$ 2,100,000
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	14.4	MGD	\$ 150,000	\$ 2,160,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 6,447,600
Contingencies	1	LS	25%	\$ 1,611,900
Engineering, Admin, and Legal	1	LS	25%	\$ 2,014,875
Environmental & Permitting	1	LS	10%	\$ 805,950
TOTAL				\$ 10,880,400

Sacramento County Water Agency

S-5

North Vineyard Station Storage Tank

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 240,000
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Water Storage Tank	0	MG	\$ 700,000	\$ -
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	8.6	MGD	\$ 150,000	\$ 1,290,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 3,240,000
Contingencies	1	LS	25%	\$ 810,000
Engineering, Admin, and Legal	1	LS	25%	\$ 1,012,500
Environmental & Permitting	1	LS	10%	\$ 405,000
TOTAL				\$ 5,467,500

Sacramento County Water Agency

S-6

Calvine Meadows Pump Station Expansion

Project Element	Quantity	Unit	Unit Cost	Total
Mobilization	1	LS	8.00%	\$ 223,200
Site Grading, Paving, and Landscaping	1	LS	\$ 300,000	\$ 300,000
Water Storage Tank	0	MG	\$ 700,000	\$ -
Pump Station Building	1	LS	\$ 300,000	\$ 300,000
Pumps and Motors	7.2	MGD	\$ 150,000	\$ 1,080,000
Standby Generator	1	EA	\$ 400,000	\$ 400,000
Pump Station Electrical and Instrumentation	1	LS	\$ 400,000	\$ 400,000
Yard Piping	1	LS	\$ 300,000	\$ 300,000
Connection to (E) System	1	EA	\$ 10,000	\$ 10,000
Property Acquisition	0	ACRE		\$ -
SUBTOTAL				\$ 3,013,200
Contingencies	1	LS	25%	\$ 753,300
Engineering, Admin, and Legal	1	LS	25%	\$ 941,625
Environmental & Permitting	1	LS	10%	\$ 376,650
TOTAL				\$ 5,084,800

Zone 40 Water System Infrastructure Plan
Sacramento County Water Agency

Phases 2 and 3 Pipelines,
Baseline

Project Element		Quantity	Unit	Unit Cost	Total
Pipelines					
	16 -inch	82,803	LF	\$ 227	\$ 18,796,400
	18 -inch	4,740	LF	\$ 257	\$ 1,218,101
	20 -inch	-	LF	\$ 264	\$ -
	24 -inch	64,864	LF	\$ 293	\$ 19,005,091
	30 -inch	4,681	LF	\$ 370	\$ 1,731,900
	36 -inch	29,502	LF	\$ 438	\$ 12,921,900
	42 -inch	3,371	LF	\$ 510	\$ 1,719,300
	54 -inch	40,704	LF	\$ 767	\$ 31,220,000
Installation in Major Arterials			EA	10.00%	\$ -
Butterfly Valves					
	16 -inch	83	EA	\$ 6,866	\$ 569,900
	18 -inch	5	EA	\$ 7,896	\$ 39,480
	20 -inch	0	EA	\$ 10,871	\$ -
	24 -inch	65	EA	\$ 20,711	\$ 1,346,215
	30 -inch	5	EA	\$ 25,061	\$ 125,305
	36 -inch	30	EA	\$ 34,444	\$ 1,033,400
	42 -inch	4	EA	\$ 52,409	\$ 209,700
	54 -inch	41	LF	\$ 81,362	\$ 3,335,900
Horizontal Drilling					
	30 -inch Casing	0	LF	\$ 1,361	\$ -
	36 -inch Casing	0	LF	\$ 1,361	\$ -
	42 -inch Casing	0	LF	\$ 1,902	\$ -
Trench Restoration					
	Paved	644,189	SF	\$ 2	\$ 1,288,379
Blow-Off Assembly		0	EA		\$ -
Fire Hydrants		0	EA		\$ -
Connection to (E) System		0	EA	\$ 10,000	\$ -
Abandonment Exist Pipe		0	EA		\$ -
Property Acquisition		0	ACRE		\$ -
Railroad Crossing Permitting		0	EA	10%	\$ -
Highway Crossing Permitting		0	EA	10%	\$ -
Highway Crossing Permitting		0	EA	10%	\$ -
SUBTOTAL					\$ 94,560,971
Contingencies		1	LS	25%	\$ 23,640,243
Engineering, Admin, and Legal		1	LS	25%	\$ 29,550,303
Environmental & Permitting		1	LS	10%	\$ 11,820,121
TOTAL					\$ 159,571,700

Zone 40 Water System Infrastructure Plan
Sacramento County Water Agency

Phases 2 and 3 Pipelines,
Jackson Township

Project Element		Quantity	Unit	Unit Cost	Total
Pipelines					
	16 -inch	114,351	LF	\$ 227	\$ 25,957,800
	18 -inch	1,739	LF	\$ 257	\$ 447,042
	20 -inch	5,689	LF	\$ 264	\$ 1,501,900
	24 -inch	64,864	LF	\$ 293	\$ 19,005,091
	30 -inch	4,681	LF	\$ 370	\$ 1,731,900
	36 -inch	29,502	LF	\$ 438	\$ 12,921,900
	42 -inch	3,371	LF	\$ 510	\$ 1,719,300
	54 -inch	40,704	LF	\$ 767	\$ 31,220,000
Installation in Major Arterials			EA	10.00%	\$ -
Butterfly Valves					
	16 -inch	115	EA	\$ 6,866	\$ 789,600
	18 -inch	2	EA	\$ 7,896	\$ 15,792
	20 -inch	6	EA	\$ 10,871	\$ 65,226
	24 -inch	65	EA	\$ 20,711	\$ 1,346,215
	30 -inch	5	EA	\$ 25,061	\$ 125,305
	36 -inch	30	EA	\$ 34,444	\$ 1,033,400
	42 -inch	4	EA	\$ 52,409	\$ 209,700
	54 -inch	41	LF	\$ 81,362	\$ 3,335,900
Horizontal Drilling					
	30 -inch Casing	0	LF	\$ 1,361	\$ -
	36 -inch Casing	0	LF	\$ 1,361	\$ -
	42 -inch Casing	0	LF	\$ 1,902	\$ -
Trench Restoration					
	Paved	742,590	SF	\$ 2	\$ 1,485,180
Blow-Off Assembly			EA		\$ -
Fire Hydrants			EA		\$ -
Connection to (E) System			EA	\$ 10,000	\$ -
Abandonment Exist Pipe			EA		\$ -
Property Acquisition			ACRE		\$ -
Railroad Crossing Permitting			EA	10%	\$ -
Highway Crossing Permitting			EA	10%	\$ -
Highway Crossing Permitting			EA	10%	\$ -
SUBTOTAL					\$ 102,911,251
Contingencies		1	LS	25%	\$ 25,727,813
Engineering, Admin, and Legal		1	LS	25%	\$ 32,159,766
Environmental & Permitting		1	LS	10%	\$ 12,863,906
TOTAL					\$ 173,662,800

Zone 40 Water System Infrastructure Plan
Sacramento County Water Agency

Phases 2 and 3 Pipelines,
NewBridge

Project Element	Quantity	Unit	Unit Cost	Total
Pipelines				
16 -inch	105,319	LF	\$ 227	\$ 23,907,600
18 -inch	7,863	LF	\$ 257	\$ 2,020,910
20 -inch	-	LF	\$ 264	\$ -
24 -inch	64,864	LF	\$ 293	\$ 19,005,091
30 -inch	4,681	LF	\$ 370	\$ 1,731,900
36 -inch	29,502	LF	\$ 438	\$ 12,921,900
42 -inch	3,371	LF	\$ 510	\$ 1,719,300
54 -inch	40,704	LF	\$ 767	\$ 31,220,000
Installation in Major Arterials		EA	10.00%	\$ -
Butterfly Valves				
16 -inch	106	EA	\$ 6,866	\$ 727,800
18 -inch	8	EA	\$ 7,896	\$ 63,168
20 -inch	0	EA	\$ 10,871	\$ -
24 -inch	65	EA	\$ 20,711	\$ 1,346,215
30 -inch	5	EA	\$ 25,061	\$ 125,305
36 -inch	30	EA	\$ 34,444	\$ 1,033,400
42 -inch	4	EA	\$ 52,409	\$ 209,700
54 -inch	41	LF	\$ 81,362	\$ 3,335,900
Horizontal Drilling				
30 -inch Casing	0	LF	\$ 1,361	\$ -
36 -inch Casing	0	LF	\$ 1,361	\$ -
42 -inch Casing	0	LF	\$ 1,902	\$ -
Trench Restoration				
Paved	717,356	SF	\$ 2	\$ 1,434,712
Blow-Off Assembly	0	EA		\$ -
Fire Hydrants	0	EA		\$ -
Connection to (E) System	0	EA	\$ 10,000	\$ -
Abandonment Exist Pipe	0	EA		\$ -
Property Acquisition	0	ACRE		\$ -
Railroad Crossing Permitting	0	EA	10%	\$ -
Highway Crossing Permitting	0	EA	10%	\$ -
Highway Crossing Permitting	0	EA	10%	\$ -
SUBTOTAL				\$ 100,802,901
Contingencies	1	LS	25%	\$ 25,200,725
Engineering, Admin, and Legal	1	LS	25%	\$ 31,500,907
Environmental & Permitting	1	LS	10%	\$ 12,600,363
TOTAL				\$ 170,104,900

Zone 40 Water System Infrastructure Plan
Sacramento County Water Agency

Phases 2 and 3 Pipelines,
West Jackson

Project Element		Quantity	Unit	Unit Cost	Total
Pipelines					
	16 -inch	148,644	LF	\$ 227	\$ 33,742,300
	18 -inch	8,227	LF	\$ 257	\$ 2,114,458
	20 -inch	1,664	LF	\$ 264	\$ 439,300
	24 -inch	67,876	LF	\$ 293	\$ 19,887,607
	30 -inch	5,305	LF	\$ 370	\$ 1,962,800
	36 -inch	29,502	LF	\$ 438	\$ 12,921,900
	42 -inch	3,371	LF	\$ 510	\$ 1,719,300
	54 -inch	40,704	LF	\$ 767	\$ 31,220,000
Installation in Major Arterials			EA	10.00%	\$ -
Butterfly Valves					
	16 -inch	149	EA	\$ 6,866	\$ 1,023,100
	18 -inch	9	EA	\$ 7,896	\$ 71,064
	20 -inch	2	EA	\$ 10,871	\$ 21,742
	24 -inch	68	EA	\$ 20,711	\$ 1,408,348
	30 -inch	6	EA	\$ 25,061	\$ 150,366
	36 -inch	30	EA	\$ 34,444	\$ 1,033,400
	42 -inch	4	EA	\$ 52,409	\$ 209,700
	54 -inch	41	LF	\$ 81,362	\$ 3,335,900
Horizontal Drilling					
	30 -inch Casing	0	LF	\$ 1,361	\$ -
	36 -inch Casing	0	LF	\$ 1,361	\$ -
	42 -inch Casing	0	LF	\$ 1,902	\$ -
Trench Restoration					
	Paved	859,509	SF	\$ 2	\$ 1,719,019
Blow-Off Assembly		0	EA		\$ -
Fire Hydrants		0	EA		\$ -
Connection to (E) System		0	EA	\$ 10,000	\$ -
Abandonment Exist Pipe		0	EA		\$ -
Property Acquisition		0	ACRE		\$ -
Railroad Crossing Permitting		0	EA	10%	\$ -
Highway Crossing Permitting		0	EA	10%	\$ -
Highway Crossing Permitting		0	EA	10%	\$ -
SUBTOTAL					\$ 112,980,304
Contingencies		1	LS	25%	\$ 28,245,076
Engineering, Admin, and Legal		1	LS	25%	\$ 35,306,345
Environmental & Permitting		1	LS	10%	\$ 14,122,538
TOTAL					\$ 190,654,300

Sacramento County Water Agency		Phases 2 and 3 Pipelines, Cumulative			
Project Element	Quantity	Unit	Unit Cost	Total	
Pipelines					
16 -inch	165,716	LF	\$ 227	\$ 37,617,700	
18 -inch	14,351	LF	\$ 257	\$ 3,688,326	
20 -inch	-	LF	\$ 264	\$ -	
24 -inch	67,876	LF	\$ 293	\$ 19,887,607	
30 -inch	5,305	LF	\$ 370	\$ 1,962,800	
36 -inch	29,502	LF	\$ 438	\$ 12,921,900	
42 -inch	3,371	LF	\$ 510	\$ 1,719,300	
54 -inch	40,704	LF	\$ 767	\$ 31,220,000	
Installation in Major Arterials		EA	10.00%	\$ -	
Butterfly Valves					
16 -inch	166	EA	\$ 6,866	\$ 1,139,800	
18 -inch	15	EA	\$ 7,896	\$ 118,440	
20 -inch	0	EA	\$ 10,871	\$ -	
24 -inch	68	EA	\$ 20,711	\$ 1,408,348	
30 -inch	6	EA	\$ 25,061	\$ 150,366	
36 -inch	30	EA	\$ 34,444	\$ 1,033,400	
42 -inch	4	EA	\$ 52,409	\$ 209,700	
54 -inch	41	LF	\$ 81,362	\$ 3,335,900	
Horizontal Drilling					
30 -inch Casing	0	LF	\$ 1,361	\$ -	
36 -inch Casing	0	LF	\$ 1,361	\$ -	
42 -inch Casing	0	LF	\$ 1,902	\$ -	
Trench Restoration					
Paved	920,983	SF	\$ 2	\$ 1,841,966	
Blow-Off Assembly	0	EA		\$ -	
Fire Hydrants	0	EA		\$ -	
Connection to (E) System	0	EA	\$ 10,000	\$ -	
Abandonment Exist Pipe	0	EA		\$ -	
Property Acquisition	0	ACRE		\$ -	
Railroad Crossing Permitting	0	EA	10%	\$ -	
Highway Crossing Permitting	0	EA	10%	\$ -	
Highway Crossing Permitting	0	EA	10%	\$ -	
SUBTOTAL				\$ 118,255,553	
Contingencies	1	LS	25%	\$ 29,563,888	
Engineering, Admin, and Legal	1	LS	25%	\$ 36,954,860	
Environmental & Permitting	1	LS	10%	\$ 14,781,944	
TOTAL				\$ 199,556,300	



10540 White Rock Road, Suite 180
Rancho Cordova, CA 95670
T | 916.444.0123